

Scaled data based on original data using  
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State  
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P684833

Luminaire Tested: **LX6C130D010 EX61309040 6LBSLI**

Issue Date: 2/15/2022



**Test Information**

Test Method: LM-79-08  
Report Number: P684833  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P205419)  
Test Lab: INNOVATION CENTER  
Issue Date: 2/15/2022  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: PORTFOLIO  
Catalog Number: LX6C130D010 EX61309040 6LBSLI  
Description: 6 INCH 13000 LUMEN PORTFOLIO LED DOWNLIGHT WITH, 4000K, 90CRI LEDS  
AND 6LBS TRIM WITH LI FINISH  
Light Source: -  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 14927.0 lumens  
Efficiency: N/A  
Efficacy: 103.4 lumens/watt  
Spacing Criteria (0/90/45): 0.91 / 0.91 / 1.04  
Luminous Opening: Circular (Dia: 0.5' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 144.3  
Input Voltage (V):  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT

TEST NUMBER: P684833

CATALOG NUMBER: LX6C130D010 EX61309040 6LBSLI

### Luminous Intensity Polar Plot

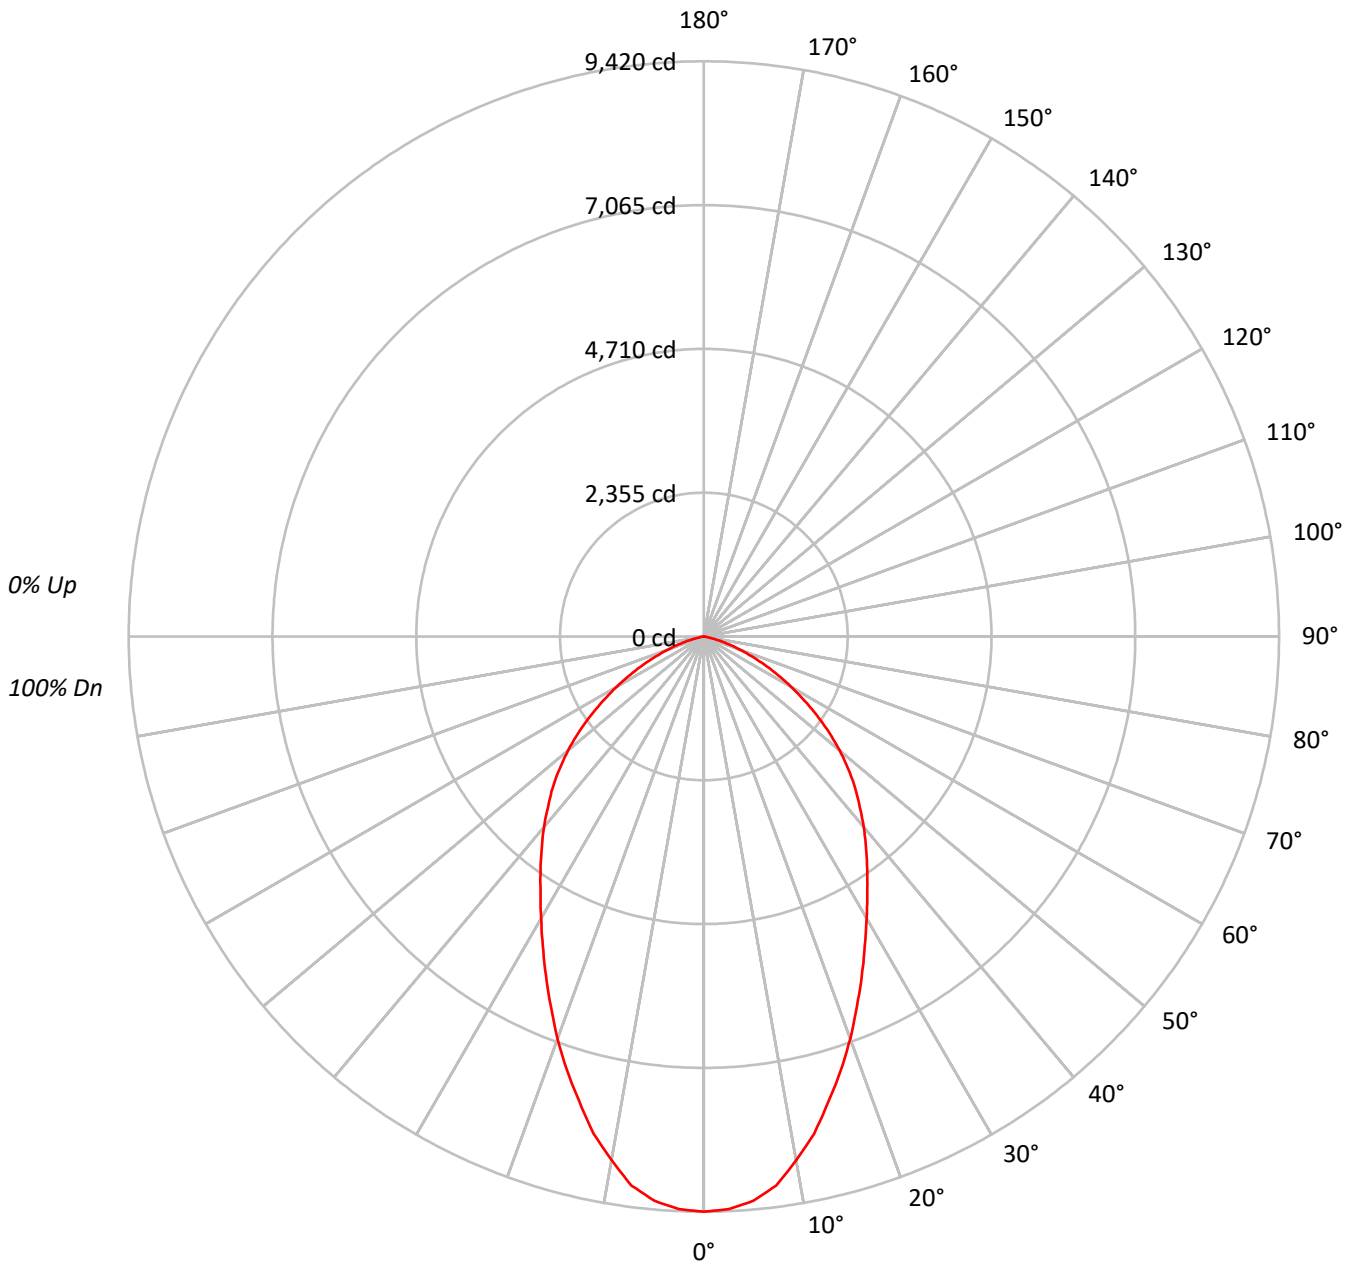



TEST NUMBER: P684833

CATALOG NUMBER: LX6C130D010 EX61309040 6LBSLI

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |    |    |    |     |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|----|-----|
| RF  | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |    |    | 20 |     |
| RC  | 80  |     |     |     | 70  |     |     |     | 50  |     |     |     | 30  |     |     |     | 10  |     |    |    | 0  |     |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30 | 10 | 0  |     |
| RCR |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |    |    |    |     |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 |    |    |    | 100 |
| 1   | 111 | 107 | 104 | 101 | 109 | 105 | 102 | 99  | 101 | 99  | 96  | 97  | 95  | 93  | 94  | 92  | 91  | 89  |    |    |    | 89  |
| 2   | 103 | 96  | 91  | 86  | 100 | 94  | 89  | 85  | 91  | 87  | 83  | 88  | 84  | 81  | 85  | 82  | 79  | 77  |    |    |    | 77  |
| 3   | 95  | 86  | 79  | 74  | 93  | 85  | 78  | 73  | 82  | 76  | 72  | 79  | 75  | 71  | 77  | 73  | 70  | 68  |    |    |    | 68  |
| 4   | 88  | 78  | 70  | 64  | 86  | 77  | 69  | 64  | 74  | 68  | 63  | 72  | 67  | 62  | 70  | 65  | 62  | 60  |    |    |    | 60  |
| 5   | 82  | 71  | 63  | 57  | 80  | 70  | 62  | 57  | 67  | 61  | 56  | 66  | 60  | 55  | 64  | 59  | 55  | 53  |    |    |    | 53  |
| 6   | 76  | 64  | 56  | 51  | 74  | 63  | 56  | 51  | 62  | 55  | 50  | 60  | 54  | 50  | 59  | 53  | 49  | 47  |    |    |    | 47  |
| 7   | 71  | 59  | 51  | 46  | 70  | 58  | 51  | 45  | 57  | 50  | 45  | 55  | 49  | 45  | 54  | 49  | 45  | 43  |    |    |    | 43  |
| 8   | 67  | 54  | 47  | 41  | 65  | 54  | 46  | 41  | 52  | 46  | 41  | 51  | 45  | 41  | 50  | 45  | 41  | 39  |    |    |    | 39  |
| 9   | 63  | 50  | 43  | 38  | 61  | 50  | 43  | 38  | 49  | 42  | 38  | 48  | 42  | 37  | 47  | 41  | 37  | 36  |    |    |    | 36  |
| 10  | 59  | 47  | 40  | 35  | 58  | 46  | 39  | 35  | 45  | 39  | 35  | 45  | 39  | 34  | 44  | 38  | 34  | 33  |    |    |    | 33  |

**AVERAGE LUMINANCE (cd/sqm):**

|     |        |
|-----|--------|
|     | 0°     |
| 0°  | 516384 |
| 5°  | 510504 |
| 10° | 484621 |
| 15° | 447295 |
| 20° | 408911 |
| 25° | 370261 |
| 30° | 337286 |
| 35° | 312022 |
| 40° | 291646 |
| 45° | 271695 |
| 50° | 247497 |
| 55° | 216728 |
| 60° | 180819 |
| 65° | 141922 |
| 70° | 99119  |
| 75° | 53715  |
| 80° | 10071  |
| 85° | 0      |



TEST NUMBER: P684833

CATALOG NUMBER: LX6C130D010 EX61309040 6LBSLI

**ZONAL LUMENS:**

| Zone      | Lumens  | % Fixture |
|-----------|---------|-----------|
| 0°-10°    | 868.0   | 5.8       |
| 10°-20°   | 2209.8  | 14.8      |
| 20°-30°   | 2817.9  | 18.9      |
| 30°-40°   | 2922.3  | 19.6      |
| 40°-50°   | 2692.7  | 18.0      |
| 50°-60°   | 2025.5  | 13.6      |
| 60°-70°   | 1093.3  | 7.3       |
| 70°-80°   | 293.3   | 2.0       |
| 80°-90°   | 4.3     | 0.0       |
| 90°-100°  | 0.0     | 0.0       |
| 100°-110° | 0.0     | 0.0       |
| 110°-120° | 0.0     | 0.0       |
| 120°-130° | 0.0     | 0.0       |
| 130°-140° | 0.0     | 0.0       |
| 140°-150° | 0.0     | 0.0       |
| 150°-160° | 0.0     | 0.0       |
| 160°-170° | 0.0     | 0.0       |
| 170°-180° | 0.0     | 0.0       |
| 0°-30°    | 5895.7  | 39.5      |
| 0°-40°    | 8817.9  | 59.1      |
| 0°-60°    | 13536.1 | 90.7      |
| 0°-90°    | 14927.0 | 100.0     |
| 90°-120°  | 0.0     | 0.0       |
| 90°-150°  | 0.0     | 0.0       |
| 90°-180°  | 0.0     | 0.0       |
| 0°-180°   | 14927.0 | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°   | Flux |
|-----|------|------|
| 0°  | 9420 |      |
| 5°  | 9277 | 868  |
| 15° | 7881 | 2210 |
| 25° | 6121 | 2818 |
| 35° | 4662 | 2922 |
| 45° | 3504 | 2693 |
| 55° | 2268 | 2025 |
| 65° | 1094 | 1093 |
| 75° | 254  | 293  |
| 85° | 0    | 4    |
| 90° | 0    |      |



TEST NUMBER: P684833

CATALOG NUMBER: LX6C130D010 EX61309040 6LBSLI

**CANDELA DISTRIBUTION (FULL):**

|       | 0°     |
|-------|--------|
| 0°    | 9419.6 |
| 2.5°  | 9388.1 |
| 5°    | 9276.9 |
| 7.5°  | 9070.8 |
| 10°   | 8705.9 |
| 12.5° | 8341.4 |
| 15°   | 7881.3 |
| 17.5° | 7453.5 |
| 20°   | 7009.3 |
| 22.5° | 6549.5 |
| 25°   | 6121.3 |
| 27.5° | 5709.0 |
| 30°   | 5328.3 |
| 32.5° | 4979.4 |
| 35°   | 4662.4 |
| 37.5° | 4360.9 |
| 40°   | 4075.4 |
| 42.5° | 3774.4 |
| 45°   | 3504.5 |
| 47.5° | 3203.4 |
| 50°   | 2902.0 |
| 52.5° | 2585.0 |
| 55°   | 2267.6 |
| 57.5° | 1950.6 |
| 60°   | 1649.2 |
| 62.5° | 1363.7 |
| 65°   | 1094.1 |
| 67.5° | 840.5  |
| 70°   | 618.4  |
| 72.5° | 428.2  |
| 75°   | 253.6  |
| 77.5° | 110.9  |
| 80°   | 31.9   |
| 82.5° | 0.0    |
| 85°   | 0.0    |
| 87.5° | 0.0    |
| 90°   | 0.0    |



Report Generated By 670246072 / DESKTOP-50001EG







— 0°-180°







(END OF REPORT)