

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P684283

Luminaire Tested: **LX6C40D010 EX6C409727 6LBSH**

Issue Date: 2/15/2022



Test Information

Test Method: LM-79-08
Report Number: P684283
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P204188)
Test Lab: INNOVATION CENTER
Issue Date: 2/15/2022
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LX6C40D010 EX6C409727 6LBSH
Description: 6 INCH 4000 LUMEN PORTFOLIO LED DOWNLIGHT WITH, 2700K, 97CRI LEDS
AND 6LBS TRIM WITH H FINISH
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4121.0 lumens
Efficiency: N/A
Efficacy: 87.7 lumens/watt
Spacing Criteria (0/90/45): 1.06 / 1.06 / 1.17
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 47
Input Voltage (V):
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P684283

CATALOG NUMBER: LX6C40D010 EX6C409727 6LBSH

Luminous Intensity Polar Plot

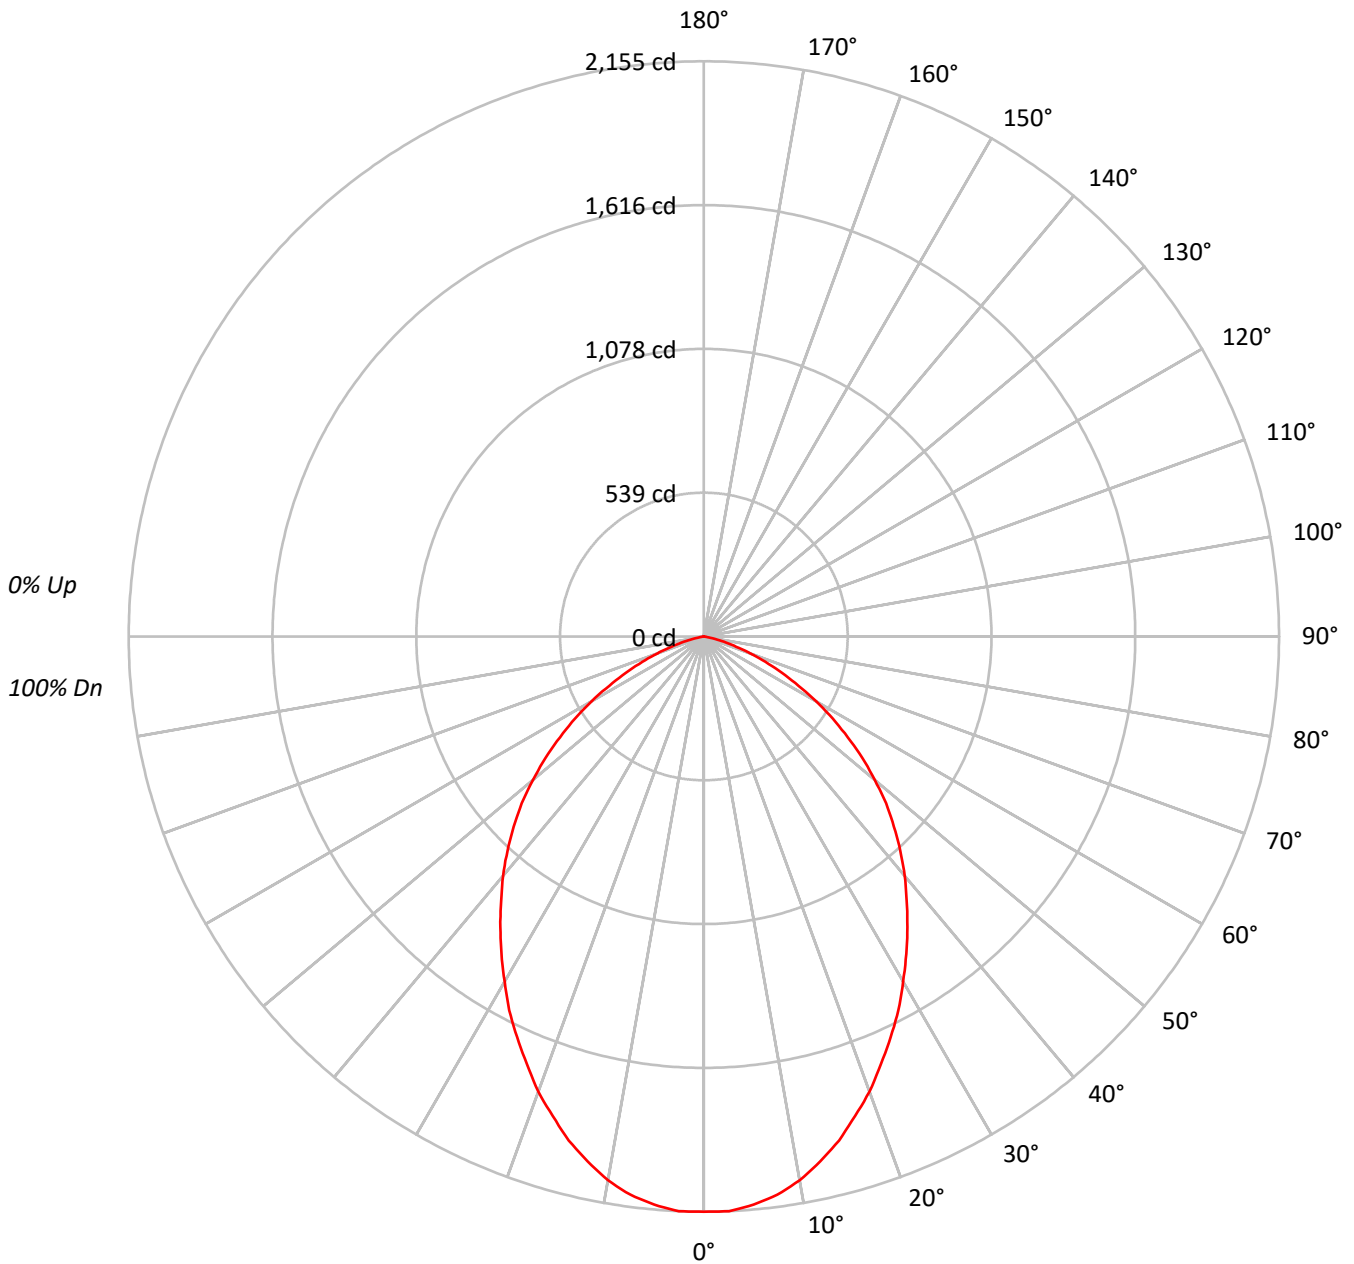



TEST NUMBER: P684283

CATALOG NUMBER: LX6C40D010 EX6C409727 6LBSH

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|---|--|--|--|--|--|--|----|--|--|--|--|--|--|--|--|---|
| RF | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | |
| RC | 80 | | | | | | | | | 50 | | | | | | | | | 30 | | | | | | | | | 10 | | | | | | | | | 0 |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 | | | | | | | | | | | | | | | | |
| RCR | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | | | | | | | | | | | | | | | | | | |
| 1 | 111 | 107 | 104 | 101 | 108 | 105 | 102 | 99 | 101 | 98 | 96 | 97 | 95 | 93 | 93 | 92 | 90 | 88 | | | | | | | | | | | | | | | | | | | |
| 2 | 102 | 96 | 90 | 85 | 100 | 94 | 88 | 84 | 90 | 86 | 82 | 87 | 83 | 80 | 84 | 81 | 79 | 77 | | | | | | | | | | | | | | | | | | | |
| 3 | 95 | 85 | 78 | 73 | 92 | 84 | 77 | 72 | 81 | 75 | 71 | 78 | 74 | 70 | 76 | 72 | 69 | 67 | | | | | | | | | | | | | | | | | | | |
| 4 | 87 | 77 | 69 | 63 | 85 | 75 | 68 | 63 | 73 | 67 | 62 | 71 | 65 | 61 | 69 | 64 | 60 | 58 | | | | | | | | | | | | | | | | | | | |
| 5 | 81 | 69 | 61 | 55 | 79 | 68 | 61 | 55 | 66 | 60 | 55 | 64 | 59 | 54 | 63 | 58 | 53 | 51 | | | | | | | | | | | | | | | | | | | |
| 6 | 75 | 63 | 55 | 49 | 73 | 62 | 54 | 49 | 60 | 54 | 49 | 59 | 53 | 48 | 57 | 52 | 48 | 46 | | | | | | | | | | | | | | | | | | | |
| 7 | 70 | 58 | 50 | 44 | 68 | 57 | 49 | 44 | 55 | 49 | 44 | 54 | 48 | 43 | 53 | 47 | 43 | 41 | | | | | | | | | | | | | | | | | | | |
| 8 | 65 | 53 | 45 | 40 | 64 | 52 | 45 | 40 | 51 | 44 | 39 | 50 | 44 | 39 | 49 | 43 | 39 | 37 | | | | | | | | | | | | | | | | | | | |
| 9 | 61 | 49 | 41 | 36 | 60 | 48 | 41 | 36 | 47 | 40 | 36 | 46 | 40 | 36 | 45 | 40 | 35 | 34 | | | | | | | | | | | | | | | | | | | |
| 10 | 58 | 45 | 38 | 33 | 56 | 45 | 38 | 33 | 44 | 37 | 33 | 43 | 37 | 33 | 42 | 37 | 33 | 31 | | | | | | | | | | | | | | | | | | | |

AVERAGE LUMINANCE (cd/sqm):

| | |
|-----|--------|
| | 0° |
| 0° | 118154 |
| 5° | 117604 |
| 10° | 115173 |
| 15° | 110988 |
| 20° | 105884 |
| 25° | 100173 |
| 30° | 94496 |
| 35° | 88974 |
| 40° | 83778 |
| 45° | 78093 |
| 50° | 71204 |
| 55° | 62889 |
| 60° | 53230 |
| 65° | 41794 |
| 70° | 29829 |
| 75° | 16330 |
| 80° | 2873 |
| 85° | 0 |



TEST NUMBER: P684283

CATALOG NUMBER: LX6C40D010 EX6C409727 6LBSH

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 201.9 | 4.9 |
| 10°-20° | 548.7 | 13.3 |
| 20°-30° | 762.0 | 18.5 |
| 30°-40° | 831.6 | 20.2 |
| 40°-50° | 775.7 | 18.8 |
| 50°-60° | 588.8 | 14.3 |
| 60°-70° | 322.4 | 7.8 |
| 70°-80° | 88.7 | 2.2 |
| 80°-90° | 1.2 | 0.0 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 1512.6 | 36.7 |
| 0°-40° | 2344.2 | 56.9 |
| 0°-60° | 3708.7 | 90.0 |
| 0°-90° | 4121.0 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 4121.0 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 2155 | |
| 5° | 2137 | 202 |
| 15° | 1956 | 549 |
| 25° | 1656 | 762 |
| 35° | 1330 | 832 |
| 45° | 1007 | 776 |
| 55° | 658 | 589 |
| 65° | 322 | 322 |
| 75° | 77 | 89 |
| 85° | 0 | 1 |
| 90° | 0 | |



TEST NUMBER: P684283

CATALOG NUMBER: LX6C40D010 EX6C409727 6LBSH

CANDELA DISTRIBUTION (FULL):

| | 0° |
|-------|--------|
| 0° | 2155.3 |
| 2.5° | 2155.3 |
| 5° | 2137.1 |
| 7.5° | 2109.8 |
| 10° | 2069.0 |
| 12.5° | 2014.6 |
| 15° | 1955.6 |
| 17.5° | 1883.0 |
| 20° | 1815.0 |
| 22.5° | 1733.3 |
| 25° | 1656.1 |
| 27.5° | 1579.0 |
| 30° | 1492.8 |
| 32.5° | 1411.1 |
| 35° | 1329.5 |
| 37.5° | 1247.8 |
| 40° | 1170.7 |
| 42.5° | 1089.0 |
| 45° | 1007.3 |
| 47.5° | 925.6 |
| 50° | 834.9 |
| 52.5° | 748.7 |
| 55° | 658.0 |
| 57.5° | 571.7 |
| 60° | 485.5 |
| 62.5° | 399.3 |
| 65° | 322.2 |
| 67.5° | 249.5 |
| 70° | 186.1 |
| 72.5° | 127.0 |
| 75° | 77.1 |
| 77.5° | 36.3 |
| 80° | 9.1 |
| 82.5° | 0.0 |
| 85° | 0.0 |
| 87.5° | 0.0 |
| 90° | 0.0 |



Report Generated By 670246072 / DESKTOP-50001EG





— 0°-180°







(END OF REPORT)