

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P684525

Luminaire Tested: **LX6C70D010 EX6C709027 6LBSH**

Issue Date: 2/15/2022

Test Information

Test Method: LM-79-08
Report Number: P684525
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P204188)
Test Lab: INNOVATION CENTER
Issue Date: 2/15/2022
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LX6C70D010 EX6C709027 6LBSH
Description: 6 INCH 7000 LUMEN PORTFOLIO LED DOWNLIGHT WITH, 2700K, 90CRI LEDS
AND 6LBS TRIM WITH H FINISH
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 7174.0 lumens
Efficiency: N/A
Efficacy: 92.0 lumens/watt
Spacing Criteria (0/90/45): 1.06 / 1.06 / 1.17
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 78
Input Voltage (V):
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P684525
CATALOG NUMBER: LX6C70D010 EX6C709027 6LBSH

Luminous Intensity Polar Plot

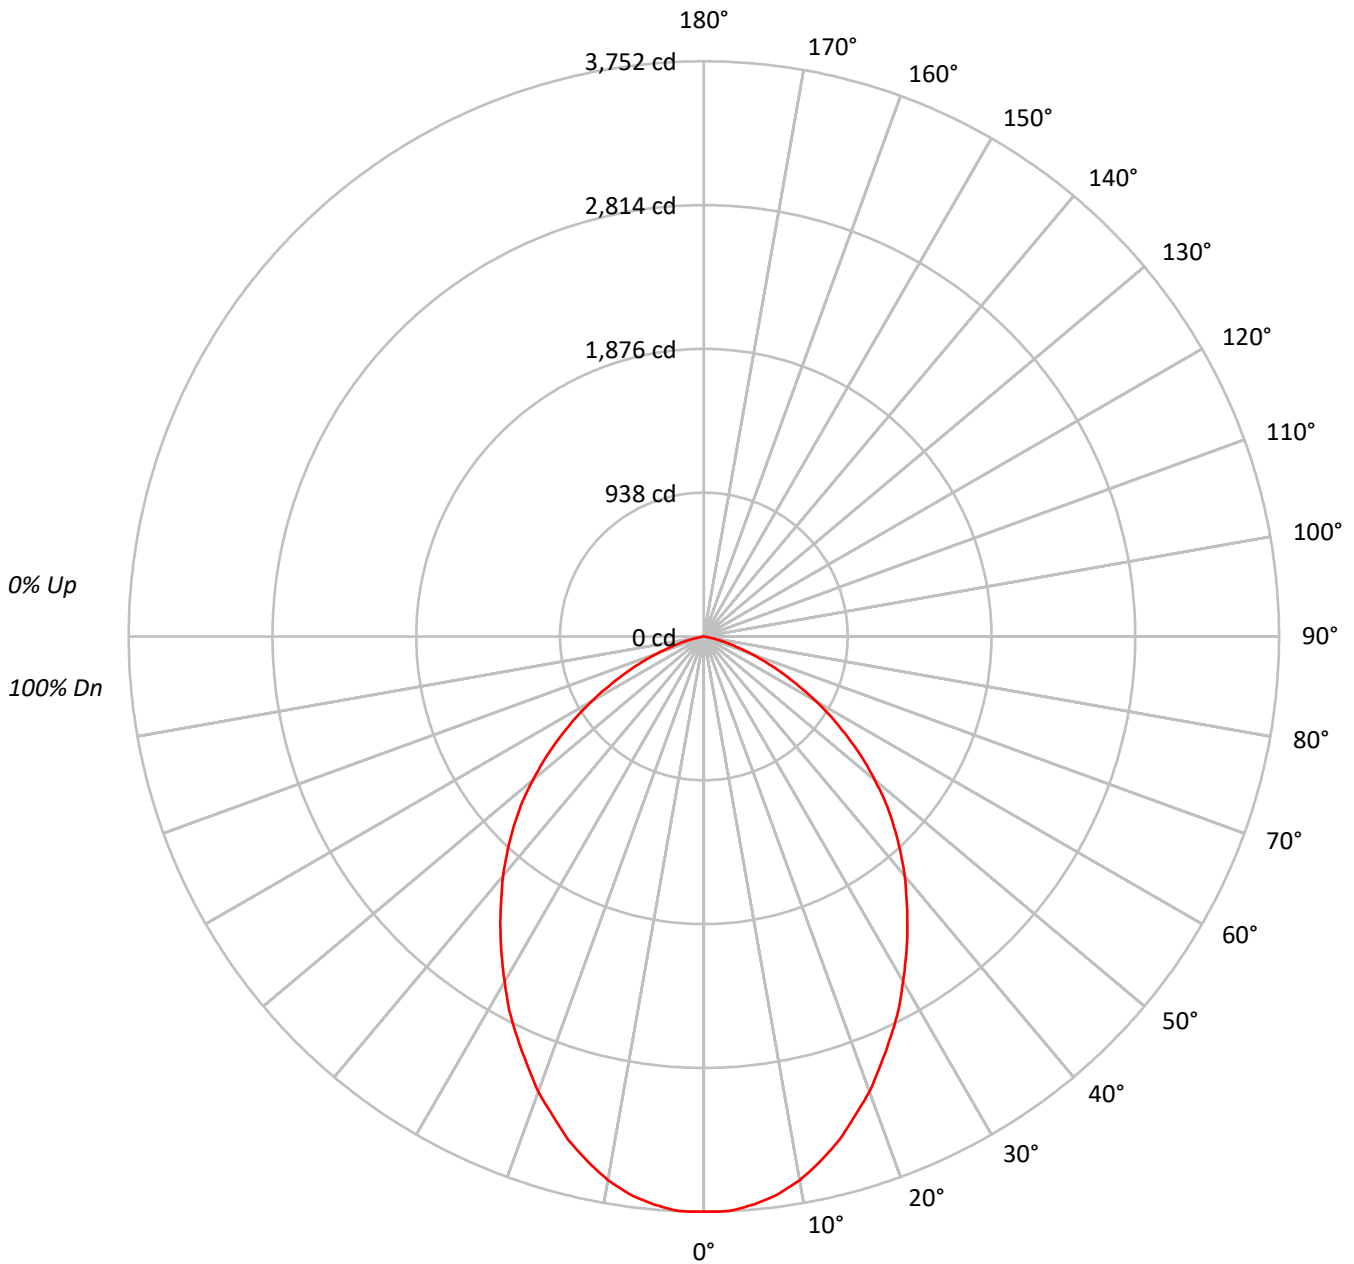



TEST NUMBER: P684525

CATALOG NUMBER: LX6C70D010 EX6C709027 6LBSH

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	111	107	104	101	108	105	102	99	101	98	96	97	95	93	93	92	90	88																			
2	102	96	90	85	100	94	88	84	90	86	82	87	83	80	84	81	79	77																			
3	95	85	78	73	92	84	77	72	81	75	71	78	74	70	76	72	69	67																			
4	87	77	69	63	85	75	68	63	73	67	62	71	65	61	69	64	60	58																			
5	81	69	61	55	79	68	61	55	66	60	55	64	59	54	63	58	53	51																			
6	75	63	55	49	73	62	54	49	60	54	49	59	53	48	57	52	48	46																			
7	70	58	50	44	68	57	49	44	55	49	44	54	48	43	53	47	43	41																			
8	65	53	45	40	64	52	45	40	51	44	39	50	44	39	49	43	39	37																			
9	61	49	41	36	60	48	41	36	47	40	36	46	40	36	45	40	35	34																			
10	58	45	38	33	56	45	38	33	44	37	33	43	37	33	42	37	33	31																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	205685
5°	204727
10°	200503
15°	193208
20°	184326
25°	174391
30°	164500
35°	154887
40°	145838
45°	135944
50°	123953
55°	109473
60°	92657
65°	72757
70°	51916
75°	28446
80°	5020
85°	0



TEST NUMBER: P684525

CATALOG NUMBER: LX6C70D010 EX6C709027 6LBSH

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	351.4	4.9
10°-20°	955.2	13.3
20°-30°	1326.6	18.5
30°-40°	1447.6	20.2
40°-50°	1350.4	18.8
50°-60°	1025.0	14.3
60°-70°	561.3	7.8
70°-80°	154.5	2.2
80°-90°	2.2	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2633.2	36.7
0°-40°	4080.8	56.9
0°-60°	6456.1	90.0
0°-90°	7174.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7174.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3752	
5°	3720	351
15°	3404	955
25°	2883	1327
35°	2314	1448
45°	1754	1350
55°	1145	1025
65°	561	561
75°	134	154
85°	0	2
90°	0	



TEST NUMBER: P684525

CATALOG NUMBER: LX6C70D010 EX6C709027 6LBSH

CANDELA DISTRIBUTION (FULL):

	0°
0°	3752.0
2.5°	3752.0
5°	3720.3
7.5°	3672.9
10°	3601.9
12.5°	3507.1
15°	3404.3
17.5°	3278.0
20°	3159.6
22.5°	3017.4
25°	2883.1
27.5°	2748.8
30°	2598.7
32.5°	2456.5
35°	2314.4
37.5°	2172.2
40°	2037.9
42.5°	1895.7
45°	1753.5
47.5°	1611.3
50°	1453.4
52.5°	1303.3
55°	1145.4
57.5°	995.3
60°	845.1
62.5°	695.2
65°	560.9
67.5°	434.4
70°	323.9
72.5°	221.2
75°	134.3
77.5°	63.3
80°	15.9
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670246072 / DESKTOP-50001EG





— 0°-180°







(END OF REPORT)