

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P684586

Luminaire Tested: **LX6C75D010 EX6C759040 6LBWH**

Issue Date: 2/15/2022



Test Information

Test Method: LM-79-08
Report Number: P684586
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P202739)
Test Lab: INNOVATION CENTER
Issue Date: 2/15/2022
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LX6C75D010 EX6C759040 6LBWH
Description: 6 INCH 7500 LUMEN PORTFOLIO LED DOWNLIGHT WITH, 4000K, 90CRI LEDS
AND 6LBW TRIM WITH H FINISH
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7565.0 lumens
Efficiency: N/A
Efficacy: 92.8 lumens/watt
Spacing Criteria (0/90/45): 1.16 / 1.16 / 1.16
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 81.5
Input Voltage (V):
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P684586

CATALOG NUMBER: LX6C75D010 EX6C759040 6LBWH

Luminous Intensity Polar Plot

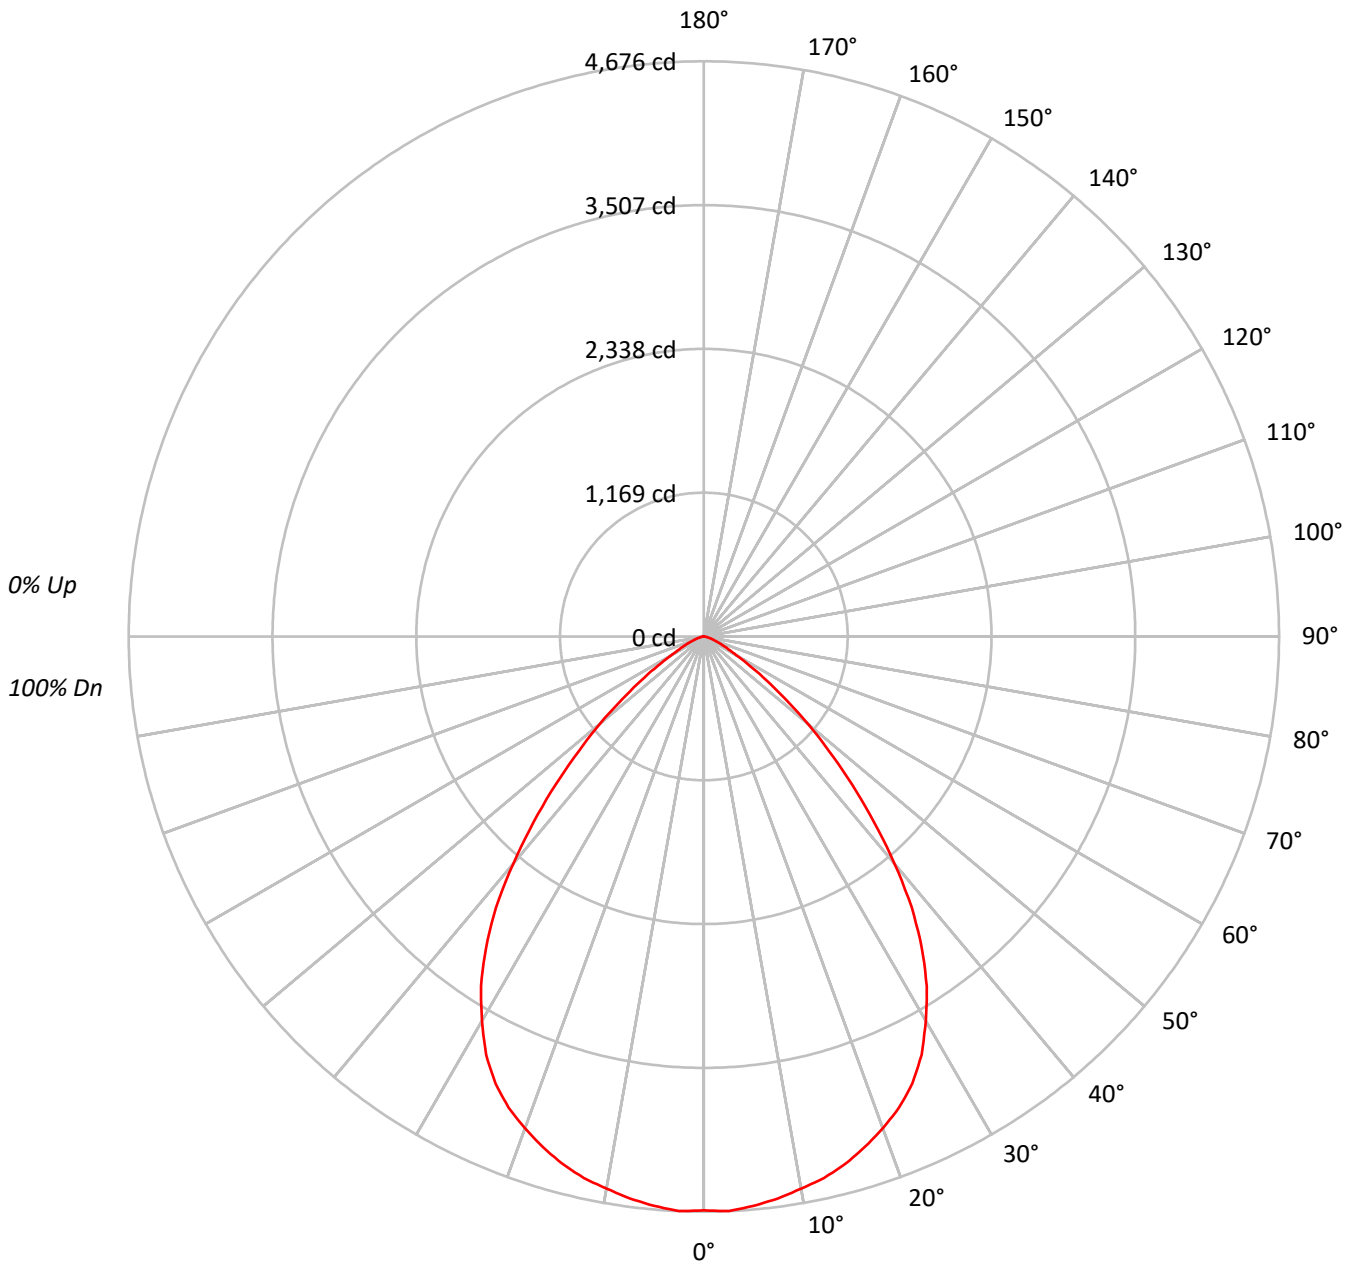



TEST NUMBER: P684586

CATALOG NUMBER: LX6C75D010 EX6C759040 6LBWH

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	112	109	106	103	110	107	104	101	103	100	98	99	97	95	95	94	93	91																			
2	105	99	94	90	103	97	93	89	94	90	87	91	88	85	88	85	83	81																			
3	98	90	84	79	96	89	83	78	86	81	77	83	79	76	81	78	75	73																			
4	92	82	75	70	90	81	75	70	79	73	69	77	72	68	75	71	67	65																			
5	86	75	68	63	84	74	68	63	72	66	62	71	65	61	69	64	61	59																			
6	80	69	62	57	78	68	61	56	67	61	56	65	60	56	64	59	55	53																			
7	75	64	56	51	73	63	56	51	62	55	51	60	55	51	59	54	50	49																			
8	70	59	52	47	69	58	51	47	57	51	46	56	50	46	55	50	46	44																			
9	66	55	48	43	65	54	47	43	53	47	43	52	47	42	51	46	42	41																			
10	62	51	44	40	61	50	44	39	50	43	39	49	43	39	48	43	39	38																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	255780
5°	255689
10°	253725
15°	252022
20°	248183
25°	242512
30°	228345
35°	206652
40°	172559
45°	132223
50°	93643
55°	59037
60°	33298
65°	21624
70°	14121
75°	10379
80°	6219
85°	6227



TEST NUMBER: P684586

CATALOG NUMBER: LX6C75D010 EX6C759040 6LBWH

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	440.7	5.8
10°-20°	1250.5	16.5
20°-30°	1833.5	24.2
30°-40°	1908.2	25.2
40°-50°	1320.2	17.5
50°-60°	574.8	7.6
60°-70°	176.3	2.3
70°-80°	52.8	0.7
80°-90°	8.1	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3524.6	46.6
0°-40°	5432.8	71.8
0°-60°	7327.8	96.9
0°-90°	7565.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7565.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4666	
5°	4646	441
15°	4441	1250
25°	4009	1833
35°	3088	1908
45°	1706	1320
55°	618	575
65°	167	176
75°	49	53
85°	10	8
90°	0	



TEST NUMBER: P684586

CATALOG NUMBER: LX6C75D010 EX6C759040 6LBWH

CANDELA DISTRIBUTION (FULL):

0°	
0°	4665.8
2.5°	4675.7
5°	4646.4
7.5°	4607.3
10°	4558.0
12.5°	4509.0
15°	4440.6
17.5°	4352.2
20°	4254.2
22.5°	4146.4
25°	4009.3
27.5°	3832.8
30°	3607.3
32.5°	3371.9
35°	3087.9
37.5°	2774.3
40°	2411.3
42.5°	2048.7
45°	1705.5
47.5°	1382.0
50°	1098.0
52.5°	833.4
55°	617.7
57.5°	441.2
60°	303.7
62.5°	225.5
65°	166.7
67.5°	127.6
70°	88.1
72.5°	68.7
75°	49.0
77.5°	29.2
80°	19.7
82.5°	9.9
85°	9.9
87.5°	0.0
90°	0.0



Report Generated By 670246072 / DESKTOP-50001EG





— 0°-180°







(END OF REPORT)