

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: PORTFOLIO

Report Number: P856568

Luminaire Tested: **LD6C08D010 EU6089027 6LBWLI**

Issue Date: 2/15/2022

This test was performed under the Supervised Manufacturer's Testing Program. The results of this test have not been influenced by sources from within Cooper Lighting Solutions or from external interests.



Test Information

Test Method: LM-79-08
Report Number: P856568
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P205209)
Test Lab: INNOVATION CENTER
Issue Date: 2/15/2022
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LD6C08D010 EU6089027 6LBWLI
Description: 6 INCH 800 LUMEN PORTFOLIO LED DOWNLIGHT WITH, 2700K, 90CRI LEDS AND 6LBW TRIM WITH LI FINISH
Light Source: -
Ballast/Driver: -

Luminaire Equipment: Sample No. Condition Description

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 874.0 lumens
Efficiency: N/A
Efficacy: 88.3 lumens/watt
Spacing Criteria (0/90/45): 1.24 / 1.24 / 1.18
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 9.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P856568

CATALOG NUMBER: LD6C08D010 EU6089027 6LBWLI

Luminous Intensity Polar Plot

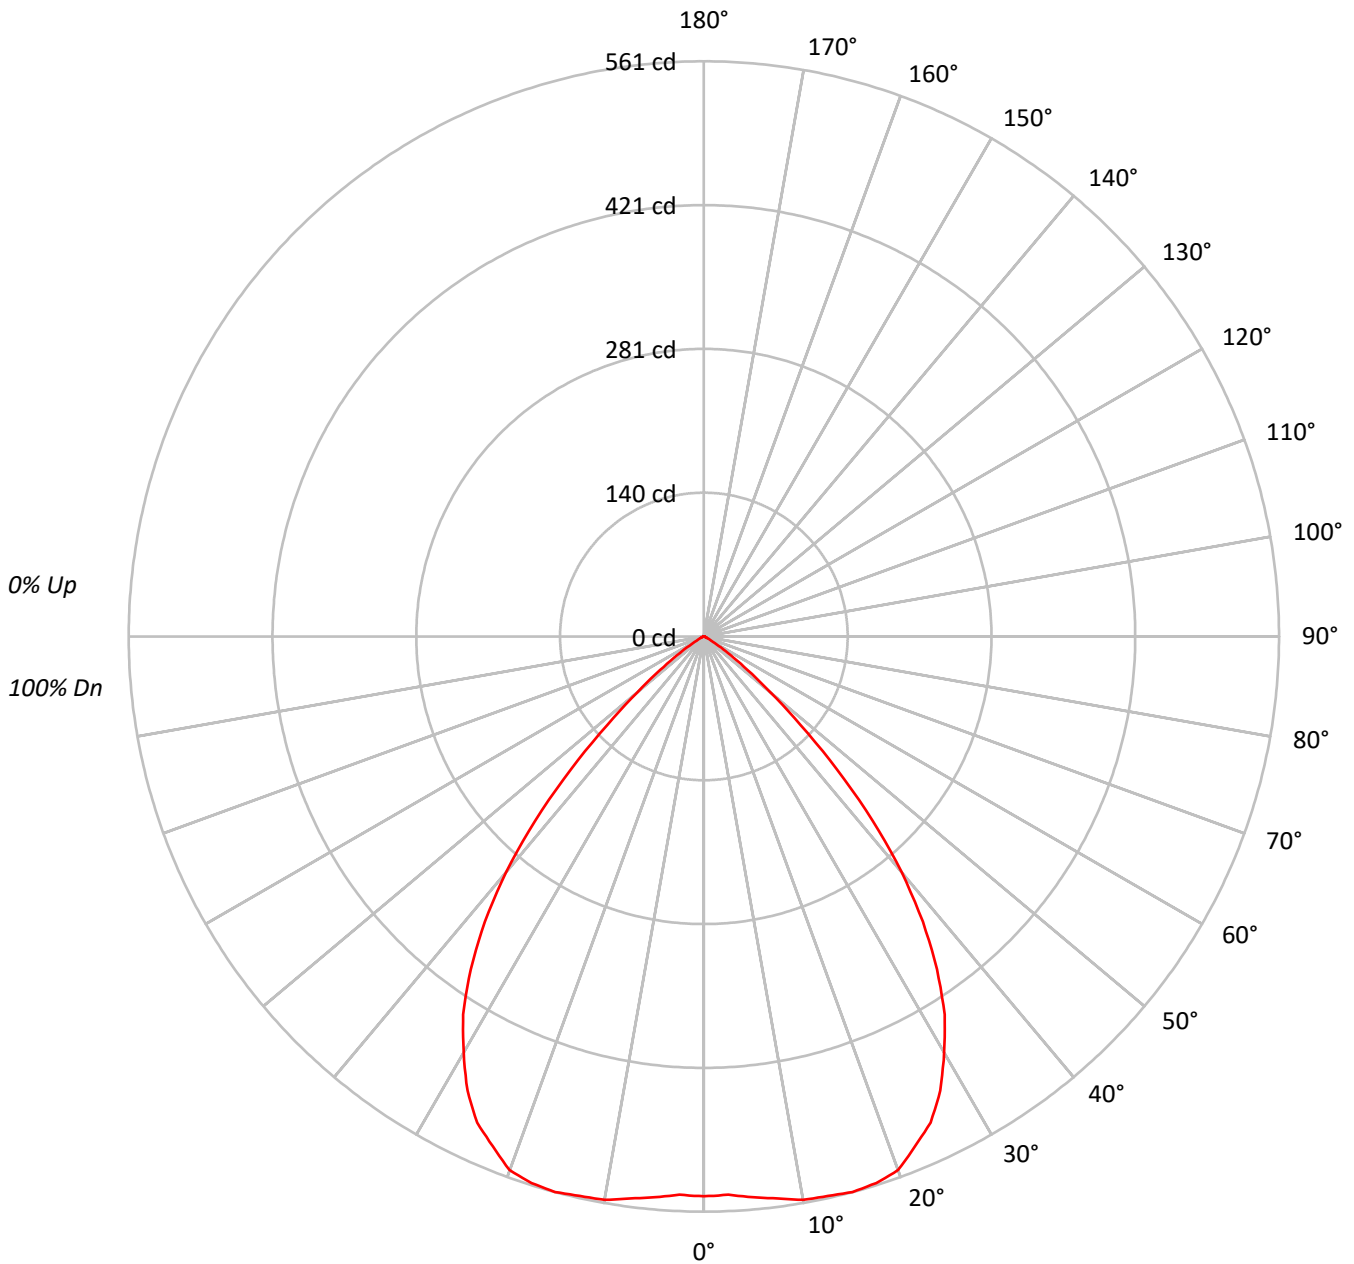



TEST NUMBER: P856568

CATALOG NUMBER: LD6C08D010 EU6089027 6LBWLI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	110	107	104	110	107	105	103	103	101	99	100	98	97	96	95	94	92	92	92	92
2	106	101	96	92	104	99	95	91	95	92	89	92	90	87	90	87	85	83	83	83	83
3	100	92	87	82	97	91	86	81	88	84	80	86	82	79	83	80	77	76	76	76	76
4	93	85	78	73	92	84	78	73	81	76	72	79	75	71	77	74	70	69	69	69	69
5	88	78	71	66	86	77	71	66	75	70	65	73	69	65	72	68	64	63	63	63	63
6	82	72	65	60	81	71	65	60	70	64	59	68	63	59	67	62	59	57	57	57	57
7	77	67	60	55	76	66	59	55	65	59	54	63	58	54	62	57	54	52	52	52	52
8	73	62	55	50	71	61	55	50	60	54	50	59	54	50	58	53	49	48	48	48	48
9	69	57	51	46	67	57	50	46	56	50	46	55	50	46	54	49	46	44	44	44	44
10	65	54	47	43	64	53	47	42	52	46	42	51	46	42	51	46	42	41	41	41	41

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	29932
5°	30211
10°	31056
15°	31833
20°	32314
25°	31647
30°	29669
35°	26528
40°	21483
45°	14211
50°	7181
55°	3030
60°	976
65°	389
70°	321
75°	212
80°	0
85°	0



TEST NUMBER: P856568

CATALOG NUMBER: LD6C08D010 EU6089027 6LBWLI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	52.7	6.0
10°-20°	158.3	18.1
20°-30°	238.7	27.3
30°-40°	244.3	27.9
40°-50°	142.3	16.3
50°-60°	32.7	3.7
60°-70°	4.0	0.5
70°-80°	1.1	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	449.7	51.4
0°-40°	693.9	79.4
0°-60°	868.9	99.4
0°-90°	874.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	874.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	546	
5°	549	53
15°	561	158
25°	523	239
35°	396	244
45°	183	142
55°	32	33
65°	3	4
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P856568

CATALOG NUMBER: LD6C08D010 EU6089027 6LBWLI

CANDELA DISTRIBUTION (FULL):

	0°
0°	546.0
2.5°	545.0
5°	549.0
7.5°	552.9
10°	557.9
12.5°	558.9
15°	560.9
17.5°	558.9
20°	553.9
22.5°	538.1
25°	523.2
27.5°	499.4
30°	468.7
32.5°	437.0
35°	396.4
37.5°	350.8
40°	300.2
42.5°	243.8
45°	183.3
47.5°	127.8
50°	84.2
52.5°	53.5
55°	31.7
57.5°	16.9
60°	8.9
62.5°	5.0
65°	3.0
67.5°	3.0
70°	2.0
72.5°	1.0
75°	1.0
77.5°	1.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670246072 / DESKTOP-50001EG





— 0°-180°







(END OF REPORT)