

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P136094

Luminaire Tested: **LD6A30D010TE ERW6A30935 6LW1LI**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P136094
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P23358)
Test Lab: INNOVATION CENTER P2
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LD6A30D010TE ERW6A30935 6LW1LI
Description: PORTFOLIO 6 INCH 60 DEGREE CUTOFF RECESSED DOWNLIGHT
WIDE DISTRIBUTION WITH SPECULAR CLEAR TRIM
Light Source: (1) HIGH LUMEN LED 3500K
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2780.0 lumens
Efficiency: N/A
Efficacy: 61.2 lumens/watt
Spacing Criteria (0/90/45): 1.22 / 1.22 / 1.12
Luminous Opening: Circular (Dia: 0.46' x H: 0')
CIE Type: Direct


Input Watts (W): 45.4
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P136094

CATALOG NUMBER: LD6A30D010TE ERW6A30935 6LW1LI

Luminous Intensity Polar Plot

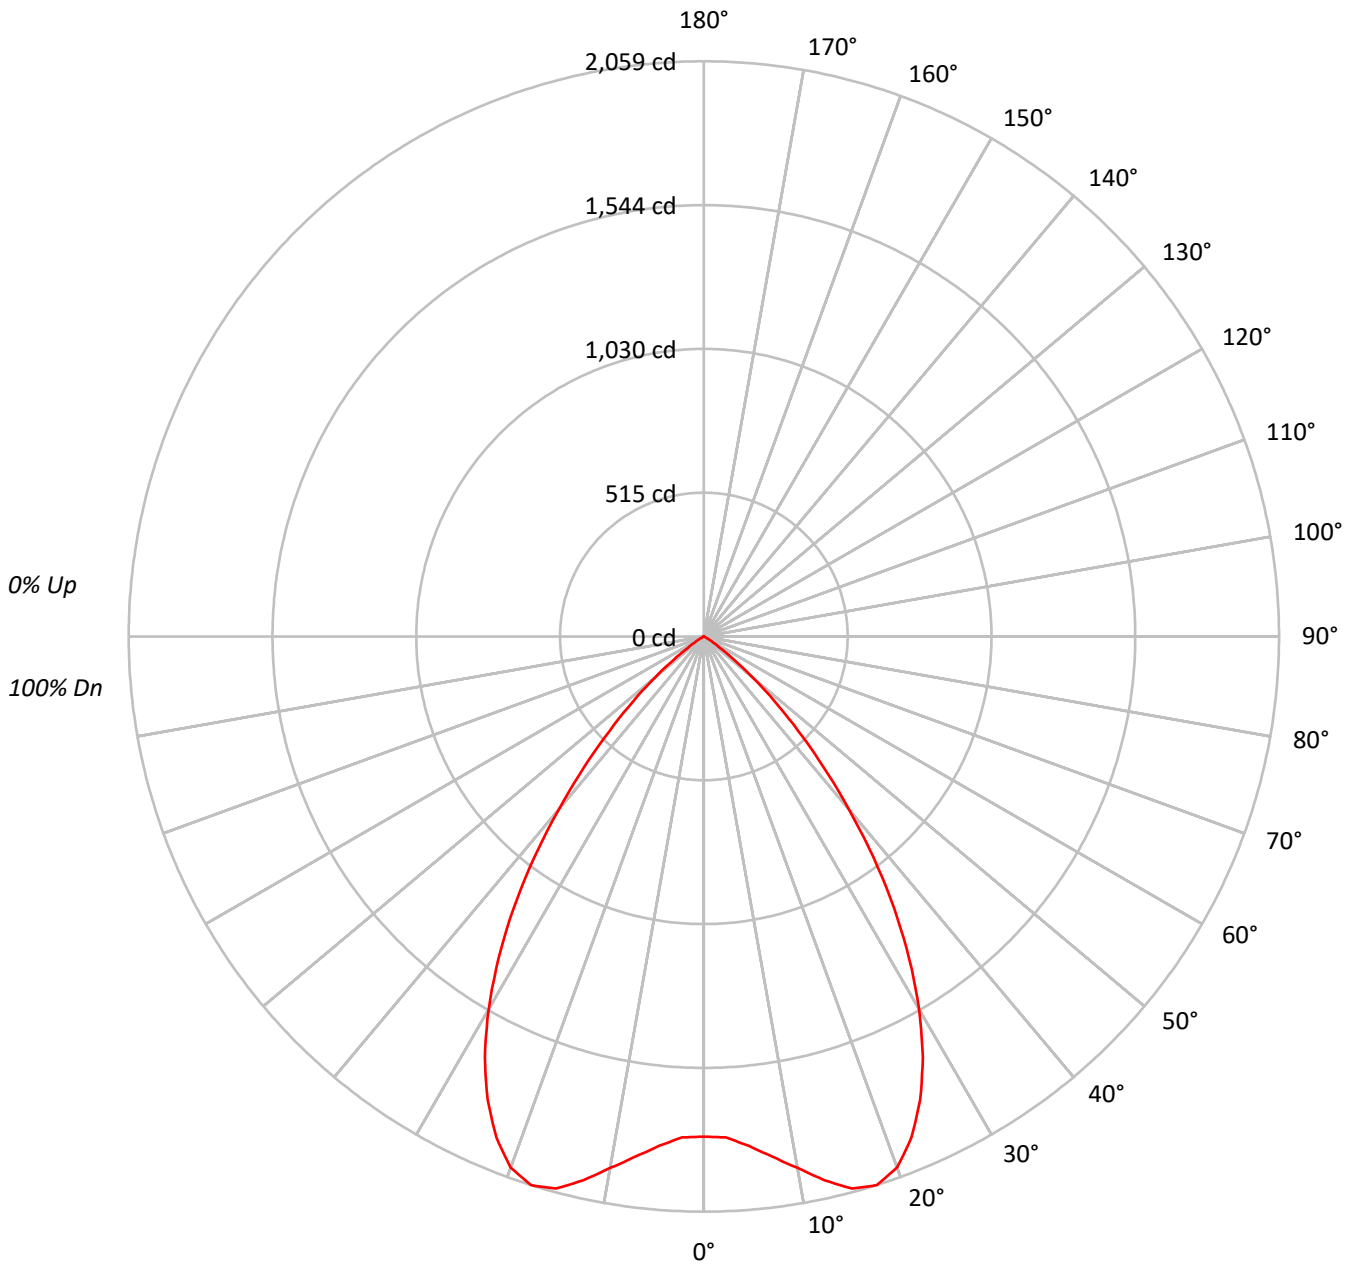



TEST NUMBER: P136094

CATALOG NUMBER: LD6A30D010TE ERW6A30935 6LW1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	110	107	105	110	108	105	103	104	102	100	100	98	97	97	95	94	92	92	92	92
2	107	101	97	93	104	99	95	92	96	93	90	93	90	88	90	88	86	84	84	84	84
3	100	93	88	83	98	92	87	83	89	85	81	87	83	80	84	81	79	77	77	77	77
4	94	86	80	75	93	85	79	75	83	78	74	81	76	73	79	75	72	70	70	70	70
5	89	80	73	68	87	79	73	68	77	71	67	75	70	67	73	69	66	65	65	65	65
6	84	74	67	62	82	73	67	62	71	66	62	70	65	61	69	64	61	59	59	59	59
7	79	68	62	57	77	68	61	57	66	61	57	65	60	56	64	59	56	54	54	54	54
8	74	64	57	53	73	63	57	52	62	56	52	61	56	52	60	55	52	50	50	50	50
9	70	60	53	49	69	59	53	48	58	52	48	57	52	48	56	51	48	46	46	46	46
10	66	56	49	45	65	55	49	45	54	49	45	54	48	45	53	48	44	43	43	43	43

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	116820
5°	119801
10°	127976
15°	138184
20°	140431
25°	131819
30°	116096
35°	94561
40°	68678
45°	44065
50°	23161
55°	7917
60°	2270
65°	587
70°	362
75°	479
80°	0
85°	0



TEST NUMBER: P136094

CATALOG NUMBER: LD6A30D010TE ERW6A30935 6LW1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	178.0	6.4
10°-20°	573.9	20.6
20°-30°	832.7	30.0
30°-40°	733.5	26.4
40°-50°	375.6	13.5
50°-60°	79.1	2.8
60°-70°	6.1	0.2
70°-80°	1.2	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1584.5	57.0
0°-40°	2318.0	83.4
0°-60°	2772.6	99.7
0°-90°	2780.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2780.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1791	
5°	1829	178
15°	2046	574
25°	1831	833
35°	1187	733
45°	478	376
55°	70	79
65°	4	6
75°	2	1
85°	0	0
90°	0	



TEST NUMBER: P136094

CATALOG NUMBER: LD6A30D010TE ERW6A30935 6LW1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	1790.6
2.5°	1794.5
5°	1829.3
7.5°	1877.7
10°	1931.8
12.5°	1993.6
15°	2045.9
17.5°	2059.4
20°	2022.7
22.5°	1941.4
25°	1831.2
27.5°	1697.8
30°	1541.1
32.5°	1369.0
35°	1187.3
37.5°	997.8
40°	806.4
42.5°	634.3
45°	477.6
47.5°	342.3
50°	228.2
52.5°	133.4
55°	69.6
57.5°	34.8
60°	17.4
62.5°	7.8
65°	3.8
67.5°	3.8
70°	1.9
72.5°	1.9
75°	1.9
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)