

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P135371

Luminaire Tested: **LD6A30D010TE ERM6A30840 6LM1LI**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P135371  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P23398)  
Test Lab: INNOVATION CENTER P2  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LD6A30D010TE ERM6A30840 6LM1LI  
Description: PORTFOLIO 6 INCH 50 DEGREE CUTOFF RECESSED DOWNLIGHT  
MEDIUM DISTRIBUTION WITH SPECULAR CLEAR TRIM  
Light Source: (1) HIGH LUMEN LED 4000K  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 3076.0 lumens  
Efficiency: N/A  
Efficacy: 67.8 lumens/watt  
Spacing Criteria (0/90/45): 0.82 / 0.82 / 0.8  
Luminous Opening: Circular (Dia: 0.46' x H: 0')  
CIE Type: Direct


Input Watts (W): 45.4  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P135371

CATALOG NUMBER: LD6A30D010TE ERM6A30840 6LM1LI

### Luminous Intensity Polar Plot

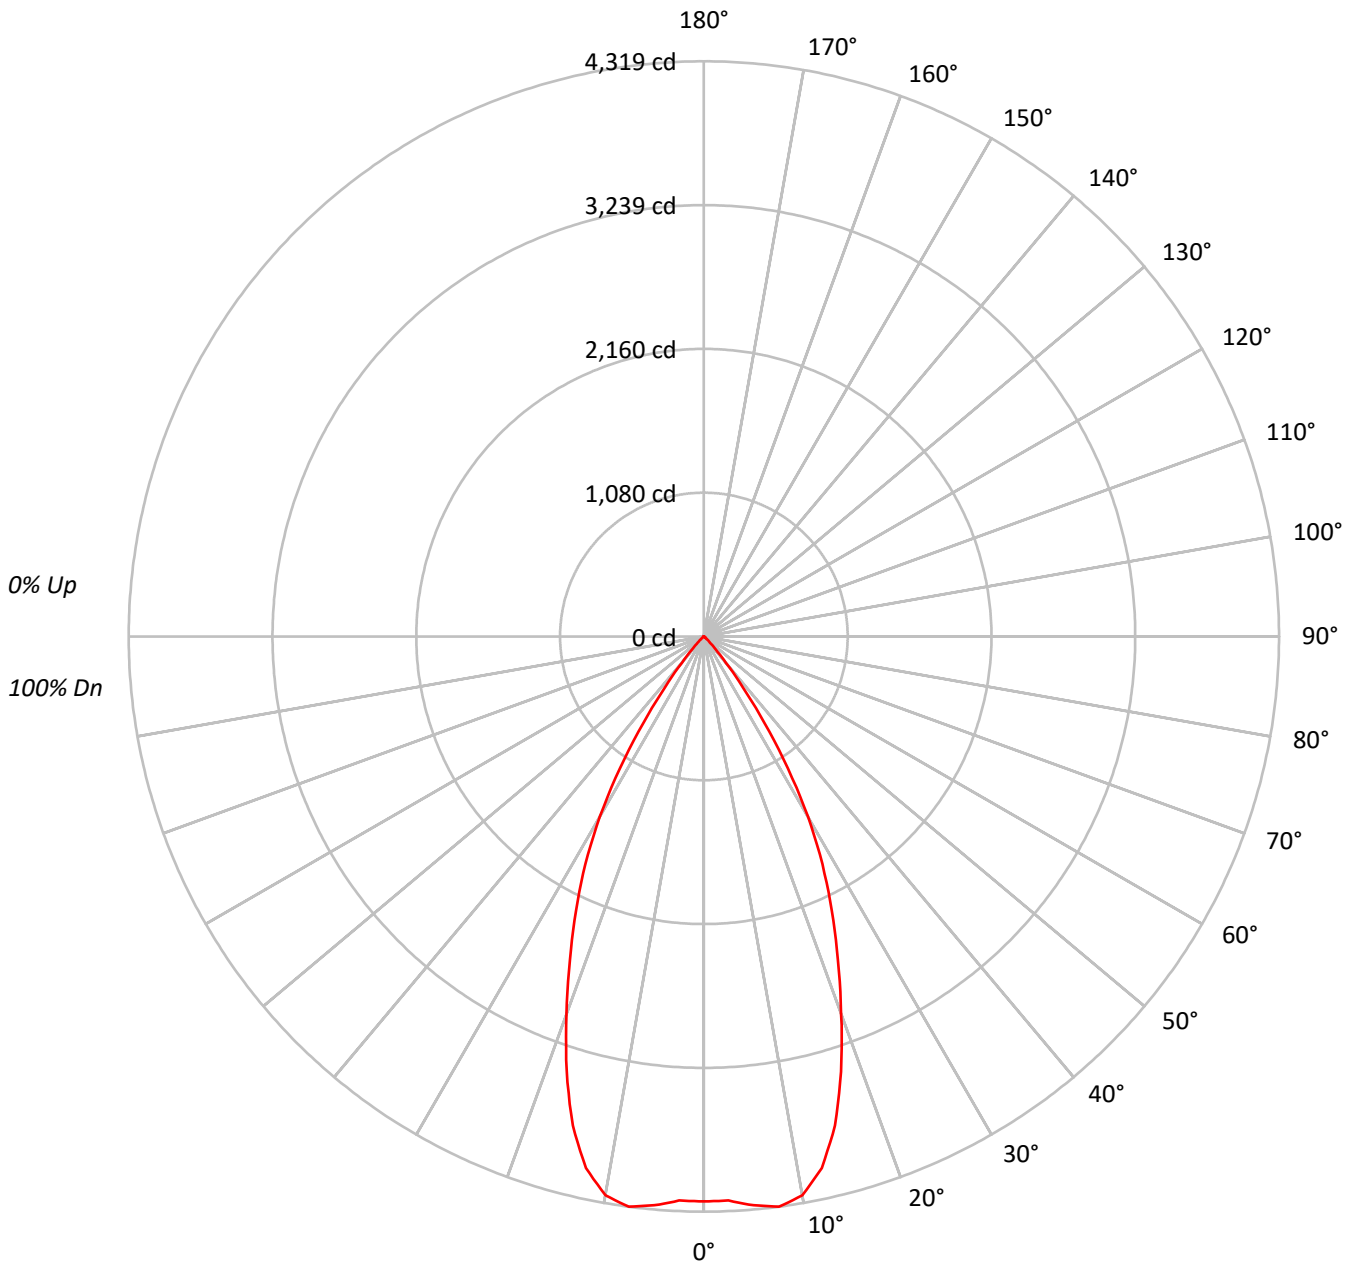



TEST NUMBER: P135371

CATALOG NUMBER: LD6A30D010TE ERM6A30840 6LM1LI

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	111	109	107	112	109	107	105	105	104	102	101	100	99	98	97	96	94			
2	109	104	101	98	107	103	99	96	99	97	94	97	94	92	94	92	90	89			
3	104	98	93	90	102	97	93	89	94	91	88	92	89	86	90	87	85	84			
4	99	92	87	83	98	91	87	83	89	85	82	87	84	81	85	82	80	79			
5	95	87	82	78	93	86	81	77	84	80	77	83	79	76	81	78	75	74			
6	91	82	77	73	89	82	76	73	80	76	72	79	75	72	78	74	71	70			
7	87	78	72	69	85	77	72	68	76	71	68	75	71	68	74	70	67	66			
8	83	74	69	65	82	73	68	65	72	68	64	71	67	64	70	67	64	63			
9	79	70	65	61	78	70	65	61	69	64	61	68	64	61	67	63	61	59			
10	76	67	62	58	75	67	61	58	66	61	58	65	61	58	64	60	57	56			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	276744
5°	280788
10°	282246
15°	256802
20°	209248
25°	163500
30°	117821
35°	62943
40°	21905
45°	5933
50°	1898
55°	944
60°	535
65°	324
70°	401
75°	529
80°	0
85°	0



TEST NUMBER: P135371

CATALOG NUMBER: LD6A30D010TE ERM6A30840 6LM1LI

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	409.1	13.3
10°-20°	1041.3	33.9
20°-30°	1035.2	33.7
30°-40°	509.6	16.6
40°-50°	68.5	2.2
50°-60°	8.0	0.3
60°-70°	2.8	0.1
70°-80°	1.4	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2485.6	80.8
0°-40°	2995.3	97.4
0°-60°	3071.8	99.9
0°-90°	3076.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3076.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	4242	
5°	4288	409
15°	3802	1041
25°	2271	1035
35°	790	510
45°	64	69
55°	8	8
65°	2	3
75°	2	1
85°	0	0
90°	0	



TEST NUMBER: P135371

CATALOG NUMBER: LD6A30D010TE ERM6A30840 6LM1LI

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	4241.9
2.5°	4239.8
5°	4287.5
7.5°	4318.6
10°	4260.5
12.5°	4088.4
15°	3802.1
17.5°	3426.7
20°	3013.9
22.5°	2626.0
25°	2271.3
27.5°	1927.0
30°	1564.0
32.5°	1174.0
35°	790.3
37.5°	475.0
40°	257.2
42.5°	132.8
45°	64.3
47.5°	31.1
50°	18.7
52.5°	10.4
55°	8.3
57.5°	6.2
60°	4.1
62.5°	4.1
65°	2.1
67.5°	2.1
70°	2.1
72.5°	2.1
75°	2.1
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)