

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P785365

Luminaire Tested: LERS6D02D010-EC6DR150210IC9030-6LBS1H

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P785365
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-21)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LERS6D02D010-EC6DR150210IC9030-6LBS1H
Description: 6 INCH ROUND SHALLOW SEMI-SPECULAR CLEAR TRIM, WITH 15° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 385.3 lumens
Efficiency: N/A
Efficacy: 75.5 lumens/watt
Spacing Criteria (0/90/45): 0.22 / 0.22 / 0.23
Luminous Opening: Vertical Cylinder (Dia: 0.35' x H: 0.35')
CIE Type: Direct

Input Watts (W): 5.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P785365

CATALOG NUMBER: LERS6D02D010-EC6DR150210IC9030-6LBS1H

Luminous Intensity Polar Plot

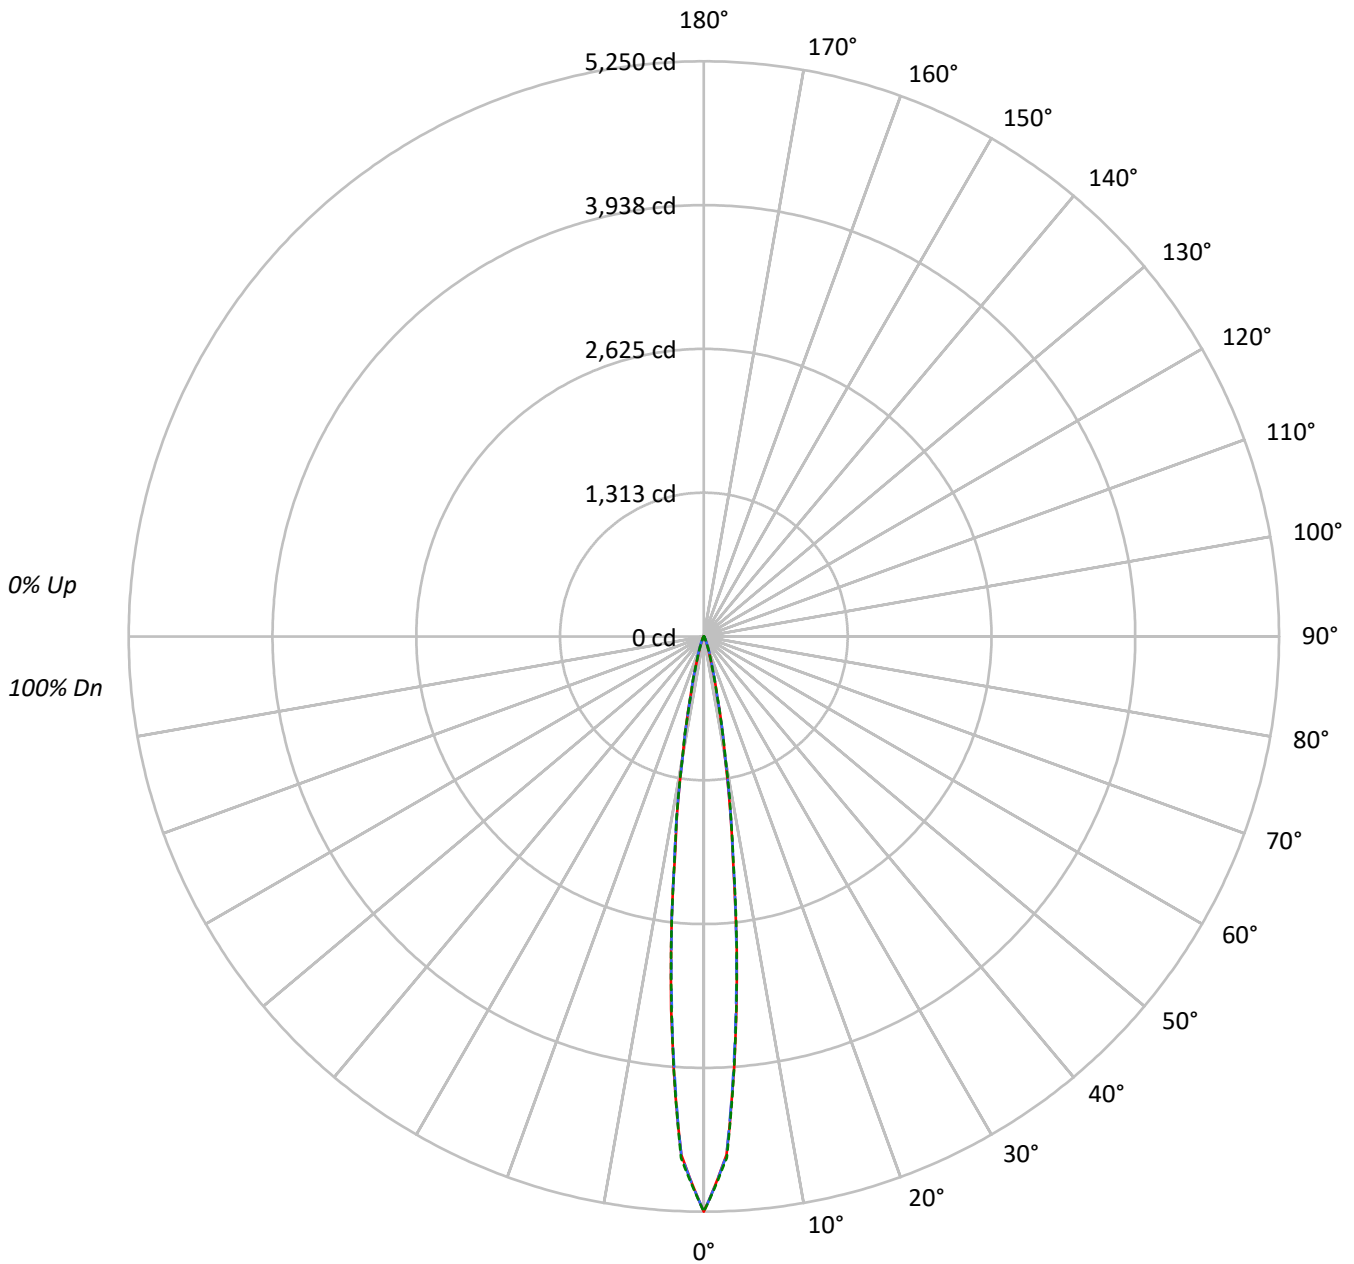



TEST NUMBER: P785365

CATALOG NUMBER: LERS6D02D010-EC6DR150210IC9030-6LBS1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	116	114	112	111	113	112	110	109	108	107	106	104	103	103	101	100	100	98						98													
2	113	110	107	105	111	108	106	104	105	103	102	102	101	100	100	99	98	96						96													
3	110	106	103	101	108	105	102	100	103	100	99	100	99	97	98	97	96	94						94													
4	108	103	100	98	106	102	99	97	100	98	96	99	97	95	97	95	94	93						93													
5	106	101	98	95	104	100	97	95	99	96	94	97	95	93	96	94	92	92						92													
6	104	99	95	93	102	98	95	93	97	94	92	96	93	92	95	93	91	90						90													
7	102	97	94	91	101	96	93	91	95	93	91	94	92	90	93	91	90	89						89													
8	100	95	92	90	99	95	92	90	94	91	89	93	91	89	92	90	89	88						88													
9	99	93	90	88	98	93	90	88	92	90	88	92	89	88	91	89	88	87						87													
10	97	92	89	87	96	92	89	87	91	89	87	91	88	87	90	88	86	86						86													

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	590730	590730	590730
5°	347144	342642	345355
10°	103609	104327	105923
15°	25770	26274	25458
20°	7708	8927	7871
25°	2719	3459	2750
30°	996	1318	1018
35°	501	566	487
40°	312	348	312
45°	231	252	231
50°	188	188	188
55°	153	153	153
60°	126	126	126
65°	93	93	93
70°	80	80	80
75°	53	53	68
80°	32	32	32
85°	17	17	17

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 45°

Vertical Angle: 45°

Luminance: 252 cd/sqm



TEST NUMBER: P785365

CATALOG NUMBER: LERS6D02D010-EC6DR150210IC9030-6LBS1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	249.9	64.9
10°-20°	102.8	26.7
20°-30°	20.4	5.3
30°-40°	5.1	1.3
40°-50°	2.7	0.7
50°-60°	2.0	0.5
60°-70°	1.4	0.4
70°-80°	0.8	0.2
80°-90°	0.2	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	373.1	96.8
0°-40°	378.2	98.2
0°-60°	382.9	99.4
0°-90°	385.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	385.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	5250	5250	5250	5250	5250	
5°	3416	3381	3372	3395	3398	249
15°	297	302	302	297	293	102
25°	35	40	44	39	35	18
35°	7	7	8	7	7	5
45°	3	3	4	3	3	3
55°	2	2	2	2	2	2
65°	1	1	1	1	1	1
75°	1	1	1	1	1	1
85°	0	0	0	0	0	0
90°	0	0	0	0	0	0



TEST NUMBER: P785365

CATALOG NUMBER: LERS6D02D010-EC6DR150210IC9030-6LBS1H

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	5250.0	5250.0	5250.0	5250.0	5250.0
2.5°	4735.7	4739.7	4741.2	4745.9	4763.2
5°	3415.8	3380.6	3371.5	3394.9	3398.2
7.5°	2023.4	2030.5	2056.5	2062.3	2041.4
10°	1110.4	1119.5	1118.1	1126.1	1135.2
12.5°	567.8	560.7	558.5	567.6	555.0
15°	296.7	302.3	302.5	297.1	293.1
17.5°	159.6	166.0	176.7	168.0	154.7
20°	94.2	100.0	109.1	102.0	96.2
22.5°	58.2	62.9	69.3	63.8	59.1
25°	34.9	39.6	44.4	39.3	35.3
27.5°	20.7	24.7	27.8	24.4	20.4
30°	13.3	15.6	17.6	15.3	13.6
32.5°	9.3	10.2	11.1	10.2	9.3
35°	6.9	7.3	7.8	7.3	6.7
37.5°	5.3	5.8	6.0	5.6	5.1
40°	4.4	4.7	4.9	4.7	4.4
42.5°	3.8	4.0	4.0	4.0	3.8
45°	3.3	3.3	3.6	3.3	3.3
47.5°	2.9	2.9	3.1	2.9	2.9
50°	2.7	2.7	2.7	2.7	2.7
52.5°	2.4	2.4	2.4	2.4	2.4
55°	2.2	2.2	2.2	2.2	2.2
57.5°	2.0	2.0	2.0	2.0	2.0
60°	1.8	1.8	1.8	1.8	1.8
62.5°	1.6	1.6	1.6	1.6	1.6
65°	1.3	1.3	1.3	1.3	1.3
67.5°	1.3	1.3	1.3	1.3	1.3
70°	1.1	1.1	1.1	1.1	1.1
72.5°	0.9	0.9	0.9	0.9	0.9
75°	0.7	0.7	0.7	0.7	0.9
77.5°	0.7	0.7	0.7	0.7	0.7
80°	0.4	0.4	0.4	0.4	0.4
82.5°	0.4	0.4	0.4	0.4	0.4
85°	0.2	0.2	0.2	0.2	0.2
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)