

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P785403

Luminaire Tested: LERS6D02D010-EC6DR200210IC9050-6LBS1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P785403
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LERS6D02D010-EC6DR200210IC9050-6LBS1MW
Description: 6 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 20° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 411.7 lumens
Efficiency: N/A
Efficacy: 80.7 lumens/watt
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.36
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 5.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P785403

CATALOG NUMBER: LERS6D02D010-EC6DR200210IC9050-6LBS1MW

Luminous Intensity Polar Plot

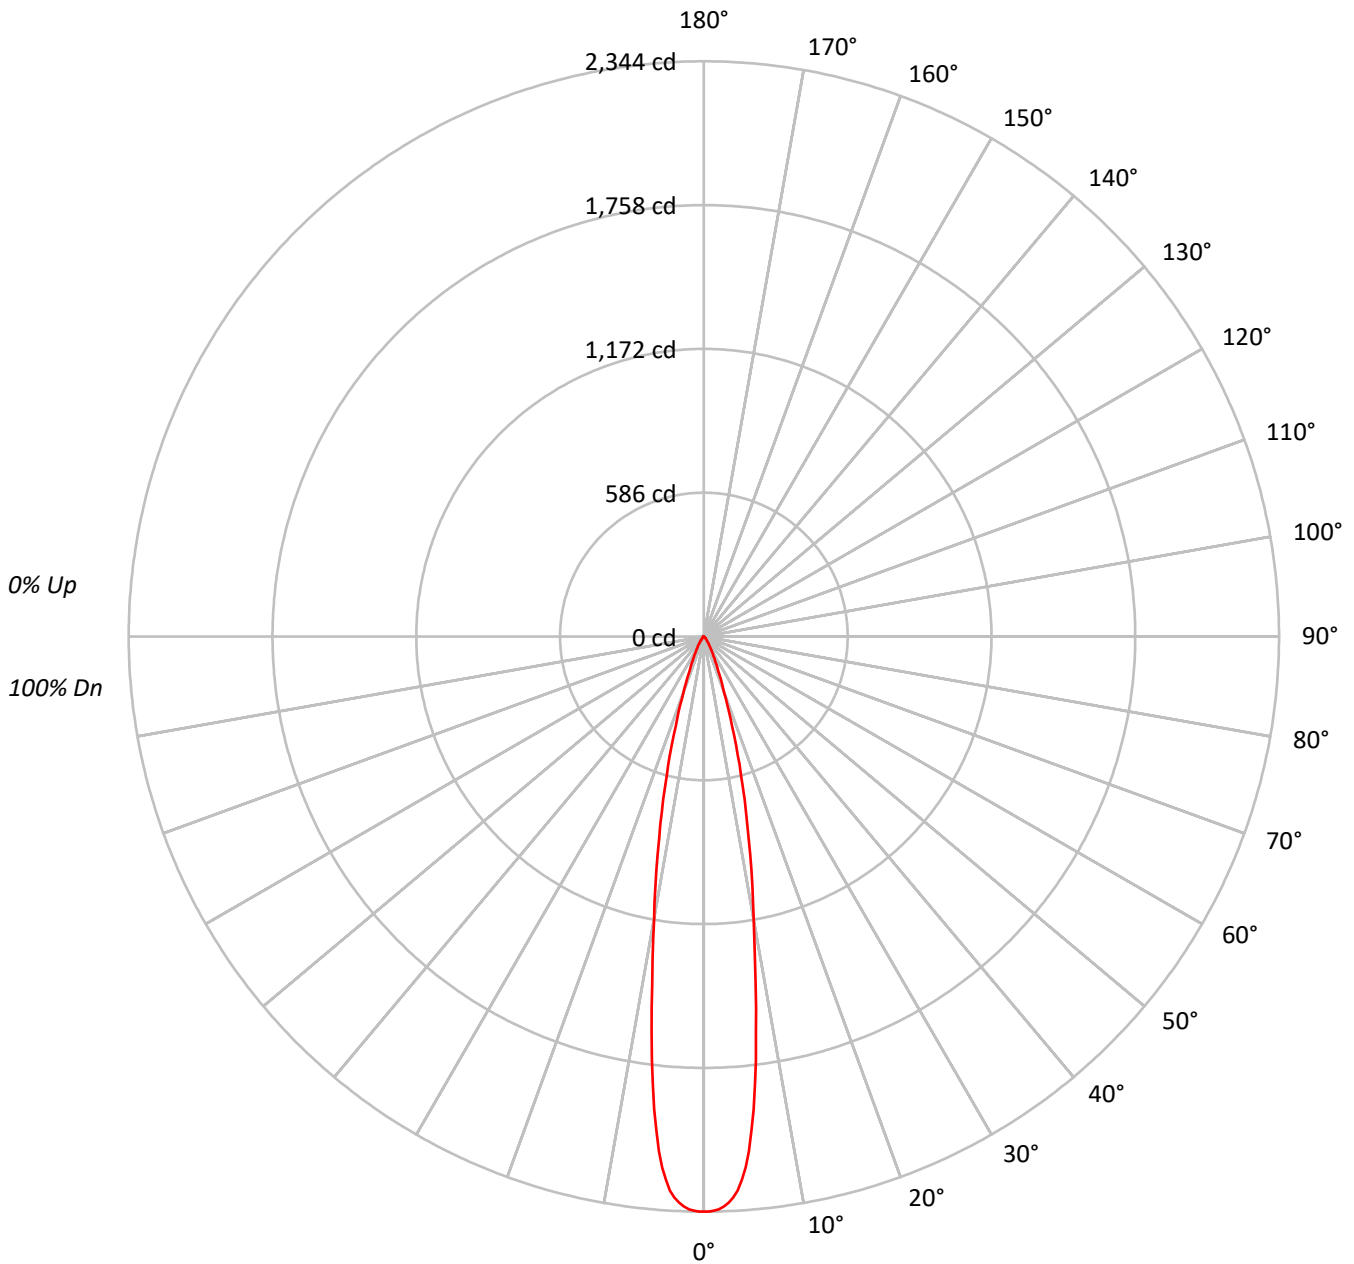



TEST NUMBER: P785403

CATALOG NUMBER: LERS6D02D010-EC6DR200210IC9050-6LBS1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100															
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	97	98	96	95	94															
2	111	108	105	102	109	106	104	101	103	101	99	100	99	97	98	96	95	94	98	96	95	94															
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	93	92	91	95	93	92	91															
4	105	99	96	93	103	98	95	92	96	93	91	95	92	90	93	91	89	88	93	91	89	88															
5	102	96	92	89	100	95	91	89	94	90	88	92	89	87	91	88	86	85	91	88	86	85															
6	99	93	89	86	98	92	88	86	91	87	85	90	87	84	88	86	84	83	88	86	84	83															
7	96	90	86	83	95	89	86	83	88	85	82	87	84	82	86	84	82	81	86	84	82	81															
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	80	79	84	82	80	79															
9	91	85	81	78	91	85	81	78	84	80	78	83	80	78	82	80	78	77	82	80	78	77															
10	89	83	79	76	88	82	79	76	82	78	76	81	78	76	81	78	76	75	81	78	76	75															

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	256074
5°	231026
10°	129663
15°	65912
20°	27905
25°	12887
30°	6825
35°	3668
40°	1968
45°	1159
50°	680
55°	362
60°	219
65°	155
70°	64
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 1159 cd/sqm



TEST NUMBER: P785403

CATALOG NUMBER: LERS6D02D010-EC6DR200210IC9050-6LBS1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	166.9	40.5
10°-20°	164.3	39.9
20°-30°	53.7	13.0
30°-40°	18.3	4.4
40°-50°	6.1	1.5
50°-60°	1.9	0.5
60°-70°	0.6	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	384.9	93.5
0°-40°	403.1	97.9
0°-60°	411.1	99.9
0°-90°	411.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	411.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2344	
5°	2106	167
15°	583	164
25°	107	54
35°	28	18
45°	8	6
55°	2	2
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P785403

CATALOG NUMBER: LERS6D02D010-EC6DR200210IC9050-6LBS1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	2343.7
0.5°	2343.7
1°	2340.7
1.5°	2334.9
2°	2324.2
2.5°	2310.1
3°	2290.0
3.5°	2262.1
4°	2220.5
4.5°	2170.0
5°	2106.4
5.5°	2022.7
6°	1936.9
6.5°	1838.6
7°	1742.4
7.5°	1629.7
8°	1529.1
8.5°	1427.9
9°	1334.4
9.5°	1248.6
10°	1168.7
12.5°	839.2
15°	582.7
17.5°	380.7
20°	240.0
22.5°	155.5
25°	106.9
27.5°	75.1
30°	54.1
32.5°	38.8
35°	27.5
37.5°	19.2
40°	13.8
42.5°	10.0
45°	7.5
47.5°	5.8
50°	4.0
52.5°	2.5
55°	1.9
57.5°	1.5
60°	1.0
62.5°	0.8
65°	0.6



TEST NUMBER: P785403

CATALOG NUMBER: LERS6D02D010-EC6DR200210IC9050-6LBS1MW

CANDELA DISTRIBUTION (continued):

	0°
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





67.5°		0.4
70°		0.2

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)