

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P785448

Luminaire Tested: LERS6D02D010-EC6DR300210IC9050-6LBS1B

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P785448
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-16)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LERS6D02D010-EC6DR300210IC9050-6LBS1B
Description: 6 INCH ROUND SHALLOW SPECULAR BLACK TRIM, WITH 30° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 653.6 lumens
Efficiency: N/A
Efficacy: 128.2 lumens/watt
Spacing Criteria (0/90/45): 0.52 / 0.52 / 0.49
Luminous Opening: Rectangular (W 0.38' x L: 0.38' x H: 0')
CIE Type: Direct

Input Watts (W): 5.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P785448

CATALOG NUMBER: LERS6D02D010-EC6DR300210IC9050-6LBS1B

Luminous Intensity Polar Plot

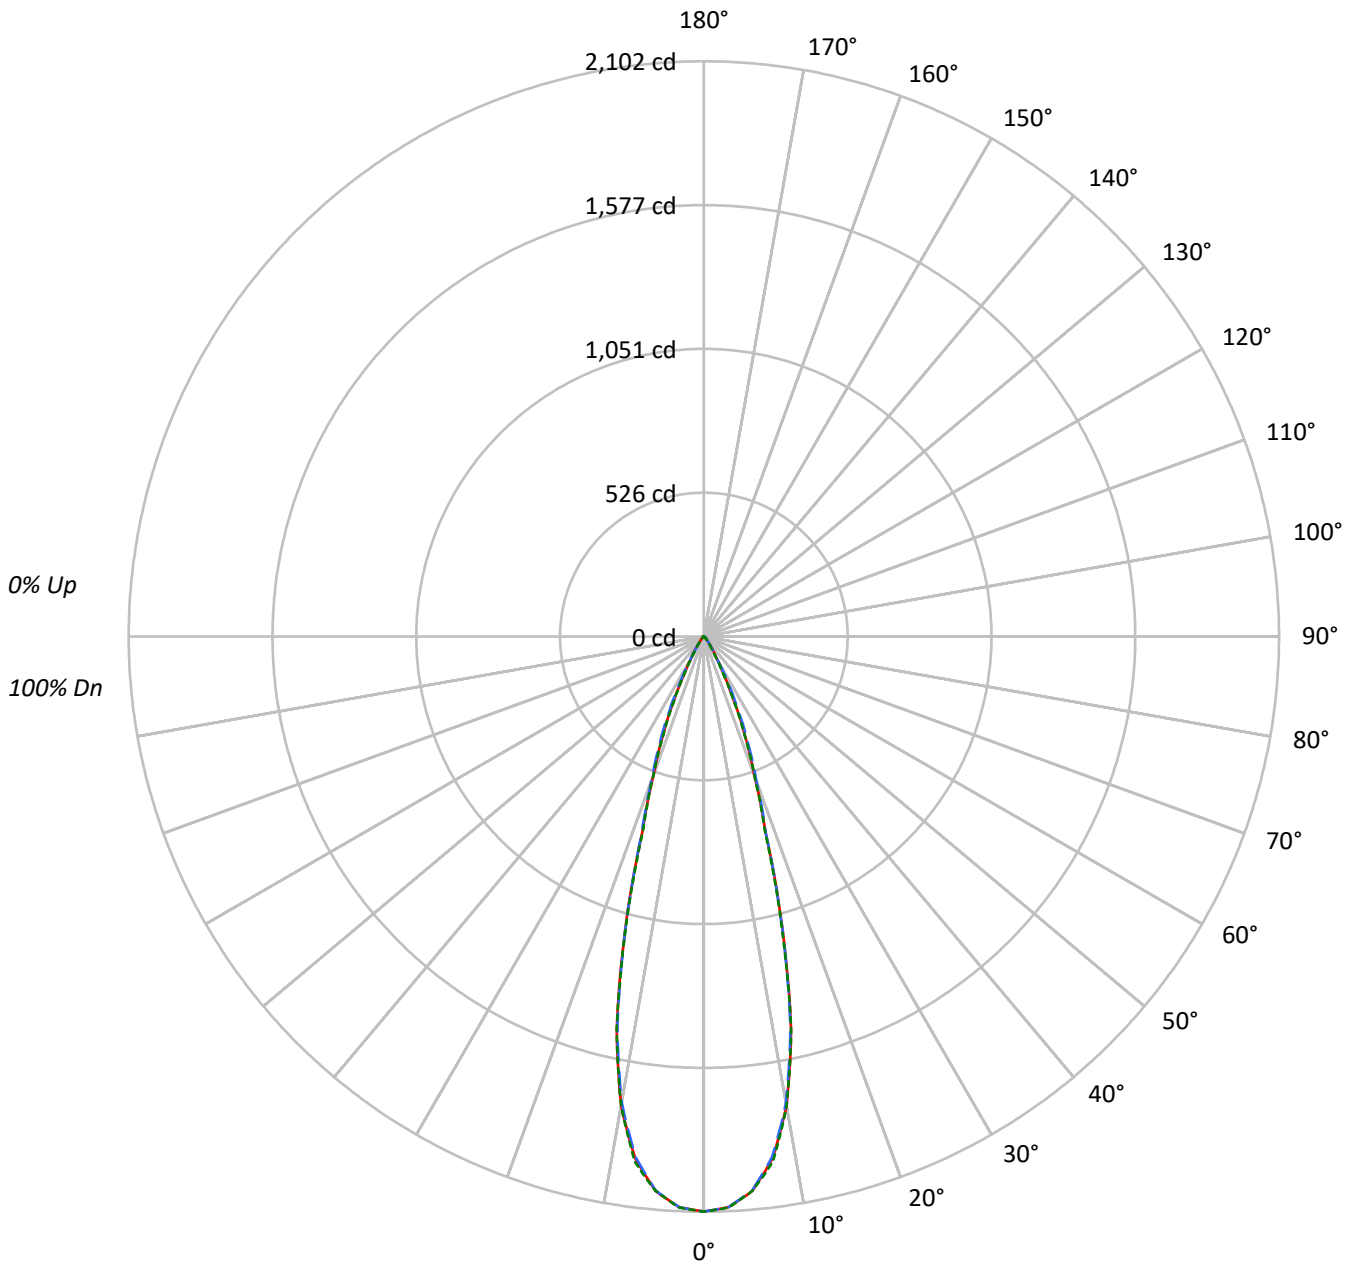



TEST NUMBER: P785448

CATALOG NUMBER: LERS6D02D010-EC6DR300210IC9050-6LBS1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96																			
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92																			
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89																			
4	103	98	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85																			
5	100	94	89	86	98	93	89	86	91	88	85	90	87	84	88	86	83	82																			
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79																			
7	94	87	82	79	92	86	82	79	85	81	78	84	81	78	83	80	78	77																			
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74																			
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72																			
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69																			

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	160871	160871	160871
5°	156253	156069	156261
10°	135341	134385	135310
15°	88301	87826	87390
20°	43913	45558	43848
25°	22119	24940	21663
30°	8856	9652	7716
35°	4111	3934	3299
40°	1769	1968	1669
45°	1256	1548	1267
50°	429	1131	453
55°	254	467	267
60°	168	199	168
65°	109	109	109
70°	67	45	67
75°	0	30	0
80°	0	0	0
85°	0	0	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 22.5°
 Vertical Angle: 45°
 Luminance: 1548 cd/sqm



TEST NUMBER: P785448

CATALOG NUMBER: LERS6D02D010-EC6DR300210IC9050-6LBS1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.8	28.3
10°-20°	297.6	45.5
20°-30°	128.6	19.7
30°-40°	29.3	4.5
40°-50°	10.1	1.5
50°-60°	2.5	0.4
60°-70°	0.6	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	611.1	93.5
0°-40°	640.4	98.0
0°-60°	652.9	99.9
0°-90°	653.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	653.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2102	2102	2102	2102	2102	
5°	2034	2032	2031	2036	2034	185
15°	1114	1101	1108	1105	1103	298
25°	262	272	295	265	256	125
35°	44	45	42	42	35	30
45°	12	14	14	14	12	8
55°	2	2	4	2	2	2
65°	1	1	1	1	1	1
75°	0	0	0	0	0	0
85°	0	0	0	0	0	0
90°	0	0	0	0	0	0



TEST NUMBER: P785448

CATALOG NUMBER: LERS6D02D010-EC6DR300210IC9050-6LBS1B

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2101.7	2101.7	2101.7	2101.7	2101.7
2.5°	2087.8	2086.3	2087.2	2088.2	2088.6
5°	2033.6	2031.7	2031.2	2035.5	2033.7
7.5°	1924.3	1921.6	1917.3	1926.9	1935.9
10°	1741.3	1738.2	1729.0	1733.5	1740.9
12.5°	1471.0	1461.0	1460.8	1475.3	1473.3
15°	1114.3	1100.9	1108.3	1104.7	1102.8
17.5°	749.3	744.2	754.1	751.1	738.2
20°	539.1	540.4	559.3	549.8	538.3
22.5°	393.3	398.2	420.6	396.1	387.2
25°	261.9	271.8	295.3	264.9	256.5
27.5°	161.1	165.6	189.5	159.0	154.5
30°	100.2	97.9	109.2	93.7	87.3
32.5°	65.7	62.8	66.5	59.6	54.5
35°	44.0	44.9	42.1	41.8	35.3
37.5°	27.4	31.6	27.9	29.7	22.7
40°	17.7	22.9	19.7	21.8	16.7
42.5°	14.5	17.6	16.2	17.2	14.9
45°	11.6	14.3	14.3	14.3	11.7
47.5°	6.4	9.6	12.3	9.8	6.8
50°	3.6	4.8	9.5	5.1	3.8
52.5°	2.5	2.8	6.5	2.9	2.6
55°	1.9	2.0	3.5	2.1	2.0
57.5°	1.4	1.5	1.9	1.5	1.4
60°	1.1	1.1	1.3	1.2	1.1
62.5°	0.8	0.8	0.9	0.8	0.8
65°	0.6	0.6	0.6	0.6	0.6
67.5°	0.3	0.4	0.4	0.4	0.4
70°	0.3	0.2	0.2	0.2	0.3
72.5°	0.2	0.1	0.1	0.1	0.1
75°	0.0	0.0	0.1	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)