

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P785583

Luminaire Tested: LERS6D02D010-EC6DR600210IC9030-6LBS1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P785583
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-60)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LERS6D02D010-EC6DR600210IC9030-6LBS1MW
Description: 6 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 60° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 634.7 lumens
Efficiency: N/A
Efficacy: 124.4 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 5.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P785583

CATALOG NUMBER: LERS6D02D010-EC6DR600210IC9030-6LBS1MW

Luminous Intensity Polar Plot

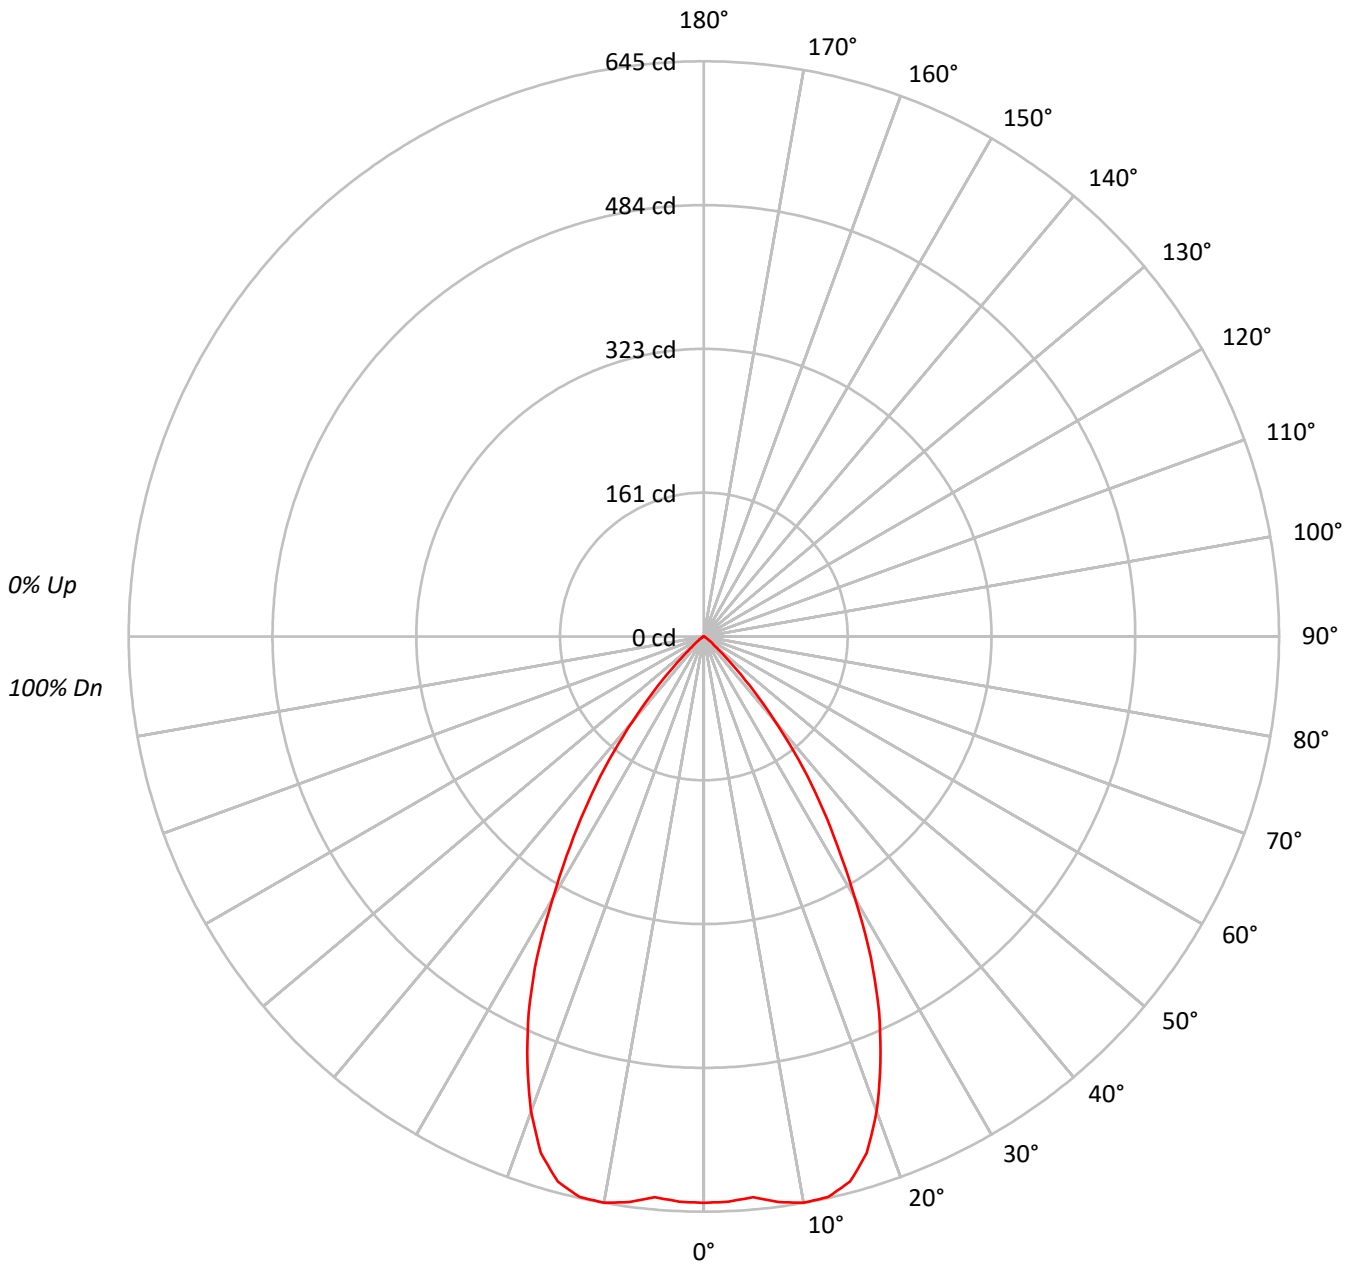



TEST NUMBER: P785583

CATALOG NUMBER: LERS6D02D010-EC6DR600210IC9030-6LBS1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	94			
2	108	103	99	96	106	101	98	95	98	95	92	95	93	90	92	90	89	87			
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81			
4	97	90	84	80	95	88	83	79	86	82	78	84	81	78	82	79	77	75			
5	92	84	78	74	91	83	77	73	81	76	73	79	75	72	78	74	71	70			
6	87	79	73	68	86	78	72	68	76	71	68	75	70	67	74	70	67	65			
7	83	74	68	63	82	73	67	63	72	67	63	71	66	63	69	65	62	61			
8	79	69	63	59	78	69	63	59	68	63	59	67	62	59	66	61	58	57			
9	75	65	59	55	74	65	59	55	64	59	55	63	58	55	62	58	55	53			
10	72	62	56	52	71	61	56	52	61	55	52	60	55	52	59	55	52	50			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	69392
5°	69218
10°	71527
15°	71591
20°	65880
25°	56034
30°	42694
35°	30198
40°	17729
45°	7154
50°	2397
55°	1143
60°	481
65°	78
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 7154 cd/sqm



TEST NUMBER: P785583

CATALOG NUMBER: LERS6D02D010-EC6DR600210IC9030-6LBS1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	60.9	9.6
10°-20°	175.3	27.6
20°-30°	209.9	33.1
30°-40°	140.4	22.1
40°-50°	41.6	6.6
50°-60°	6.0	0.9
60°-70°	0.6	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	446.1	70.3
0°-40°	586.5	92.4
0°-60°	634.1	99.9
0°-90°	634.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	634.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	635	
5°	631	61
15°	633	175
25°	465	210
35°	226	140
45°	46	42
55°	6	6
65°	0	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P785583

CATALOG NUMBER: LERS6D02D010-EC6DR600210IC9030-6LBS1MW

CANDELA DISTRIBUTION (FULL):

0°	
0°	635.1
2.5°	634.3
5°	631.1
7.5°	639.7
10°	644.7
12.5°	643.7
15°	632.9
17.5°	607.5
20°	566.6
22.5°	517.5
25°	464.8
27.5°	405.4
30°	338.4
32.5°	278.6
35°	226.4
37.5°	174.0
40°	124.3
42.5°	82.0
45°	46.3
47.5°	23.7
50°	14.1
52.5°	9.1
55°	6.0
57.5°	3.9
60°	2.2
62.5°	0.9
65°	0.3
67.5°	0.1
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)