

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P785615

Luminaire Tested: LERS6D02D010-EC6DR650210IC9040-6LBS1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P785615
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-147)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LERS6D02D010-EC6DR650210IC9040-6LBS1MW
Description: 6 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 601.5 lumens
Efficiency: N/A
Efficacy: 117.9 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.96
Luminous Opening: Circular (Dia: 0.48' x H: 0')
CIE Type: Direct

Input Watts (W): 5.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P785615

CATALOG NUMBER: LERS6D02D010-EC6DR650210IC9040-6LBS1MW

Luminous Intensity Polar Plot

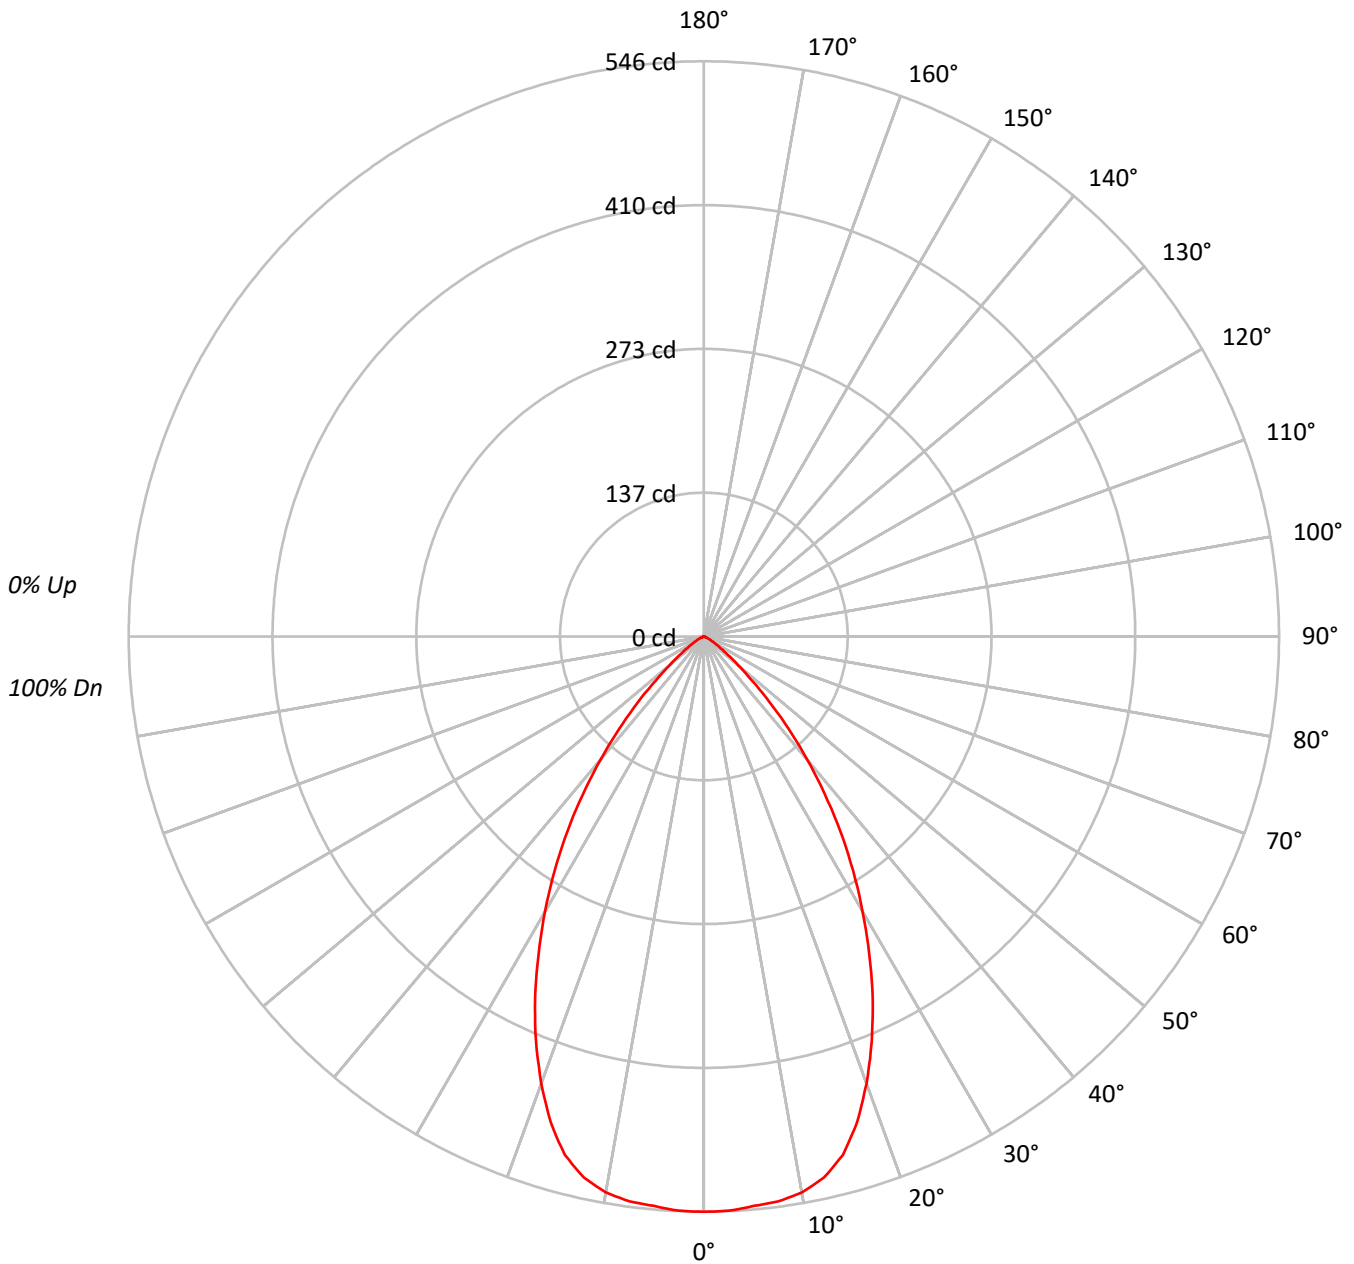



TEST NUMBER: P785615

CATALOG NUMBER: LERS6D02D010-EC6DR650210IC9040-6LBS1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100															
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	93				93															
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85				85															
3	101	94	88	84	99	92	87	83	90	86	82	87	84	81	85	82	80	78				78															
4	95	87	81	76	93	86	80	76	84	79	75	82	77	74	80	76	73	72				72															
5	90	81	74	70	88	80	74	69	78	73	69	76	72	68	75	71	68	66				66															
6	85	75	69	64	83	74	68	64	73	67	63	71	67	63	70	66	62	61				61															
7	80	70	64	59	79	69	63	59	68	63	59	67	62	58	66	61	58	56				56															
8	76	66	59	55	75	65	59	55	64	58	54	63	58	54	62	57	54	52				52															
9	72	61	55	51	71	61	55	51	60	54	51	59	54	50	58	54	50	49				49															
10	68	58	52	47	67	57	51	47	57	51	47	56	51	47	55	50	47	46				46															

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	31894
5°	31817
10°	31787
15°	30813
20°	28049
25°	24443
30°	20326
35°	16106
40°	11627
45°	7343
50°	3825
55°	2036
60°	1063
65°	594
70°	239
75°	271
80°	202
85°	134

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 7343 cd/sqm



TEST NUMBER: P785615

CATALOG NUMBER: LERS6D02D010-EC6DR650210IC9040-6LBS1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	51.6	8.6
10°-20°	141.4	23.5
20°-30°	172.9	28.7
30°-40°	140.3	23.3
40°-50°	69.9	11.6
50°-60°	19.5	3.2
60°-70°	4.4	0.7
70°-80°	1.2	0.2
80°-90°	0.3	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	366.0	60.8
0°-40°	506.2	84.2
0°-60°	595.6	99.0
0°-90°	601.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	601.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	546	
5°	543	52
15°	510	141
25°	379	173
35°	226	140
45°	89	70
55°	20	20
65°	4	4
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P785615

CATALOG NUMBER: LERS6D02D010-EC6DR650210IC9040-6LBS1MW

CANDELA DISTRIBUTION (FULL):

0°	
0°	546.1
2.5°	545.7
5°	542.7
7.5°	540.9
10°	536.0
12.5°	526.1
15°	509.6
17.5°	483.7
20°	451.3
22.5°	416.3
25°	379.3
27.5°	339.7
30°	301.4
32.5°	263.6
35°	225.9
37.5°	188.3
40°	152.5
42.5°	118.9
45°	88.9
47.5°	62.0
50°	42.1
52.5°	29.1
55°	20.0
57.5°	13.5
60°	9.1
62.5°	6.3
65°	4.3
67.5°	2.2
70°	1.4
72.5°	1.4
75°	1.2
77.5°	0.8
80°	0.6
82.5°	0.4
85°	0.2
87.5°	0.2
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)