

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P785667

Luminaire Tested: LERS6D05D010-EC6DR100210IC9050-6LBS1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P785667
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-4)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LERS6D05D010-EC6DR100210IC9050-6LBS1MW
Description: 6 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 10° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 701.3 lumens
Efficiency: N/A
Efficacy: 93.5 lumens/watt
Spacing Criteria (0/90/45): 0.17 / 0.17 / 0.18
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 7.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P785667

CATALOG NUMBER: LERS6D05D010-EC6DR100210IC9050-6LBS1MW

Luminous Intensity Polar Plot

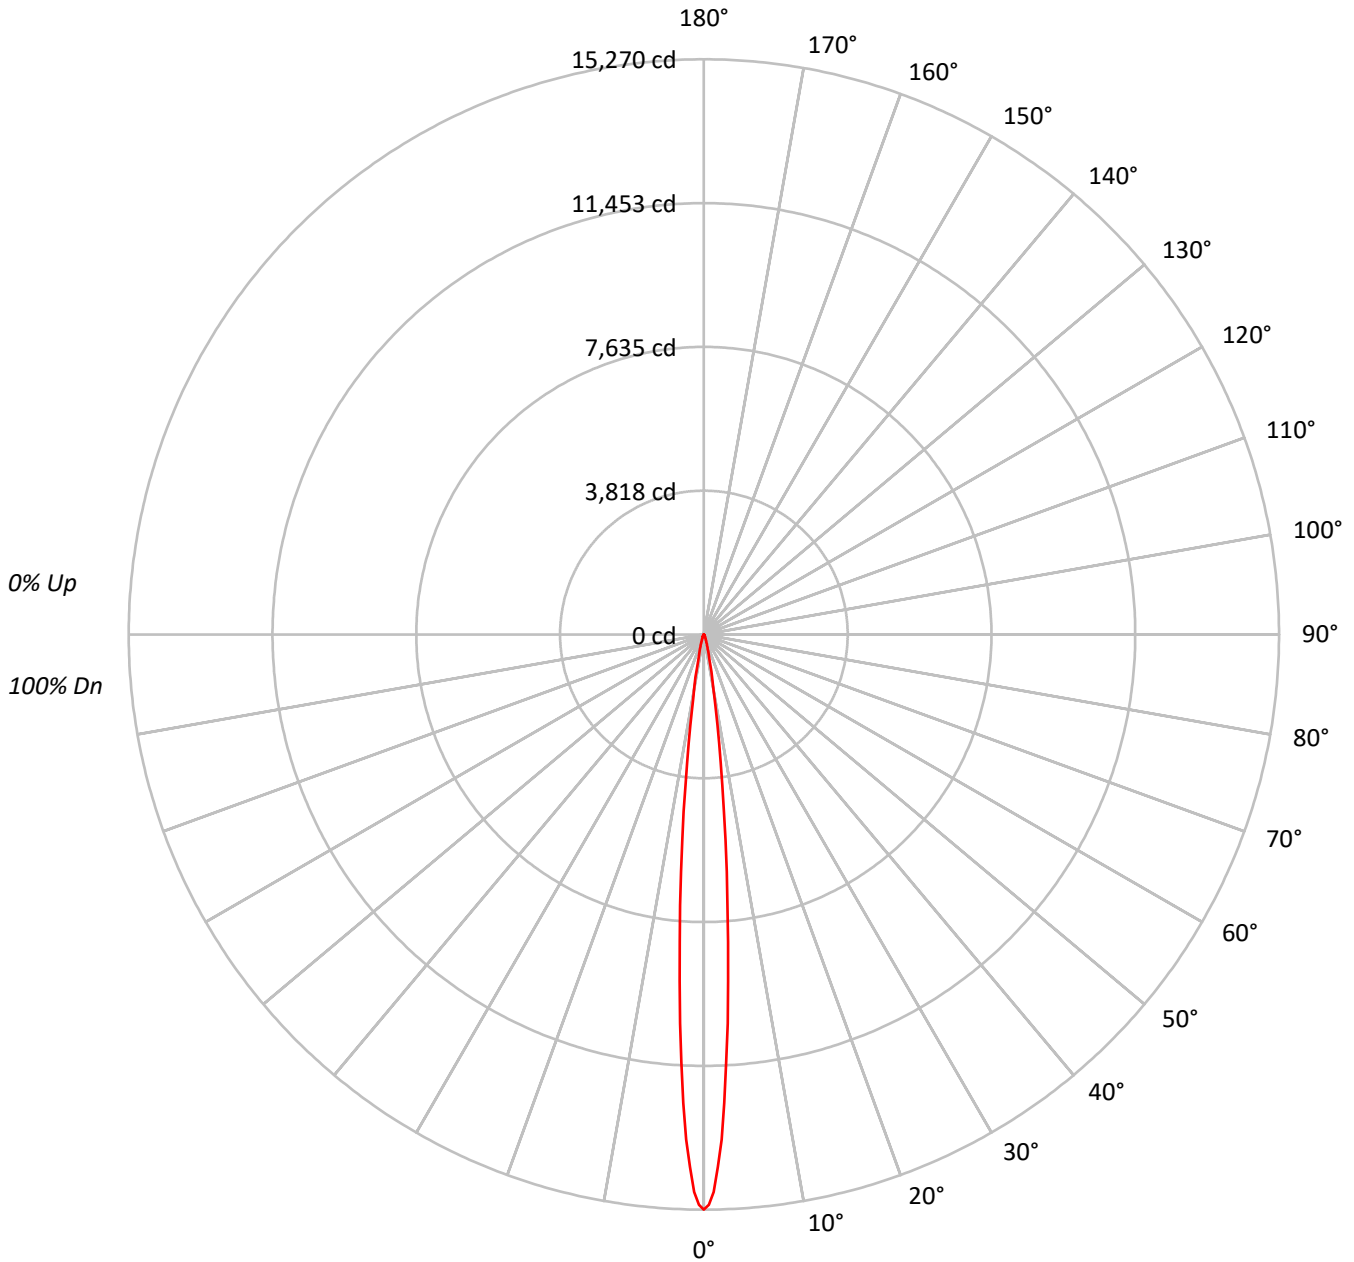



TEST NUMBER: P785667

CATALOG NUMBER: LERS6D05D010-EC6DR100210IC9050-6LBS1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	116	114	113	111	114	112	111	109	108	107	106	104	104	103	101	101	100	98	98	98	98
2	113	110	108	106	111	108	106	104	105	104	102	103	101	100	100	99	98	97	97	97	97
3	111	107	104	102	109	106	103	101	103	101	99	101	99	98	99	98	96	95	95	95	95
4	108	104	101	99	107	103	100	98	101	99	97	99	97	96	98	96	95	94	94	94	94
5	106	102	99	96	105	101	98	96	99	97	95	98	96	94	97	95	94	93	93	93	93
6	104	100	96	94	103	99	96	94	98	95	93	97	94	93	96	94	92	91	91	91	91
7	103	98	95	93	102	97	94	92	96	94	92	95	93	92	95	93	91	90	90	90	90
8	101	96	93	91	100	96	93	91	95	92	91	94	92	90	93	92	90	89	89	89	89
9	100	95	92	90	99	94	92	90	94	91	90	93	91	89	93	91	89	88	88	88	88
10	98	94	91	89	98	93	91	89	93	90	88	92	90	88	92	90	88	87	87	87	87

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1668390
5°	791152
10°	162248
15°	44545
20°	17953
25°	9620
30°	5690
35°	3708
40°	2467
45°	1607
50°	884
55°	667
60°	371
65°	0
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 1607 cd/sqm



TEST NUMBER: P785667

CATALOG NUMBER: LERS6D05D010-EC6DR100210IC9050-6LBS1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	498.7	71.1
10°-20°	134.9	19.2
20°-30°	38.6	5.5
30°-40°	17.6	2.5
40°-50°	8.1	1.2
50°-60°	2.7	0.4
60°-70°	0.6	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	672.3	95.9
0°-40°	689.9	98.4
0°-60°	700.7	99.9
0°-90°	701.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	701.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	15270	
5°	7213	499
15°	394	135
25°	80	39
35°	28	18
45°	10	8
55°	4	3
65°	0	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P785667

CATALOG NUMBER: LERS6D05D010-EC6DR100210IC9050-6LBS1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	15269.8
0.5°	15138.0
1°	14799.7
1.5°	14147.4
2°	13417.1
2.5°	12452.5
3°	11380.4
3.5°	10343.0
4°	9224.0
4.5°	8193.5
5°	7213.4
5.5°	6325.1
6°	5478.5
6.5°	4734.3
7°	4033.4
7.5°	3434.9
8°	2904.1
8.5°	2439.1
9°	2036.7
9.5°	1729.6
10°	1462.4
12.5°	697.4
15°	393.8
17.5°	239.4
20°	154.4
22.5°	107.6
25°	79.8
27.5°	59.0
30°	45.1
32.5°	34.7
35°	27.8
37.5°	20.8
40°	17.3
42.5°	13.9
45°	10.4
47.5°	6.9
50°	5.2
52.5°	3.5
55°	3.5
57.5°	1.7
60°	1.7
62.5°	1.7
65°	0.0



TEST NUMBER: P785667

CATALOG NUMBER: LERS6D05D010-EC6DR100210IC9050-6LBS1MW

CANDELA DISTRIBUTION (continued):

	0°
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



67.5°		0.0
70°		0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)