

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P785806

Luminaire Tested: LERS6D05D010-EC6DR400210IC9040-6LBS1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P785806
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-28)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LERS6D05D010-EC6DR400210IC9040-6LBS1LI
Description: 6 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 40° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1443.7 lumens
Efficiency: N/A
Efficacy: 192.5 lumens/watt
Spacing Criteria (0/90/45): 0.68 / 0.68 / 0.6
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 7.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P785806

CATALOG NUMBER: LERS6D05D010-EC6DR400210IC9040-6LBS1LI

Luminous Intensity Polar Plot

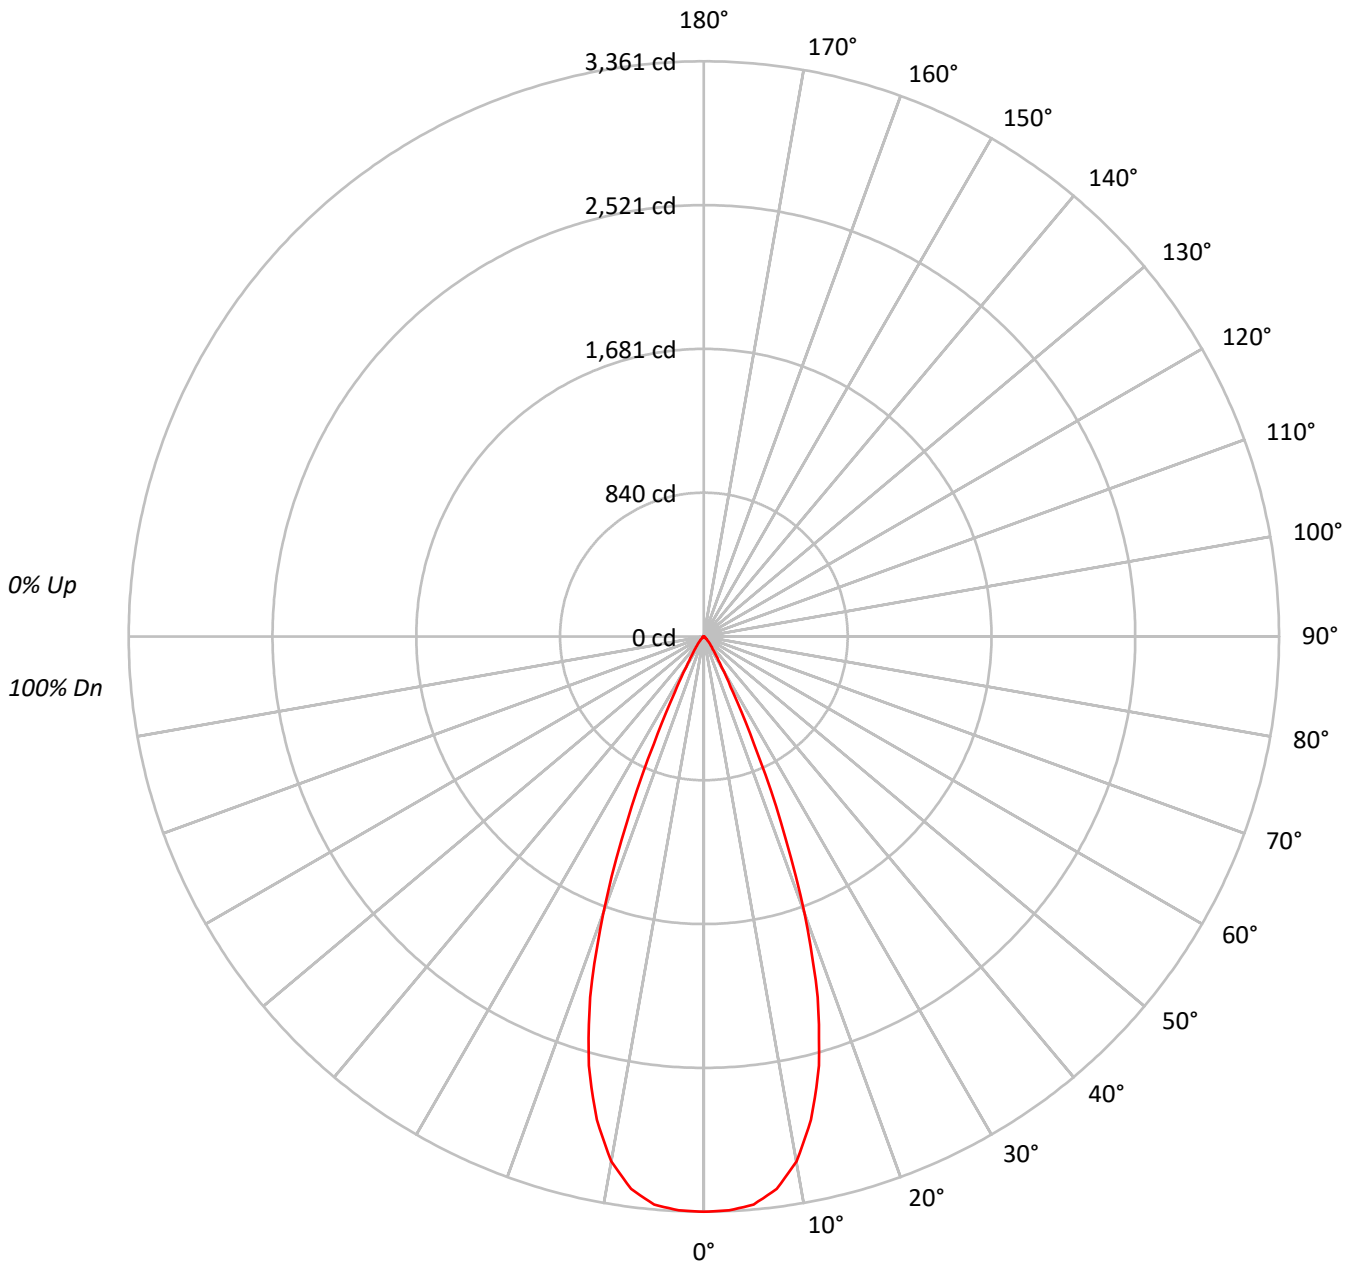



TEST NUMBER: P785806

CATALOG NUMBER: LERS6D05D010-EC6DR400210IC9040-6LBS1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100					100														
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	97	96					96														
2	110	106	103	100	108	105	102	99	102	99	97	99	97	95	96	95	93	92					92														
3	106	101	97	94	104	100	96	93	97	94	92	95	93	90	93	91	89	88					88														
4	102	97	92	89	101	95	91	88	93	90	87	92	89	86	90	87	85	84					84														
5	99	92	88	84	97	91	87	84	90	86	83	88	85	83	87	84	82	81					81														
6	95	88	84	80	94	88	83	80	86	82	80	85	82	79	84	81	79	77					77														
7	92	85	80	77	91	84	80	77	83	79	76	82	79	76	81	78	76	74					74														
8	89	82	77	74	88	81	77	74	80	76	73	79	76	73	78	75	73	72					72														
9	86	79	74	71	85	78	74	71	77	73	71	76	73	70	76	72	70	69					69														
10	83	76	71	68	82	75	71	68	75	71	68	74	70	68	73	70	68	67					67														

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	367258
5°	365480
10°	345453
15°	293681
20°	200164
25°	83521
30°	26255
35°	12205
40°	6746
45°	3090
50°	1496
55°	819
60°	437
65°	155
70°	64
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 3090 cd/sqm



TEST NUMBER: P785806

CATALOG NUMBER: LERS6D05D010-EC6DR400210IC9040-6LBS1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	311.1	21.6
10°-20°	697.1	48.3
20°-30°	348.9	24.2
30°-40°	64.0	4.4
40°-50°	17.6	1.2
50°-60°	4.1	0.3
60°-70°	0.8	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1357.1	94.0
0°-40°	1421.1	98.4
0°-60°	1442.9	99.9
0°-90°	1443.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1443.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3361	
5°	3332	311
15°	2596	697
25°	693	349
35°	92	64
45°	20	18
55°	4	4
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P785806

CATALOG NUMBER: LERS6D05D010-EC6DR400210IC9040-6LBS1LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	3361.3
2.5°	3356.4
5°	3332.3
7.5°	3255.3
10°	3113.7
12.5°	2893.0
15°	2596.3
17.5°	2210.5
20°	1721.5
22.5°	1173.7
25°	692.8
27.5°	366.2
30°	208.1
32.5°	134.5
35°	91.5
37.5°	65.4
40°	47.3
42.5°	32.4
45°	20.0
47.5°	12.8
50°	8.8
52.5°	6.3
55°	4.3
57.5°	2.7
60°	2.0
62.5°	1.2
65°	0.6
67.5°	0.4
70°	0.2
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)