

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P785829

Luminaire Tested: LERS6D05D010-EC6DR450210IC9040-6LBS1H

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P785829
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LERS6D05D010-EC6DR450210IC9040-6LBS1H
Description: 6 INCH ROUND SHALLOW SEMI-SPECULAR CLEAR TRIM, WITH 45° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1349.0 lumens
Efficiency: N/A
Efficacy: 179.9 lumens/watt
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 7.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P785829

CATALOG NUMBER: LERS6D05D010-EC6DR450210IC9040-6LBS1H

Luminous Intensity Polar Plot

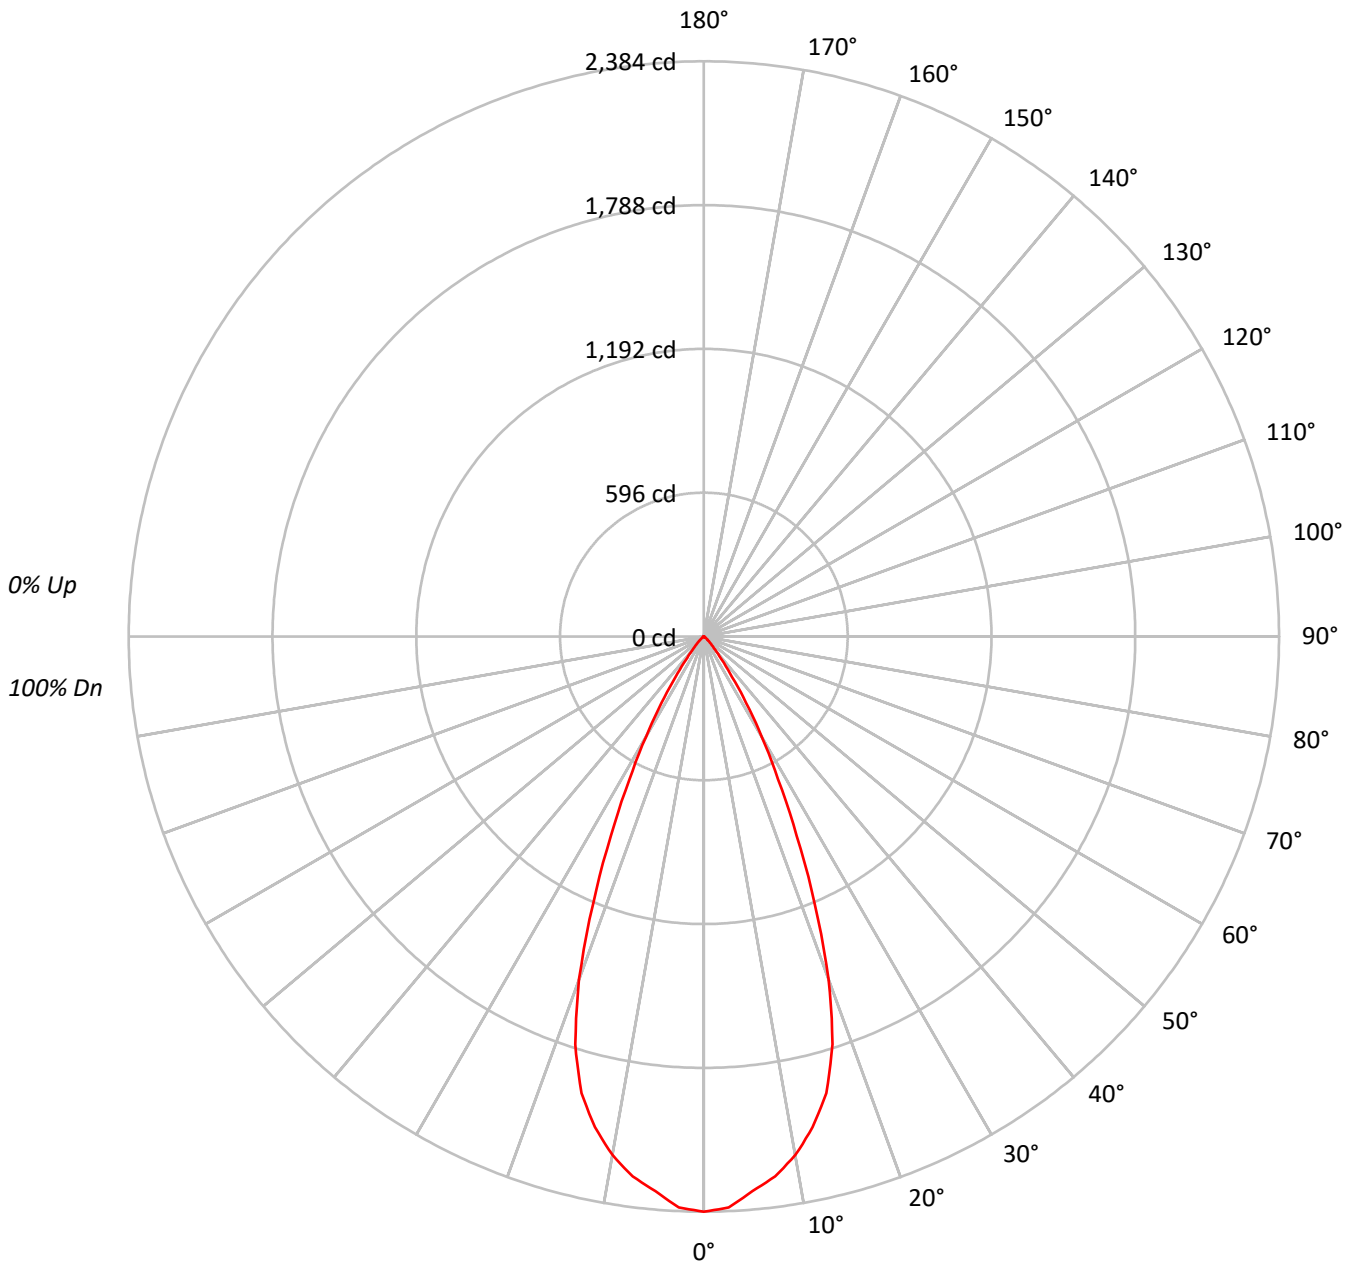



TEST NUMBER: P785829

CATALOG NUMBER: LERS6D05D010-EC6DR450210IC9040-6LBS1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100															
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95				95															
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90				90															
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85				85															
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81				81															
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77				77															
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73				73															
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69				69															
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66				66															
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63				63															
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60				60															

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	260510
5°	253093
10°	242151
15°	221615
20°	175816
25°	109766
30°	60495
35°	27170
40°	10697
45°	5037
50°	2397
55°	1257
60°	612
65°	155
70°	64
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 5037 cd/sqm



TEST NUMBER: P785829

CATALOG NUMBER: LERS6D05D010-EC6DR450210IC9040-6LBS1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	216.8	16.1
10°-20°	533.6	39.6
20°-30°	422.6	31.3
30°-40°	140.7	10.4
40°-50°	27.9	2.1
50°-60°	6.4	0.5
60°-70°	0.9	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1173.0	87.0
0°-40°	1313.8	97.4
0°-60°	1348.1	99.9
0°-90°	1349.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1349.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2384	
5°	2308	217
15°	1959	534
25°	910	423
35°	204	141
45°	33	28
55°	7	6
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P785829

CATALOG NUMBER: LERS6D05D010-EC6DR450210IC9040-6LBS1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	2384.3
2.5°	2368.8
5°	2307.6
7.5°	2257.2
10°	2182.6
12.5°	2083.2
15°	1959.2
17.5°	1772.8
20°	1512.1
22.5°	1201.6
25°	910.5
27.5°	666.7
30°	479.5
32.5°	326.1
35°	203.7
37.5°	120.8
40°	75.0
42.5°	49.3
45°	32.6
47.5°	21.0
50°	14.1
52.5°	9.4
55°	6.6
57.5°	4.3
60°	2.8
62.5°	1.5
65°	0.6
67.5°	0.2
70°	0.2
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)