

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P785847

Luminaire Tested: LERS6D05D010-EC6DR500210IC9030-6LBS1MW

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P785847  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-44)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LERS6D05D010-EC6DR500210IC9030-6LBS1MW  
Description: 6 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 50° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1196.4 lumens  
Efficiency: N/A  
Efficacy: 159.5 lumens/watt  
Spacing Criteria (0/90/45): 0.8 / 0.8 / 0.73  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 7.5  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight

TEST NUMBER: P785847

CATALOG NUMBER: LERS6D05D010-EC6DR500210IC9030-6LBS1MW

### Luminous Intensity Polar Plot

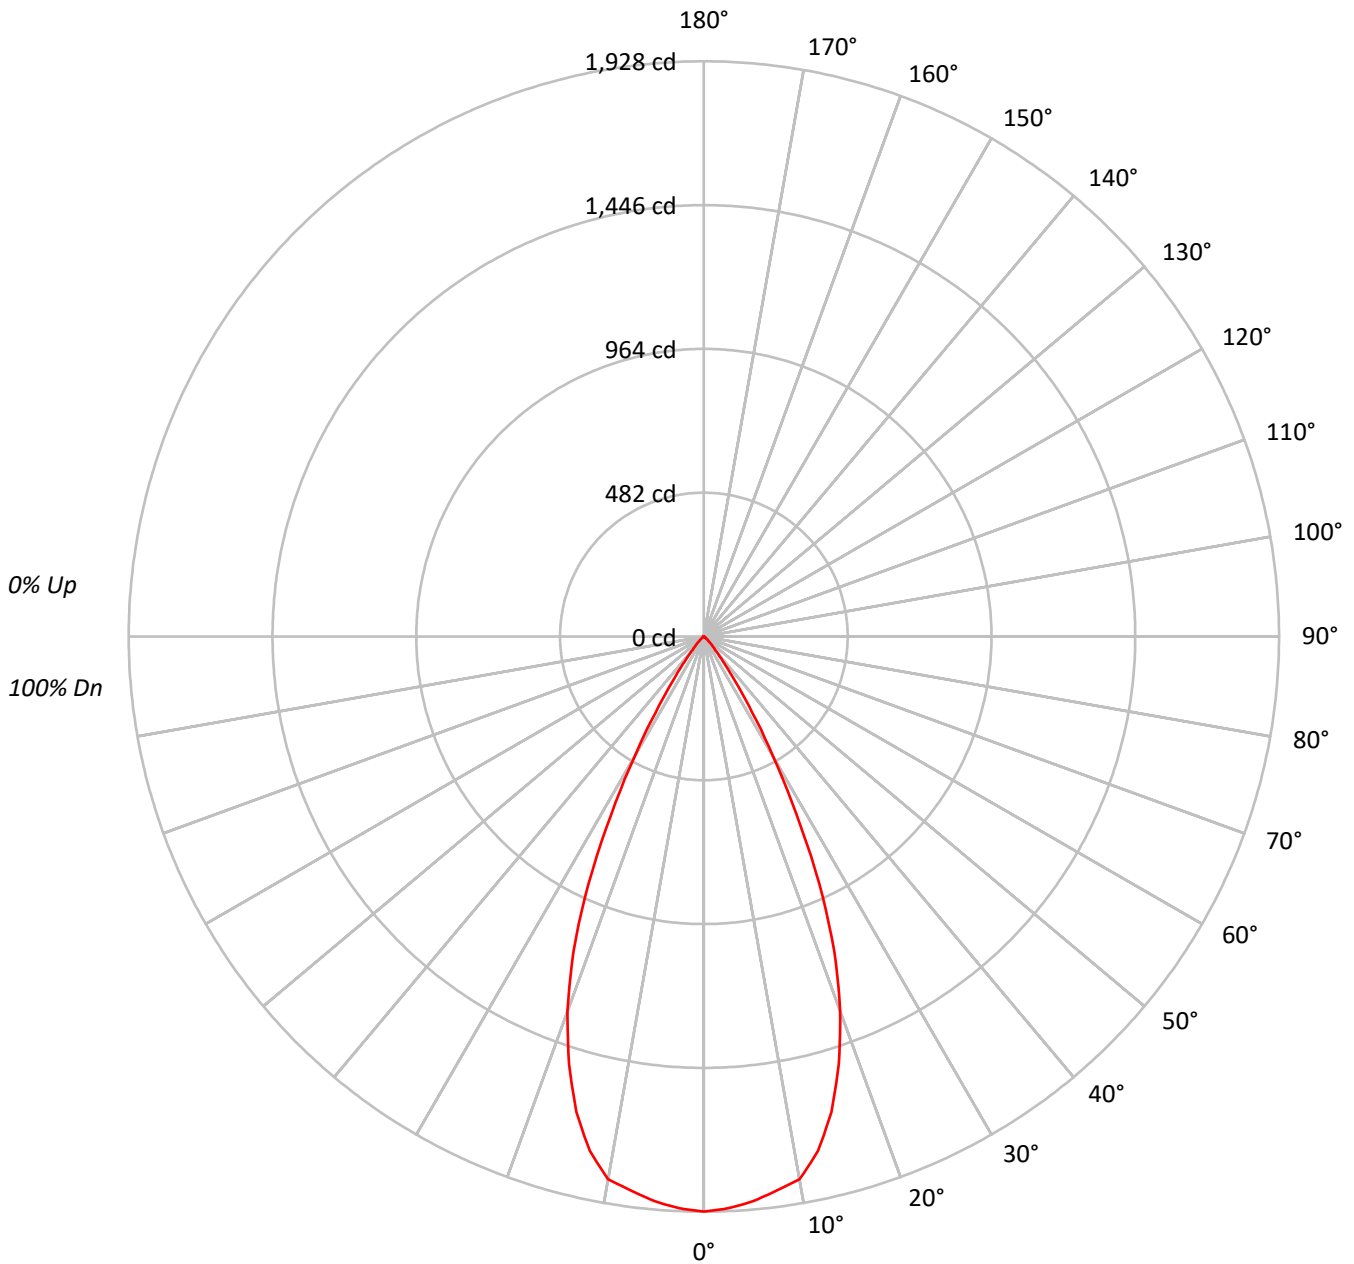



TEST NUMBER: P785847

CATALOG NUMBER: LERS6D05D010-EC6DR500210IC9030-6LBS1MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	112	109	107	112	110	108	106	106	104	102	102	101	99	98	97	97	95			
2	109	105	101	98	107	103	100	97	100	98	95	97	95	93	95	93	91	90			
3	105	99	95	91	103	98	94	90	95	92	89	93	90	88	91	88	86	85			
4	100	94	89	85	99	93	88	85	90	87	84	89	85	83	87	84	82	80			
5	96	89	84	80	95	88	83	79	86	82	79	85	81	78	83	80	77	76			
6	92	84	79	75	91	83	79	75	82	78	74	81	77	74	79	76	74	72			
7	88	80	75	71	87	79	74	71	78	74	71	77	73	70	76	73	70	69			
8	85	76	71	67	84	76	71	67	75	70	67	74	70	67	73	69	66	65			
9	81	73	68	64	80	72	67	64	71	67	64	71	67	64	70	66	63	62			
10	78	70	64	61	77	69	64	61	68	64	61	68	64	61	67	63	60	59			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	210622
5°	208410
10°	204984
15°	186651
20°	155317
25°	110248
30°	58351
35°	23782
40°	8829
45°	4048
50°	1666
55°	876
60°	437
65°	129
70°	0
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 4048 cd/sqm



TEST NUMBER: P785847

CATALOG NUMBER: LERS6D05D010-EC6DR500210IC9030-6LBS1MW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	179.6	15.0
10°-20°	453.9	37.9
20°-30°	407.7	34.1
30°-40°	127.7	10.7
40°-50°	22.4	1.9
50°-60°	4.5	0.4
60°-70°	0.7	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1041.3	87.0
0°-40°	1168.9	97.7
0°-60°	1195.8	99.9
0°-90°	1196.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1196.4	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1928	
5°	1900	180
15°	1650	454
25°	914	408
35°	178	128
45°	26	22
55°	5	4
65°	0	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P785847

CATALOG NUMBER: LERS6D05D010-EC6DR500210IC9030-6LBS1MW

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	1927.7
2.5°	1918.1
5°	1900.2
7.5°	1872.9
10°	1847.6
12.5°	1766.3
15°	1650.1
17.5°	1502.5
20°	1335.8
22.5°	1142.9
25°	914.5
27.5°	672.4
30°	462.5
32.5°	301.2
35°	178.3
37.5°	102.4
40°	61.9
42.5°	40.3
45°	26.2
47.5°	15.9
50°	9.8
52.5°	6.7
55°	4.6
57.5°	3.1
60°	2.0
62.5°	1.1
65°	0.5
67.5°	0.2
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)