

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P785981

Luminaire Tested: LERS6D08D010-EC6DR150210IC9024-6LBS1H

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P785981
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-21)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LERS6D08D010-EC6DR150210IC9024-6LBS1H
Description: 6 INCH ROUND SHALLOW SEMI-SPECULAR CLEAR TRIM, WITH 15° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 721.0 lumens
Efficiency: N/A
Efficacy: 81.0 lumens/watt
Spacing Criteria (0/90/45): 0.22 / 0.22 / 0.23
Luminous Opening: Vertical Cylinder (Dia: 0.35' x H: 0.35')
CIE Type: Direct

Input Watts (W): 8.9
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P785981

CATALOG NUMBER: LERS6D08D010-EC6DR150210IC9024-6LBS1H

Luminous Intensity Polar Plot

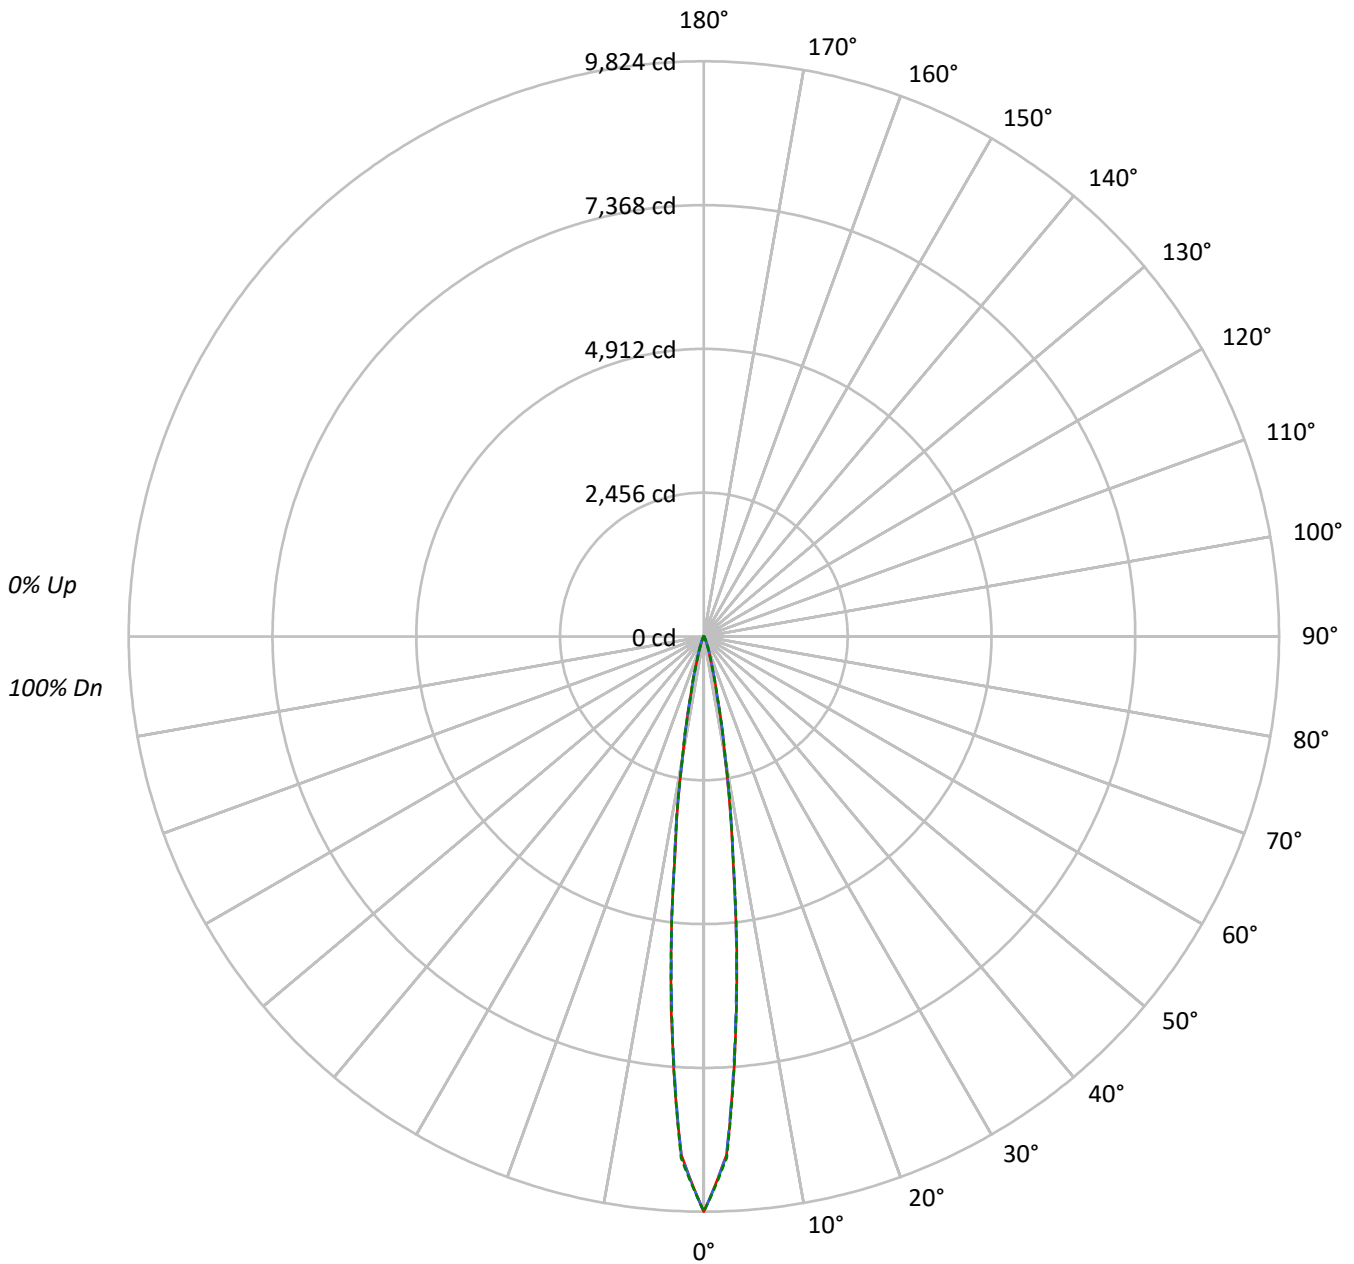



TEST NUMBER: P785981

CATALOG NUMBER: LERS6D08D010-EC6DR150210IC9024-6LBS1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|---|--|--|--|--|--|--|----|--|--|--|--|--|--|--|--|---|
| RF | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | |
| RC | 80 | | | | | | | | | 50 | | | | | | | | | 30 | | | | | | | | | 10 | | | | | | | | | 0 |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 | | | | | | | | | | | | | | | | |
| RCR | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | | | | | | | | | | | | | | | | | | |
| 1 | 116 | 114 | 112 | 111 | 113 | 112 | 110 | 109 | 108 | 107 | 106 | 104 | 103 | 103 | 101 | 100 | 100 | 98 | | | | | | | | | | | | | | | | | | | |
| 2 | 113 | 110 | 107 | 105 | 111 | 108 | 106 | 104 | 105 | 103 | 102 | 102 | 101 | 100 | 100 | 98 | 98 | 96 | | | | | | | | | | | | | | | | | | | |
| 3 | 110 | 106 | 103 | 101 | 108 | 105 | 102 | 100 | 103 | 100 | 99 | 100 | 99 | 97 | 98 | 97 | 96 | 94 | | | | | | | | | | | | | | | | | | | |
| 4 | 108 | 103 | 100 | 98 | 106 | 102 | 99 | 97 | 100 | 98 | 96 | 99 | 97 | 95 | 97 | 95 | 94 | 93 | | | | | | | | | | | | | | | | | | | |
| 5 | 106 | 101 | 98 | 95 | 104 | 100 | 97 | 95 | 99 | 96 | 94 | 97 | 95 | 93 | 96 | 94 | 92 | 92 | | | | | | | | | | | | | | | | | | | |
| 6 | 104 | 99 | 95 | 93 | 102 | 98 | 95 | 93 | 97 | 94 | 92 | 96 | 93 | 92 | 95 | 93 | 91 | 90 | | | | | | | | | | | | | | | | | | | |
| 7 | 102 | 97 | 94 | 91 | 101 | 96 | 93 | 91 | 95 | 93 | 91 | 94 | 92 | 90 | 93 | 91 | 90 | 89 | | | | | | | | | | | | | | | | | | | |
| 8 | 100 | 95 | 92 | 90 | 99 | 95 | 92 | 90 | 94 | 91 | 89 | 93 | 91 | 89 | 92 | 90 | 89 | 88 | | | | | | | | | | | | | | | | | | | |
| 9 | 99 | 93 | 90 | 88 | 98 | 93 | 90 | 88 | 92 | 90 | 88 | 92 | 89 | 88 | 91 | 89 | 88 | 87 | | | | | | | | | | | | | | | | | | | |
| 10 | 97 | 92 | 89 | 87 | 96 | 92 | 89 | 87 | 91 | 89 | 87 | 91 | 88 | 87 | 90 | 88 | 86 | 86 | | | | | | | | | | | | | | | | | | | |

AVERAGE LUMINANCE (cd/sqm):

| | 0° | 45° | 90° |
|-----|---------|---------|---------|
| 0° | 1105430 | 1105430 | 1105430 |
| 5° | 649602 | 641187 | 646268 |
| 10° | 193875 | 195237 | 198223 |
| 15° | 48223 | 49161 | 47650 |
| 20° | 14425 | 16708 | 14736 |
| 25° | 5087 | 6481 | 5149 |
| 30° | 1872 | 2464 | 1902 |
| 35° | 937 | 1060 | 908 |
| 40° | 589 | 646 | 589 |
| 45° | 434 | 469 | 434 |
| 50° | 348 | 348 | 348 |
| 55° | 292 | 292 | 292 |
| 60° | 232 | 232 | 232 |
| 65° | 178 | 178 | 178 |
| 70° | 154 | 154 | 154 |
| 75° | 91 | 91 | 128 |
| 80° | 63 | 63 | 63 |
| 85° | 33 | 33 | 33 |

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 45°

Vertical Angle: 45°

Luminance: 469 cd/sqm



TEST NUMBER: P785981

CATALOG NUMBER: LERS6D08D010-EC6DR150210IC9024-6LBS1H

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 467.7 | 64.9 |
| 10°-20° | 192.4 | 26.7 |
| 20°-30° | 38.2 | 5.3 |
| 30°-40° | 9.5 | 1.3 |
| 40°-50° | 5.0 | 0.7 |
| 50°-60° | 3.7 | 0.5 |
| 60°-70° | 2.6 | 0.4 |
| 70°-80° | 1.5 | 0.2 |
| 80°-90° | 0.4 | 0.1 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 698.2 | 96.8 |
| 0°-40° | 707.8 | 98.2 |
| 0°-60° | 716.5 | 99.4 |
| 0°-90° | 721.0 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 721.0 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | 22.5° | 45° | 67.5° | 90° | Flux |
|-----|------|-------|------|-------|------|------|
| 0° | 9824 | 9824 | 9824 | 9824 | 9824 | |
| 5° | 6392 | 6326 | 6309 | 6353 | 6359 | 467 |
| 15° | 555 | 566 | 566 | 556 | 549 | 190 |
| 25° | 65 | 74 | 83 | 74 | 66 | 34 |
| 35° | 13 | 14 | 15 | 14 | 12 | 9 |
| 45° | 6 | 6 | 7 | 6 | 6 | 5 |
| 55° | 4 | 4 | 4 | 4 | 4 | 4 |
| 65° | 2 | 2 | 2 | 2 | 2 | 3 |
| 75° | 1 | 1 | 1 | 1 | 2 | 1 |
| 85° | 0 | 0 | 0 | 0 | 0 | 0 |
| 90° | 0 | 0 | 0 | 0 | 0 | |



TEST NUMBER: P785981

CATALOG NUMBER: LERS6D08D010-EC6DR150210IC9024-6LBS1H

CANDELA DISTRIBUTION (FULL):

| | 0° | 22.5° | 45° | 67.5° | 90° |
|-------|--------|--------|--------|--------|--------|
| 0° | 9824.3 | 9824.3 | 9824.3 | 9824.3 | 9824.3 |
| 2.5° | 8861.9 | 8869.4 | 8872.3 | 8881.0 | 8913.5 |
| 5° | 6391.9 | 6326.2 | 6309.1 | 6352.8 | 6359.1 |
| 7.5° | 3786.3 | 3799.6 | 3848.3 | 3859.1 | 3820.0 |
| 10° | 2077.8 | 2094.9 | 2092.4 | 2107.3 | 2124.4 |
| 12.5° | 1062.6 | 1049.3 | 1045.1 | 1062.2 | 1038.5 |
| 15° | 555.2 | 565.6 | 566.0 | 556.1 | 548.6 |
| 17.5° | 298.6 | 310.7 | 330.6 | 314.4 | 289.5 |
| 20° | 176.3 | 187.2 | 204.2 | 190.9 | 180.1 |
| 22.5° | 109.0 | 117.7 | 129.8 | 119.4 | 110.6 |
| 25° | 65.3 | 74.0 | 83.2 | 73.6 | 66.1 |
| 27.5° | 38.7 | 46.2 | 52.0 | 45.7 | 38.3 |
| 30° | 25.0 | 29.1 | 32.9 | 28.7 | 25.4 |
| 32.5° | 17.5 | 19.1 | 20.8 | 19.1 | 17.5 |
| 35° | 12.9 | 13.7 | 14.6 | 13.7 | 12.5 |
| 37.5° | 10.0 | 10.8 | 11.2 | 10.4 | 9.6 |
| 40° | 8.3 | 8.7 | 9.1 | 8.7 | 8.3 |
| 42.5° | 7.1 | 7.5 | 7.5 | 7.5 | 7.1 |
| 45° | 6.2 | 6.2 | 6.7 | 6.2 | 6.2 |
| 47.5° | 5.4 | 5.4 | 5.8 | 5.4 | 5.4 |
| 50° | 5.0 | 5.0 | 5.0 | 5.0 | 5.0 |
| 52.5° | 4.6 | 4.6 | 4.6 | 4.6 | 4.6 |
| 55° | 4.2 | 4.2 | 4.2 | 4.2 | 4.2 |
| 57.5° | 3.7 | 3.7 | 3.7 | 3.7 | 3.7 |
| 60° | 3.3 | 3.3 | 3.3 | 3.3 | 3.3 |
| 62.5° | 2.9 | 2.9 | 2.9 | 2.9 | 2.9 |
| 65° | 2.5 | 2.5 | 2.5 | 2.5 | 2.5 |
| 67.5° | 2.5 | 2.5 | 2.5 | 2.5 | 2.5 |
| 70° | 2.1 | 2.1 | 2.1 | 2.1 | 2.1 |
| 72.5° | 1.7 | 1.7 | 1.7 | 1.7 | 1.7 |
| 75° | 1.2 | 1.2 | 1.2 | 1.2 | 1.7 |
| 77.5° | 1.2 | 1.2 | 1.2 | 1.2 | 1.2 |
| 80° | 0.8 | 0.8 | 0.8 | 0.8 | 0.8 |
| 82.5° | 0.8 | 0.8 | 0.8 | 0.8 | 0.8 |
| 85° | 0.4 | 0.4 | 0.4 | 0.4 | 0.4 |
| 87.5° | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 90° | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 |

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)