

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P786003

Luminaire Tested: LERS6D08D010-EC6DR150210IC9050-6LBS1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P786003
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-21)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LERS6D08D010-EC6DR150210IC9050-6LBS1MW
Description: 6 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 15° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 841.8 lumens
Efficiency: N/A
Efficacy: 94.6 lumens/watt
Spacing Criteria (0/90/45): 0.22 / 0.22 / 0.23
Luminous Opening: Vertical Cylinder (Dia: 0.35' x H: 0.35')
CIE Type: Direct

Input Watts (W): 8.9
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P786003

CATALOG NUMBER: LERS6D08D010-EC6DR150210IC9050-6LBS1MW

Luminous Intensity Polar Plot

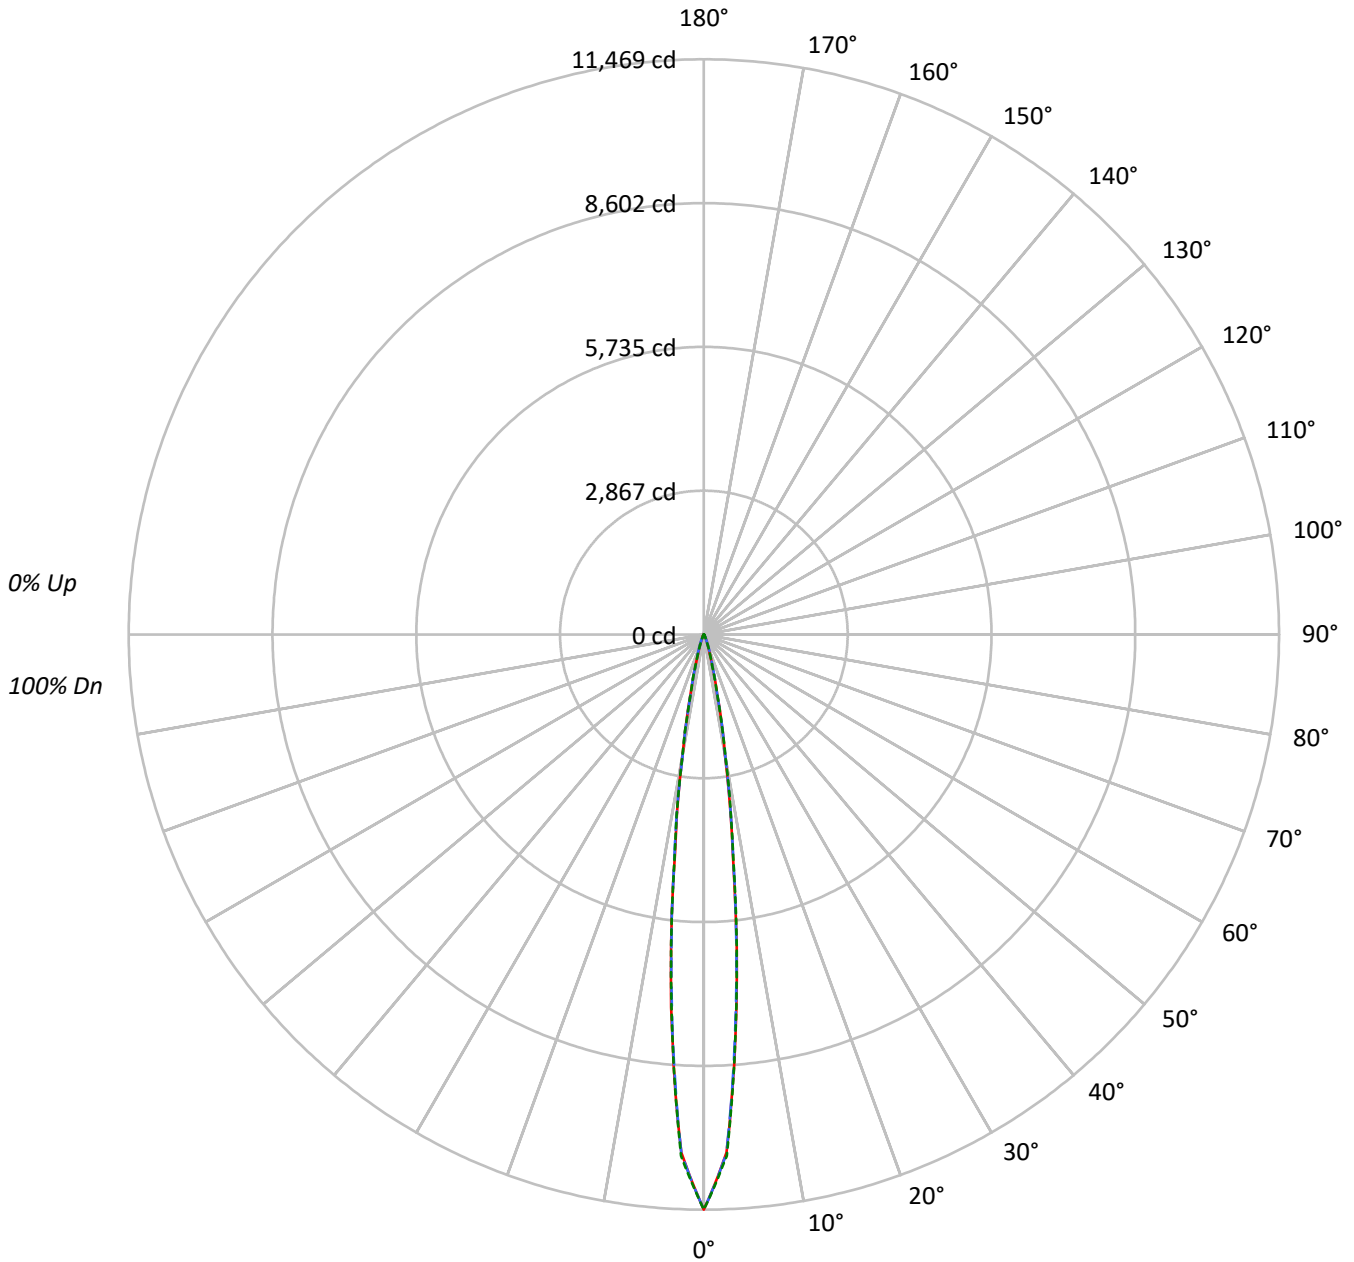



TEST NUMBER: P786003

CATALOG NUMBER: LERS6D08D010-EC6DR150210IC9050-6LBS1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	116	114	112	111	113	112	110	109	108	107	106	104	103	103	101	100	100	98																			
2	113	110	107	105	111	108	106	104	105	103	102	102	101	100	100	98	98	96																			
3	110	106	103	101	108	105	102	100	103	100	99	100	99	97	98	97	96	94																			
4	108	103	100	98	106	102	99	97	100	98	96	99	97	95	97	95	94	93																			
5	106	101	98	95	104	100	97	95	98	96	94	97	95	93	96	94	92	92																			
6	104	99	95	93	102	98	95	93	97	94	92	96	93	92	95	93	91	90																			
7	102	97	94	91	101	96	93	91	95	93	91	94	92	90	93	91	90	89																			
8	100	95	92	90	99	95	92	90	94	91	89	93	91	89	92	90	89	88																			
9	99	93	90	88	98	93	90	88	92	90	88	92	89	88	91	89	87	87																			
10	97	92	89	87	96	92	89	87	91	89	87	91	88	87	90	88	86	86																			

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1290458	1290458	1290458
5°	758335	748517	754442
10°	226327	227913	231403
15°	56301	57395	55623
20°	16847	19507	17199
25°	5936	7564	6014
30°	2179	2875	2216
35°	1097	1235	1060
40°	689	760	689
45°	511	546	511
50°	403	403	403
55°	341	341	341
60°	274	274	274
65°	207	207	207
70°	176	176	176
75°	113	113	144
80°	79	79	79
85°	42	42	42

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 45°

Vertical Angle: 45°

Luminance: 546 cd/sqm



TEST NUMBER: P786003

CATALOG NUMBER: LERS6D08D010-EC6DR150210IC9050-6LBS1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	545.9	64.9
10°-20°	224.6	26.7
20°-30°	44.6	5.3
30°-40°	11.1	1.3
40°-50°	5.8	0.7
50°-60°	4.3	0.5
60°-70°	3.1	0.4
70°-80°	1.8	0.2
80°-90°	0.5	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	815.1	96.8
0°-40°	826.2	98.2
0°-60°	836.4	99.4
0°-90°	841.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	841.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	11469	11469	11469	11469	11469	
5°	7462	7385	7365	7416	7424	545
15°	648	660	661	649	640	222
25°	76	86	97	86	77	40
35°	15	16	17	16	15	10
45°	7	7	8	7	7	6
55°	5	5	5	5	5	4
65°	3	3	3	3	3	3
75°	2	2	2	2	2	2
85°	0	0	0	0	0	1
90°	0	0	0	0	0	



TEST NUMBER: P786003

CATALOG NUMBER: LERS6D08D010-EC6DR150210IC9050-6LBS1MW

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	11468.7	11468.7	11468.7	11468.7	11468.7
2.5°	10345.3	10354.0	10357.4	10367.6	10405.5
5°	7461.8	7385.1	7365.2	7416.2	7423.5
7.5°	4420.1	4435.6	4492.4	4505.1	4459.4
10°	2425.6	2445.5	2442.6	2460.1	2480.0
12.5°	1240.5	1224.9	1220.1	1240.0	1212.3
15°	648.2	660.3	660.8	649.1	640.4
17.5°	348.6	362.7	386.0	367.0	337.9
20°	205.9	218.5	238.4	222.8	210.2
22.5°	127.2	137.4	151.5	139.3	129.1
25°	76.2	86.4	97.1	85.9	77.2
27.5°	45.2	53.9	60.7	53.4	44.7
30°	29.1	34.0	38.4	33.5	29.6
32.5°	20.4	22.3	24.3	22.3	20.4
35°	15.1	16.0	17.0	16.0	14.6
37.5°	11.7	12.6	13.1	12.1	11.2
40°	9.7	10.2	10.7	10.2	9.7
42.5°	8.3	8.7	8.7	8.7	8.3
45°	7.3	7.3	7.8	7.3	7.3
47.5°	6.3	6.3	6.8	6.3	6.3
50°	5.8	5.8	5.8	5.8	5.8
52.5°	5.3	5.3	5.3	5.3	5.3
55°	4.9	4.9	4.9	4.9	4.9
57.5°	4.4	4.4	4.4	4.4	4.4
60°	3.9	3.9	3.9	3.9	3.9
62.5°	3.4	3.4	3.4	3.4	3.4
65°	2.9	2.9	2.9	2.9	2.9
67.5°	2.9	2.9	2.9	2.9	2.9
70°	2.4	2.4	2.4	2.4	2.4
72.5°	1.9	1.9	1.9	1.9	1.9
75°	1.5	1.5	1.5	1.5	1.5
77.5°	1.5	1.5	1.5	1.5	1.5
80°	1.0	1.0	1.0	1.0	1.0
82.5°	1.0	1.0	1.0	1.0	1.0
85°	0.5	0.5	0.5	0.5	0.5
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)