

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P786007

Luminaire Tested: LERS6D08D010-EC6DR200210IC9024-6LBS1MW

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P786007  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-36)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LERS6D08D010-EC6DR200210IC9024-6LBS1MW  
Description: 6 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 20° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 718.7 lumens  
Efficiency: N/A  
Efficacy: 80.8 lumens/watt  
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.36  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct


Input Watts (W): 8.9  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



Downlight

TEST NUMBER: P786007  
CATALOG NUMBER: LERS6D08D010-EC6DR200210IC9024-6LBS1MW

### Luminous Intensity Polar Plot

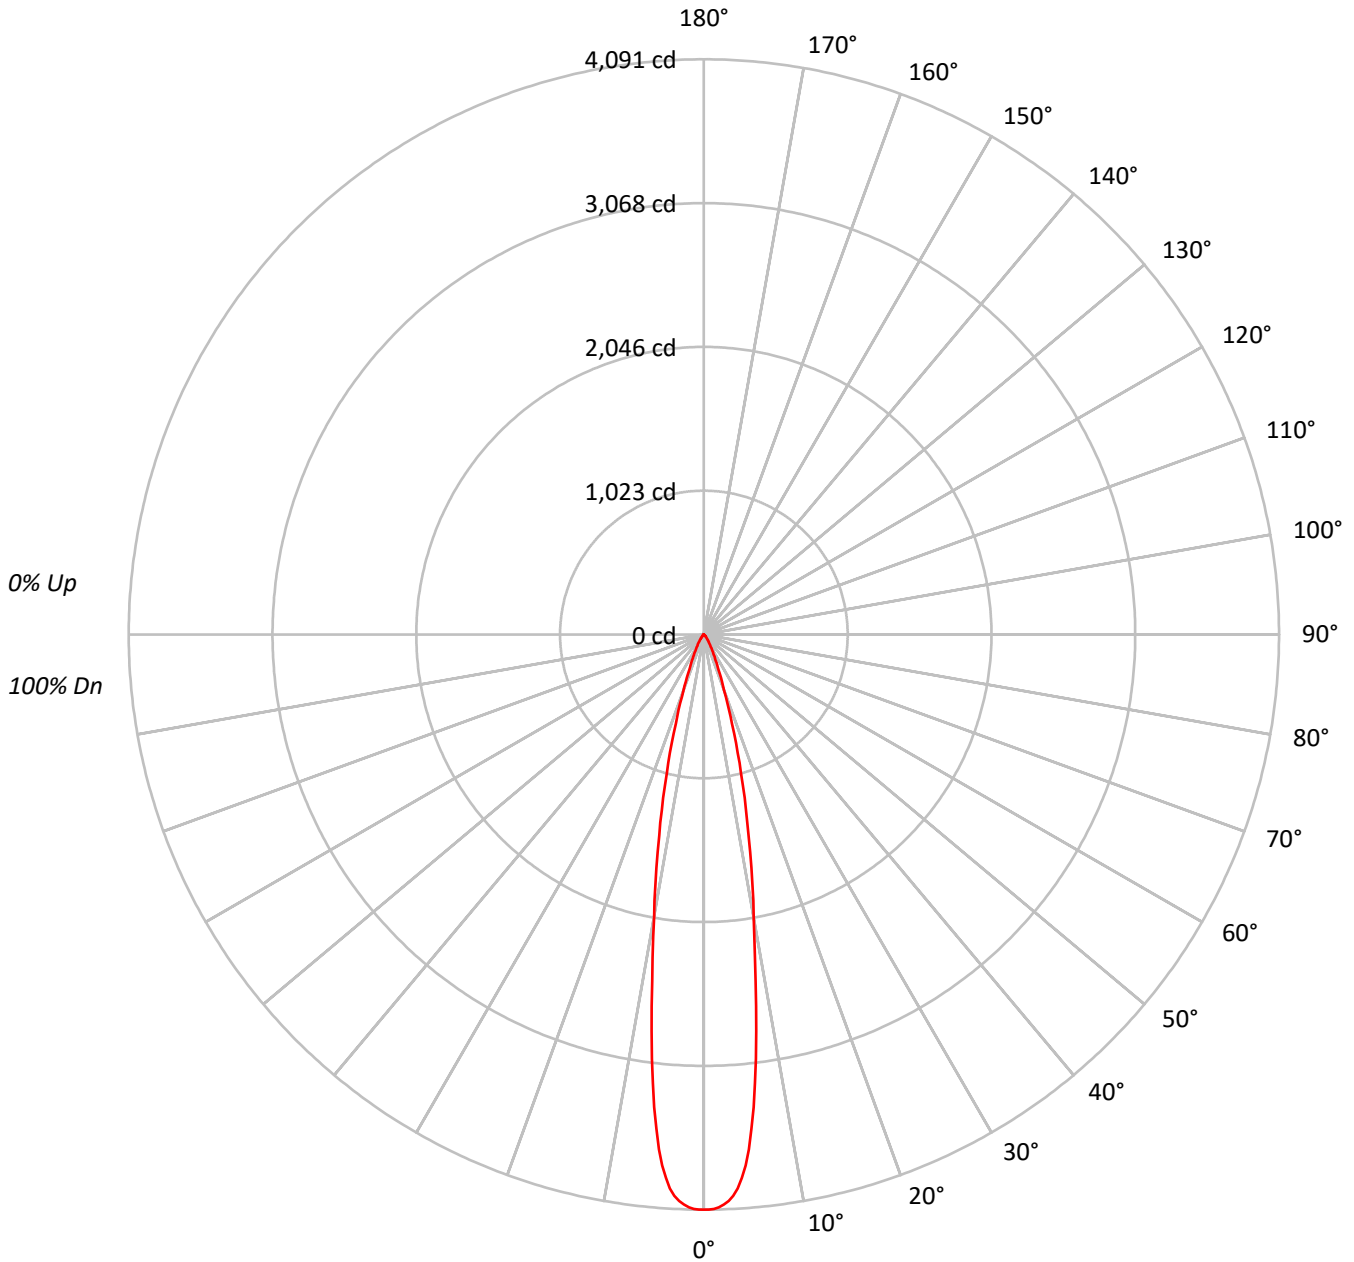



TEST NUMBER: P786007

CATALOG NUMBER: LERS6D08D010-EC6DR200210IC9024-6LBS1MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	100	99	98	97	98	96	95	94												
2	111	108	105	102	109	106	104	101	103	101	99	100	99	97	98	96	95	98	96	95	94	93	92	91	94												
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	93	92	98	96	95	94	93	92	91	94												
4	105	99	96	93	103	98	95	92	96	93	91	95	92	90	93	91	89	93	91	89	88	87	86	85	88												
5	102	96	92	89	100	95	91	89	94	90	88	92	89	87	91	88	86	91	88	86	85	84	83	82	85												
6	99	93	89	86	98	92	88	86	91	87	85	90	87	84	88	86	84	88	86	84	83	82	81	80	83												
7	96	90	86	83	95	89	86	83	88	85	82	87	84	82	86	84	82	86	84	82	81	80	79	78	81												
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	80	84	82	80	79	78	77	76	79												
9	91	85	81	78	91	85	81	78	84	80	78	83	80	78	82	80	78	82	80	78	77	76	75	74	77												
10	89	83	79	76	88	82	79	76	82	78	76	81	78	76	81	78	76	81	78	76	75	74	73	72	75												

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	446975
5°	403254
10°	226330
15°	115049
20°	48707
25°	22484
30°	11897
35°	6416
40°	3423
45°	2024
50°	1173
55°	629
60°	393
65°	284
70°	128
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 2024 cd/sqm



TEST NUMBER: P786007

CATALOG NUMBER: LERS6D08D010-EC6DR200210IC9024-6LBS1MW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	291.3	40.5
10°-20°	286.8	39.9
20°-30°	93.7	13.0
30°-40°	31.9	4.4
40°-50°	10.7	1.5
50°-60°	3.2	0.4
60°-70°	1.1	0.2
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	671.7	93.5
0°-40°	703.6	97.9
0°-60°	717.6	99.8
0°-90°	718.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	718.7	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	4091	
5°	3677	291
15°	1017	287
25°	186	94
35°	48	32
45°	13	11
55°	3	3
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P786007

CATALOG NUMBER: LERS6D08D010-EC6DR200210IC9024-6LBS1MW

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	4090.9
0.5°	4090.9
1°	4085.8
1.5°	4075.6
2°	4057.0
2.5°	4032.2
3°	3997.2
3.5°	3948.4
4°	3875.9
4.5°	3787.8
5°	3676.7
5.5°	3530.6
6°	3380.9
6.5°	3209.3
7°	3041.4
7.5°	2844.7
8°	2669.1
8.5°	2492.4
9°	2329.2
9.5°	2179.5
10°	2040.0
12.5°	1464.8
15°	1017.1
17.5°	664.4
20°	418.9
22.5°	271.4
25°	186.5
27.5°	131.1
30°	94.3
32.5°	67.8
35°	48.1
37.5°	33.5
40°	24.0
42.5°	17.5
45°	13.1
47.5°	10.2
50°	6.9
52.5°	4.4
55°	3.3
57.5°	2.5
60°	1.8
62.5°	1.5
65°	1.1



TEST NUMBER: P786007

CATALOG NUMBER: LERS6D08D010-EC6DR200210IC9024-6LBS1MW

**CANDELA DISTRIBUTION (continued):**

	0°
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



67.5°		0.7
70°		0.4

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)