

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P786155

Luminaire Tested: LERS6D08D010-EC6DR500210IC9027-6LBS1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P786155
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-44)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LERS6D08D010-EC6DR500210IC9027-6LBS1MW
Description: 6 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 50° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1363.2 lumens
Efficiency: N/A
Efficacy: 153.2 lumens/watt
Spacing Criteria (0/90/45): 0.8 / 0.8 / 0.73
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 8.9
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P786155

CATALOG NUMBER: LERS6D08D010-EC6DR500210IC9027-6LBS1MW

Luminous Intensity Polar Plot

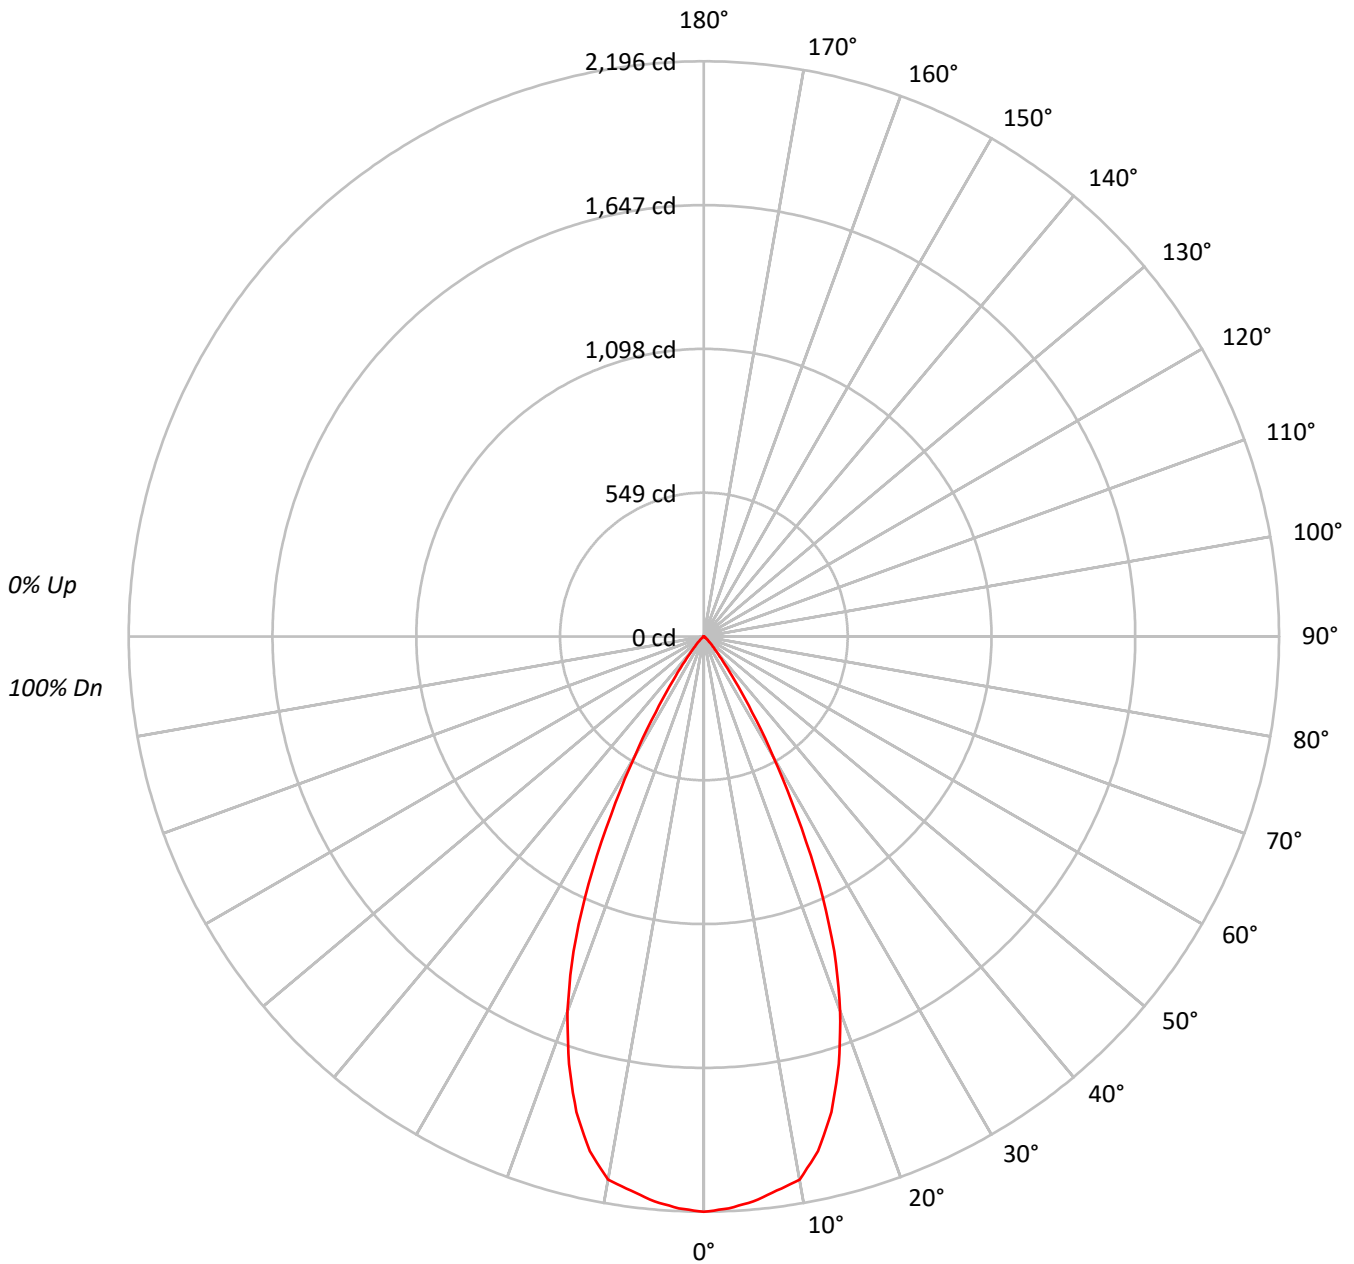



TEST NUMBER: P786155

CATALOG NUMBER: LERS6D08D010-EC6DR500210IC9027-6LBS1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR	0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100	100	100		
	1	114	112	109	107	112	110	108	106	106	104	102	102	101	99	98	97	97	95	95	95	95	95	95		
	2	109	105	101	98	107	103	100	97	100	98	95	97	95	93	95	93	91	90	90	90	90	90	90		
	3	105	99	95	91	103	98	94	90	95	92	89	93	90	88	91	88	86	85	85	85	85	85	85		
	4	100	94	89	85	99	93	88	85	90	87	84	89	85	83	87	84	82	80	80	80	80	80	80		
	5	96	89	84	80	95	88	83	79	86	82	79	85	81	78	83	80	77	76	76	76	76	76	76		
	6	92	84	79	75	91	83	79	75	82	78	74	81	77	74	79	76	74	72	72	72	72	72	72		
	7	88	80	75	71	87	79	74	71	78	74	71	77	73	70	76	73	70	69	69	69	69	69	69		
	8	85	76	71	67	84	76	71	67	75	70	67	74	70	67	73	69	66	65	65	65	65	65	65		
	9	81	73	68	64	80	72	67	64	71	67	64	71	67	64	70	66	63	62	62	62	62	62	62		
	10	78	70	64	61	77	69	64	61	68	64	61	68	64	61	67	63	60	59	59	59	59	59	59		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	239980
5°	237464
10°	233553
15°	212668
20°	176967
25°	125619
30°	66488
35°	27090
40°	10070
45°	4605
50°	1887
55°	991
60°	481
65°	155
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 4605 cd/sqm



TEST NUMBER: P786155

CATALOG NUMBER: LERS6D08D010-EC6DR500210IC9027-6LBS1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	204.6	15.0
10°-20°	517.2	37.9
20°-30°	464.6	34.1
30°-40°	145.5	10.7
40°-50°	25.5	1.9
50°-60°	5.1	0.4
60°-70°	0.8	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1186.4	87.0
0°-40°	1331.9	97.7
0°-60°	1362.4	99.9
0°-90°	1363.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1363.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2196	
5°	2165	205
15°	1880	517
25°	1042	465
35°	203	145
45°	30	25
55°	5	5
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P786155

CATALOG NUMBER: LERS6D08D010-EC6DR500210IC9027-6LBS1MW

CANDELA DISTRIBUTION (FULL):

0°	
0°	2196.4
2.5°	2185.4
5°	2165.1
7.5°	2134.0
10°	2105.1
12.5°	2012.5
15°	1880.1
17.5°	1712.0
20°	1522.0
22.5°	1302.2
25°	1042.0
27.5°	766.1
30°	527.0
32.5°	343.1
35°	203.1
37.5°	116.7
40°	70.6
42.5°	45.9
45°	29.8
47.5°	18.1
50°	11.1
52.5°	7.6
55°	5.2
57.5°	3.5
60°	2.2
62.5°	1.3
65°	0.6
67.5°	0.2
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)