

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P786236

Luminaire Tested: LERS6D08D010-EC6DR650210IC9040-6LBS1B

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P786236
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-147)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LERS6D08D010-EC6DR650210IC9040-6LBS1B
Description: 6 INCH ROUND SHALLOW SPECULAR BLACK TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1260.7 lumens
Efficiency: N/A
Efficacy: 141.6 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.96
Luminous Opening: Circular (Dia: 0.48' x H: 0')
CIE Type: Direct

Input Watts (W): 8.9
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P786236

CATALOG NUMBER: LERS6D08D010-EC6DR650210IC9040-6LBS1B

Luminous Intensity Polar Plot

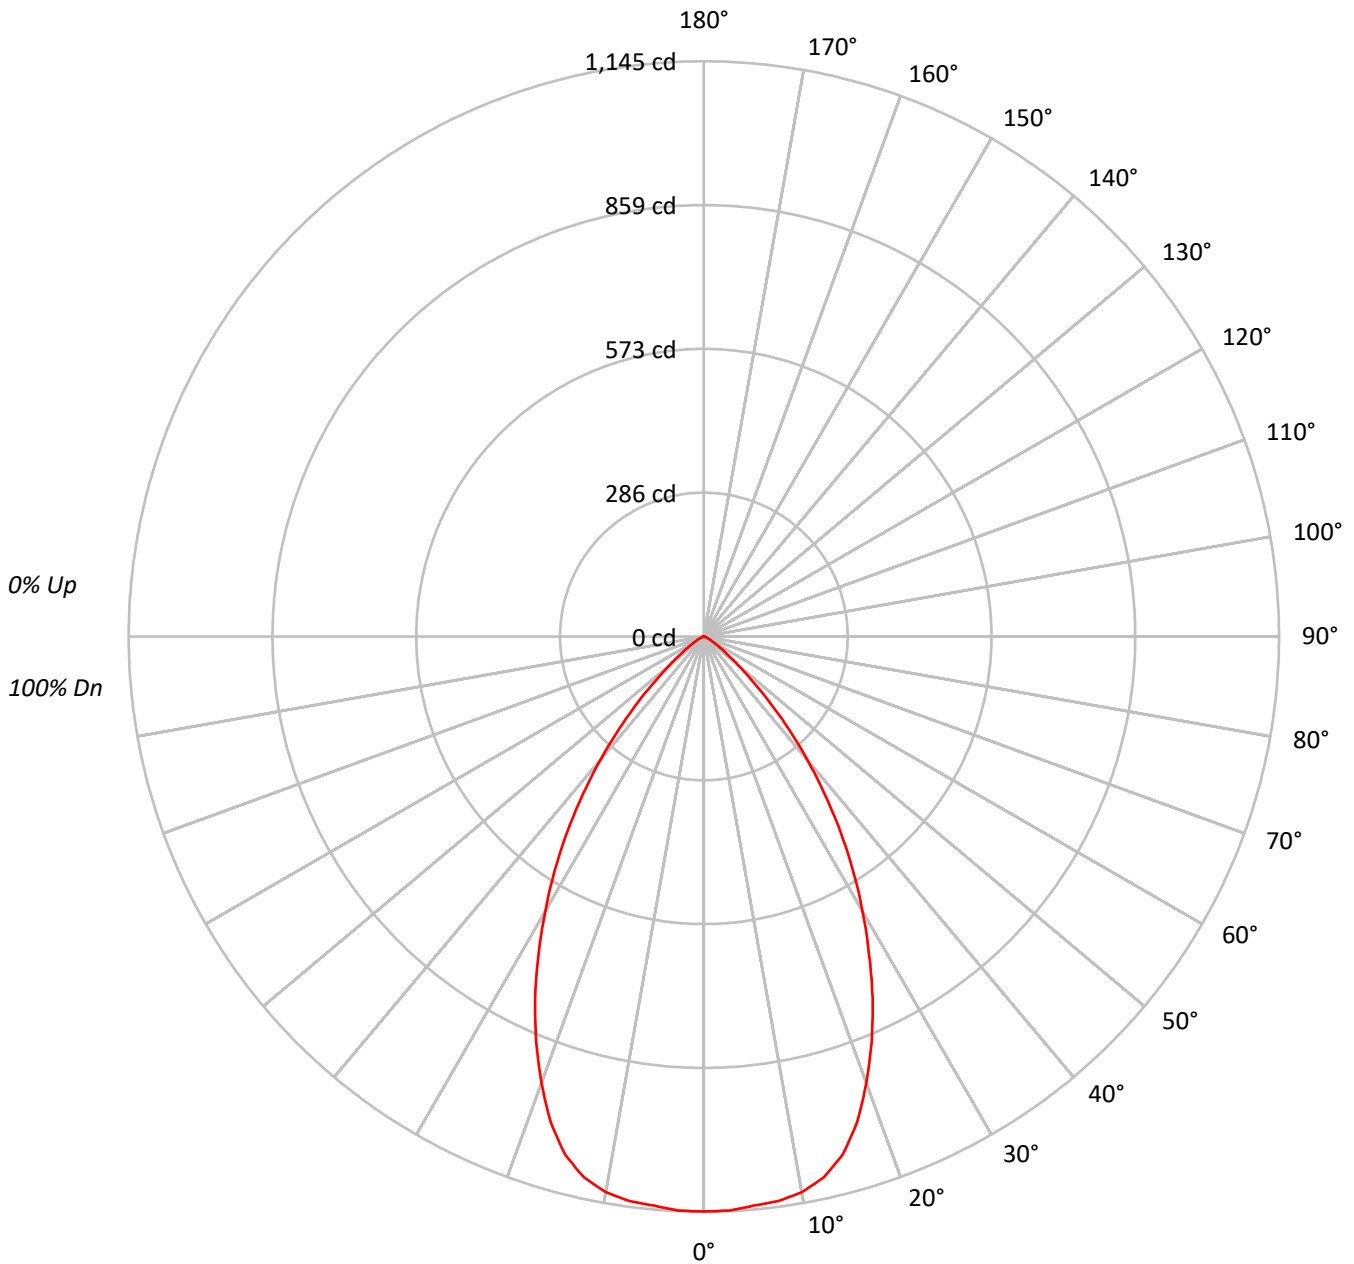



TEST NUMBER: P786236

CATALOG NUMBER: LERS6D08D010-EC6DR650210IC9040-6LBS1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100																
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	93			93																
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85			85																
3	101	94	88	84	99	92	87	83	90	86	82	87	84	81	85	82	80	78			78																
4	95	87	81	76	93	86	80	76	84	79	75	82	77	74	80	76	73	72			72																
5	90	81	74	70	88	80	74	69	78	73	69	76	72	68	75	71	68	66			66																
6	85	75	69	64	83	74	68	64	73	67	63	71	67	63	70	66	62	61			61																
7	80	70	64	59	79	69	63	59	68	63	59	67	62	58	66	61	58	56			56																
8	76	66	59	55	75	65	59	55	64	58	54	63	58	54	62	57	54	52			52																
9	72	61	55	51	71	61	55	51	60	54	51	59	54	50	58	54	50	49			49																
10	68	58	52	47	67	57	51	47	57	51	47	56	51	47	55	50	47	46			46																

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	66849
5°	66682
10°	66623
15°	64570
20°	58783
25°	51225
30°	42608
35°	33760
40°	24367
45°	15396
50°	8023
55°	4266
60°	2243
65°	1230
70°	512
75°	564
80°	404
85°	335

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 15396 cd/sqm



TEST NUMBER: P786236

CATALOG NUMBER: LERS6D08D010-EC6DR650210IC9040-6LBS1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	108.2	8.6
10°-20°	296.4	23.5
20°-30°	362.3	28.7
30°-40°	294.0	23.3
40°-50°	146.5	11.6
50°-60°	40.9	3.2
60°-70°	9.3	0.7
70°-80°	2.4	0.2
80°-90°	0.6	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	767.0	60.8
0°-40°	1061.0	84.2
0°-60°	1248.4	99.0
0°-90°	1260.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1260.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1145	
5°	1137	108
15°	1068	296
25°	795	362
35°	474	294
45°	186	147
55°	42	41
65°	9	9
75°	2	2
85°	0	1
90°	0	



TEST NUMBER: P786236

CATALOG NUMBER: LERS6D08D010-EC6DR650210IC9040-6LBS1B

CANDELA DISTRIBUTION (FULL):

0°	
0°	1144.6
2.5°	1143.8
5°	1137.4
7.5°	1133.7
10°	1123.4
12.5°	1102.6
15°	1067.9
17.5°	1013.8
20°	945.8
22.5°	872.5
25°	794.9
27.5°	712.0
30°	631.8
32.5°	552.5
35°	473.5
37.5°	394.6
40°	319.6
42.5°	249.3
45°	186.4
47.5°	129.9
50°	88.3
52.5°	60.9
55°	41.9
57.5°	28.3
60°	19.2
62.5°	13.3
65°	8.9
67.5°	4.5
70°	3.0
72.5°	2.9
75°	2.5
77.5°	1.7
80°	1.2
82.5°	0.8
85°	0.5
87.5°	0.3
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)