

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P786425

Luminaire Tested: LERS6D10D010-EC6DR400210IC9035-6LBS1H

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P786425  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-28)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LERS6D10D010-EC6DR400210IC9035-6LBS1H  
Description: 6 INCH ROUND SHALLOW SEMI-SPECULAR CLEAR TRIM, WITH 40° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 2104.4 lumens  
Efficiency: N/A  
Efficacy: 179.9 lumens/watt  
Spacing Criteria (0/90/45): 0.68 / 0.68 / 0.6  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 11.7  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight

TEST NUMBER: P786425

CATALOG NUMBER: LERS6D10D010-EC6DR400210IC9035-6LBS1H

### Luminous Intensity Polar Plot

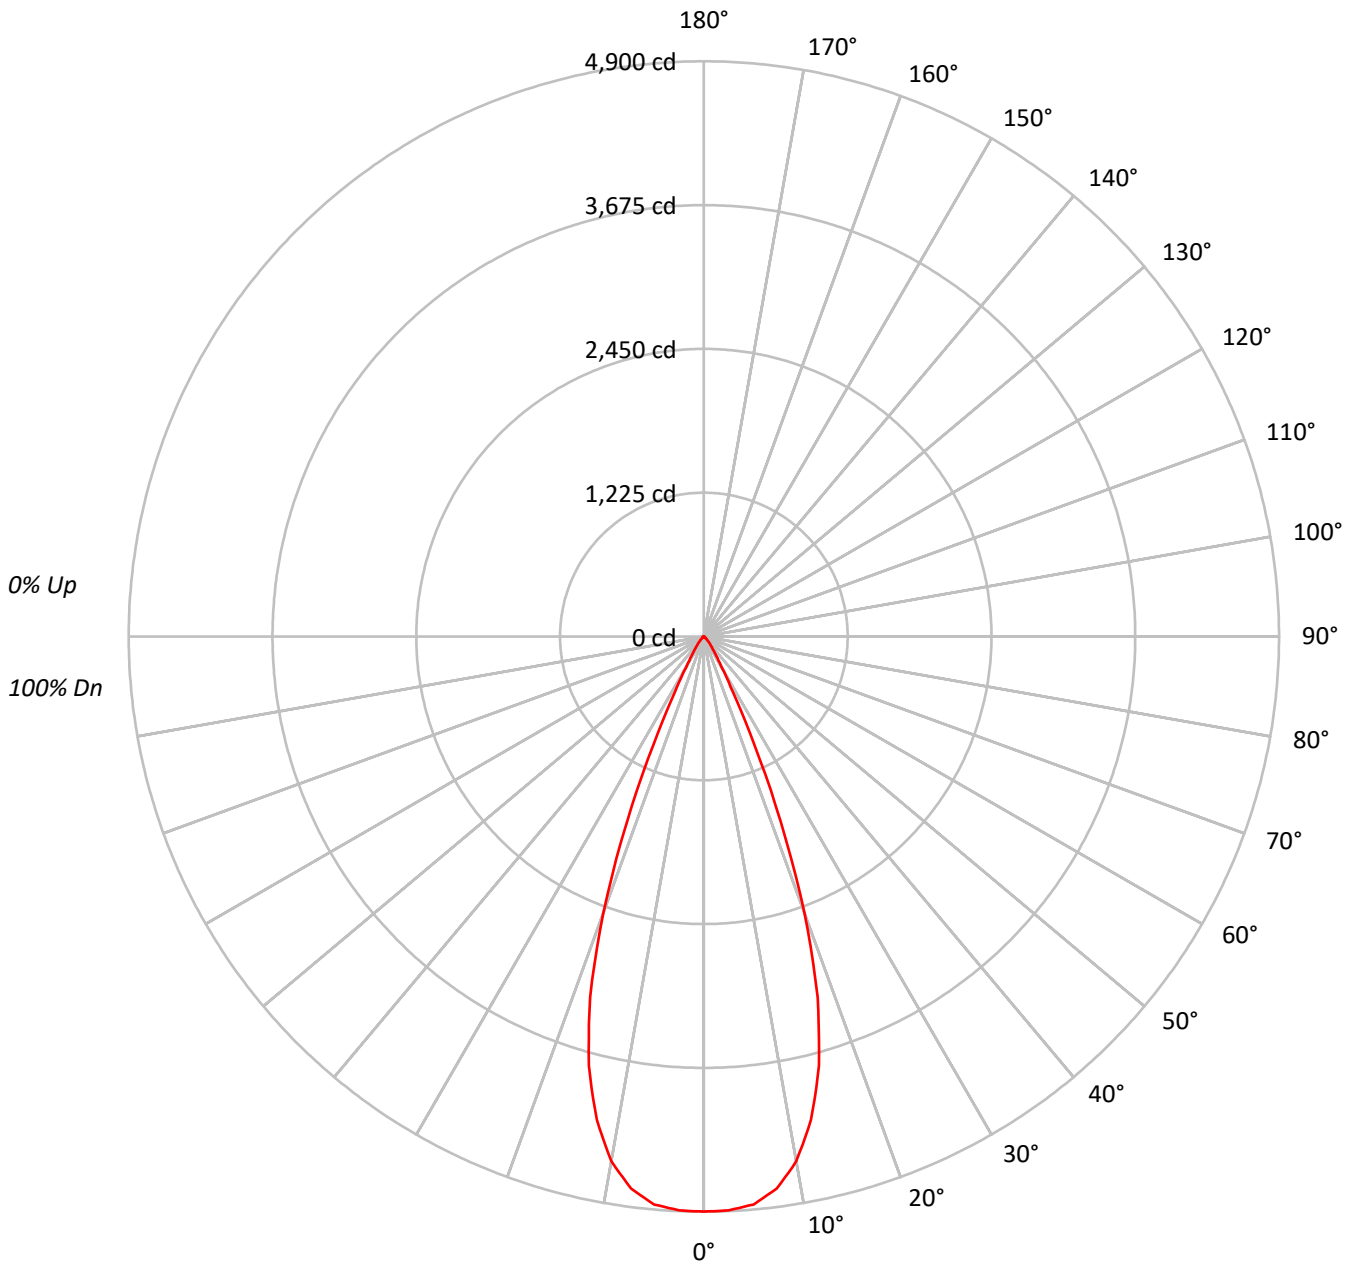



TEST NUMBER: P786425

CATALOG NUMBER: LERS6D10D010-EC6DR400210IC9035-6LBS1H

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	97	96	96	96	96
2	110	106	103	100	108	105	102	99	102	99	97	99	97	95	96	95	93	92	92	92	92
3	106	101	97	94	104	100	96	93	97	94	92	95	93	90	93	91	89	88	88	88	88
4	102	97	92	89	101	95	91	88	93	90	87	92	89	86	90	87	85	84	84	84	84
5	99	92	88	84	97	91	87	84	90	86	83	88	85	83	87	84	82	81	81	81	81
6	95	88	84	80	94	88	83	80	86	82	80	85	82	79	84	81	79	77	77	77	77
7	92	85	80	77	91	84	80	77	83	79	76	82	79	76	81	78	76	74	74	74	74
8	89	82	77	74	88	81	77	74	80	76	73	79	76	73	78	75	73	72	72	72	72
9	86	79	74	71	85	78	74	71	77	73	71	76	73	70	76	72	70	69	69	69	69
10	83	76	71	68	82	75	71	68	75	71	68	74	70	68	73	70	68	67	67	67	67

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	535323
5°	532718
10°	503541
15°	428073
20°	291764
25°	121737
30°	38278
35°	17793
40°	9841
45°	4512
50°	2193
55°	1200
60°	634
65°	233
70°	96
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 4512 cd/sqm



TEST NUMBER: P786425

CATALOG NUMBER: LERS6D10D010-EC6DR400210IC9035-6LBS1H

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	453.5	21.6
10°-20°	1016.0	48.3
20°-30°	508.6	24.2
30°-40°	93.2	4.4
40°-50°	25.7	1.2
50°-60°	6.1	0.3
60°-70°	1.2	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1978.2	94.0
0°-40°	2071.4	98.4
0°-60°	2103.2	99.9
0°-90°	2104.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2104.4	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	4900	
5°	4857	454
15°	3784	1016
25°	1010	509
35°	133	93
45°	29	26
55°	6	6
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P786425

CATALOG NUMBER: LERS6D10D010-EC6DR400210IC9035-6LBS1H

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	4899.5
2.5°	4892.3
5°	4857.1
7.5°	4744.9
10°	4538.6
12.5°	4216.9
15°	3784.4
17.5°	3222.0
20°	2509.3
22.5°	1710.7
25°	1009.8
27.5°	533.8
30°	303.4
32.5°	196.1
35°	133.4
37.5°	95.3
40°	69.0
42.5°	47.2
45°	29.2
47.5°	18.6
50°	12.9
52.5°	9.2
55°	6.3
57.5°	4.0
60°	2.9
62.5°	1.7
65°	0.9
67.5°	0.6
70°	0.3
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)