

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P786452

Luminaire Tested: LERS6D10D010-EC6DR450210IC9040-6LBS1B

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P786452
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LERS6D10D010-EC6DR450210IC9040-6LBS1B
Description: 6 INCH ROUND SHALLOW SPECULAR BLACK TRIM, WITH 45° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1987.0 lumens
Efficiency: N/A
Efficacy: 169.8 lumens/watt
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 11.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P786452

CATALOG NUMBER: LERS6D10D010-EC6DR450210IC9040-6LBS1B

Luminous Intensity Polar Plot

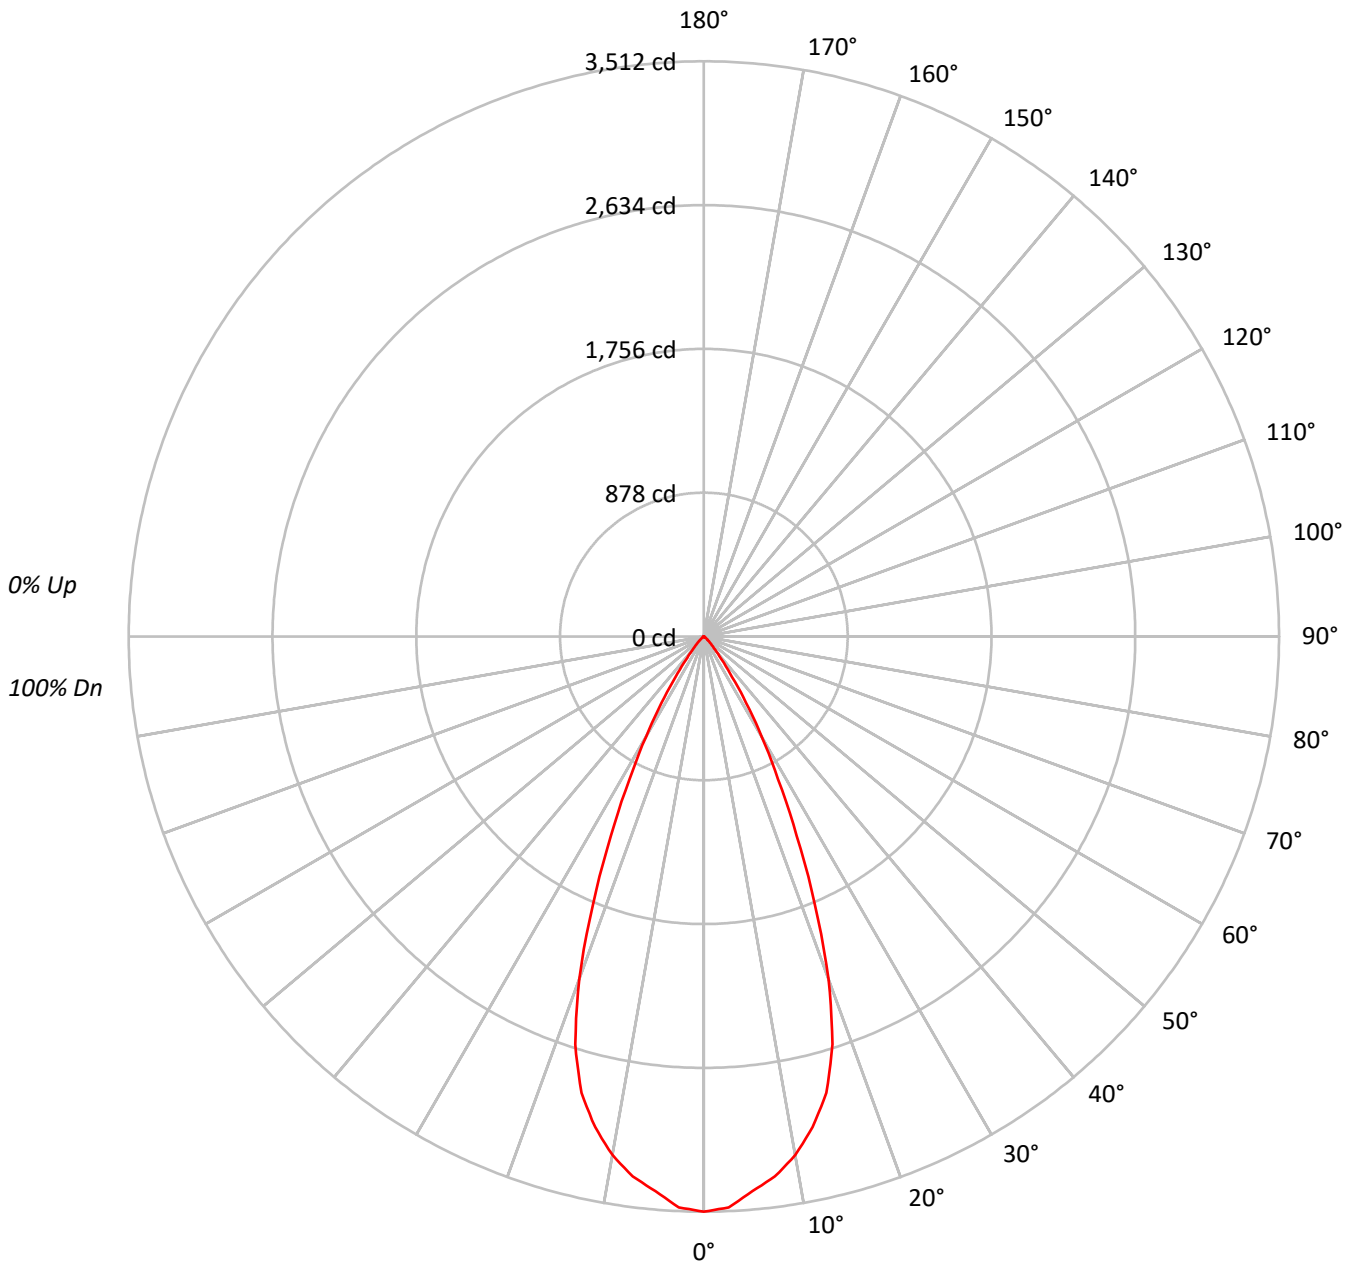



TEST NUMBER: P786452

CATALOG NUMBER: LERS6D10D010-EC6DR450210IC9040-6LBS1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95	95	95	95
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90	90	90	90
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85	85	85	85
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81	81	81	81
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77	77	77	77
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73	73	73	73
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69	69	69	69
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66	66	66	66
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63	63	63	63
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60	60	60	60

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	383724
5°	372796
10°	356670
15°	326427
20°	258975
25°	161678
30°	89109
35°	40015
40°	15761
45°	7432
50°	3519
55°	1848
60°	896
65°	207
70°	96
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 7432 cd/sqm



TEST NUMBER: P786452

CATALOG NUMBER: LERS6D10D010-EC6DR450210IC9040-6LBS1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	319.4	16.1
10°-20°	786.0	39.6
20°-30°	622.4	31.3
30°-40°	207.3	10.4
40°-50°	41.1	2.1
50°-60°	9.4	0.5
60°-70°	1.3	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1727.8	87.0
0°-40°	1935.1	97.4
0°-60°	1985.6	99.9
0°-90°	1987.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1987.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3512	
5°	3399	319
15°	2886	786
25°	1341	622
35°	300	207
45°	48	41
55°	10	9
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P786452

CATALOG NUMBER: LERS6D10D010-EC6DR450210IC9040-6LBS1B

CANDELA DISTRIBUTION (FULL):

	0°
0°	3512.0
2.5°	3489.1
5°	3399.0
7.5°	3324.7
10°	3214.8
12.5°	3068.4
15°	2885.8
17.5°	2611.2
20°	2227.3
22.5°	1769.8
25°	1341.1
27.5°	982.0
30°	706.3
32.5°	480.4
35°	300.0
37.5°	177.9
40°	110.5
42.5°	72.6
45°	48.1
47.5°	30.9
50°	20.7
52.5°	13.8
55°	9.7
57.5°	6.4
60°	4.1
62.5°	2.2
65°	0.8
67.5°	0.3
70°	0.3
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)