

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P786534

Luminaire Tested: LERS6D10D010-EC6DR650210IC9024-6LBS1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P786534
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-147)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LERS6D10D010-EC6DR650210IC9024-6LBS1LI
Description: 6 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1532.7 lumens
Efficiency: N/A
Efficacy: 131.0 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.96
Luminous Opening: Circular (Dia: 0.48' x H: 0')
CIE Type: Direct

Input Watts (W): 11.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P786534

CATALOG NUMBER: LERS6D10D010-EC6DR650210IC9024-6LBS1LI

Luminous Intensity Polar Plot

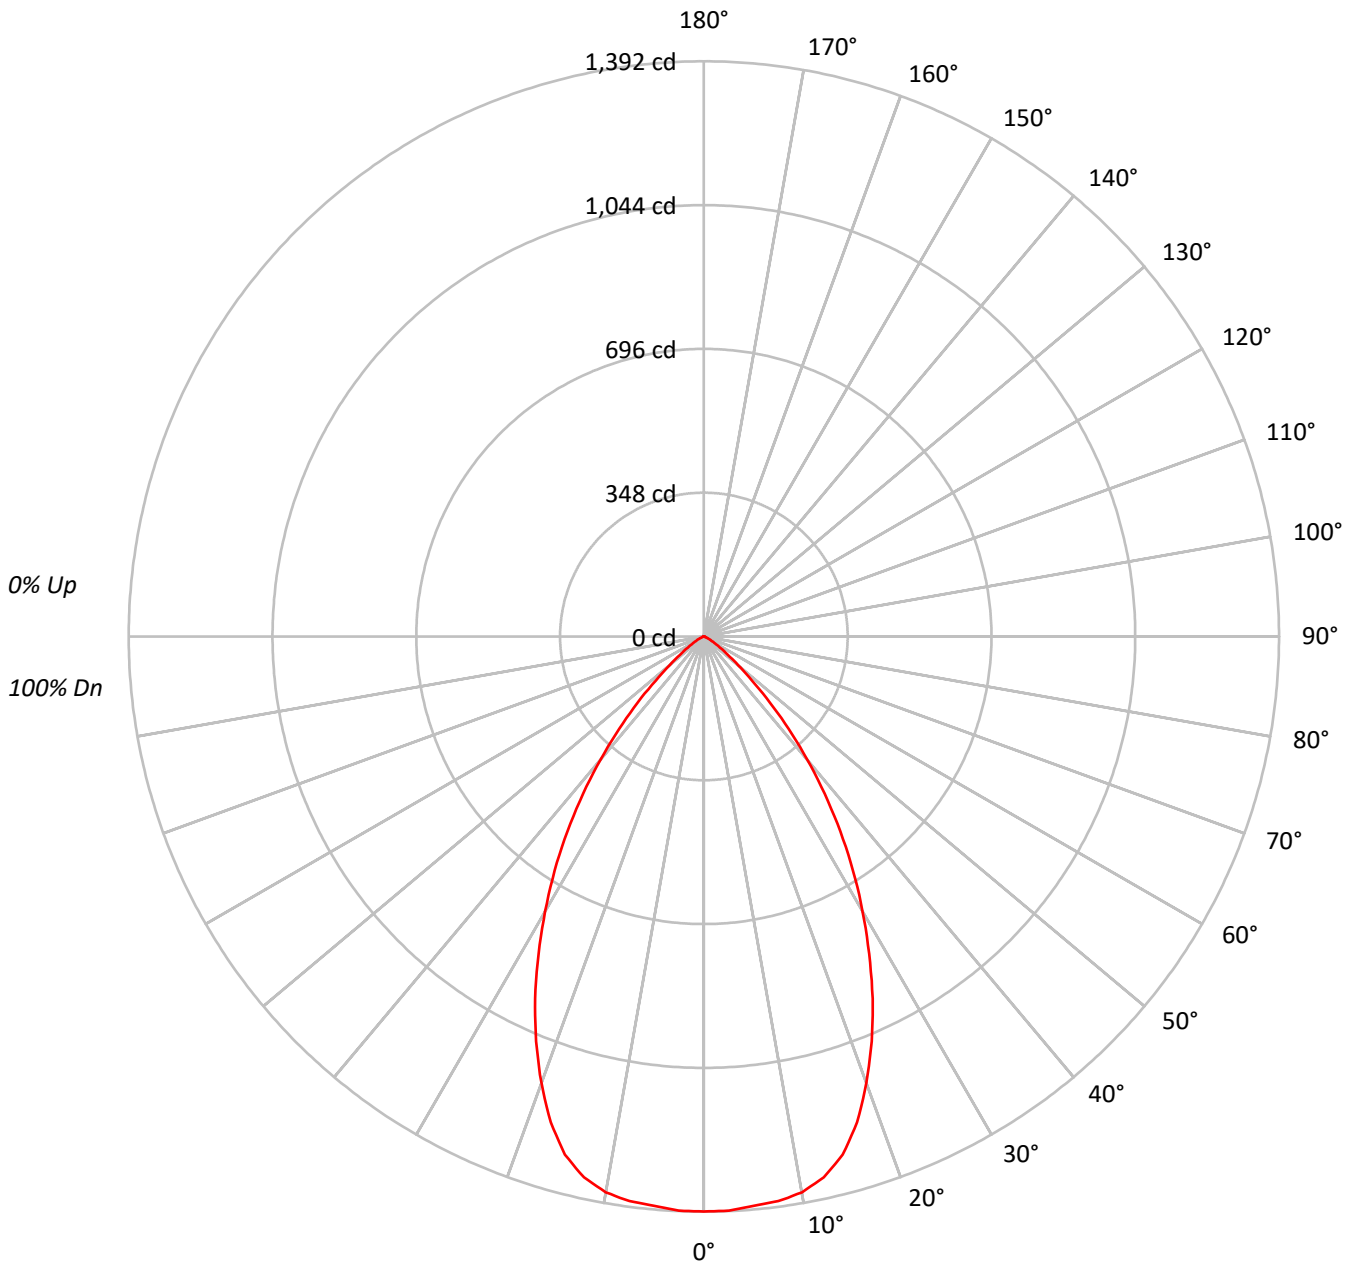



TEST NUMBER: P786534

CATALOG NUMBER: LERS6D10D010-EC6DR650210IC9024-6LBS1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100															
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	93				93															
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85				85															
3	101	94	88	84	99	92	87	83	90	86	82	87	84	81	85	82	80	78				78															
4	95	87	81	76	93	86	80	76	84	79	75	82	77	74	80	76	73	72				72															
5	90	81	74	70	88	80	74	69	78	73	69	76	72	68	75	71	68	66				66															
6	85	75	69	64	83	74	68	64	73	67	63	71	67	63	70	66	62	61				61															
7	80	70	64	59	79	69	63	59	68	63	59	67	62	58	66	61	58	56				56															
8	76	66	59	55	75	65	59	55	64	58	54	63	58	54	62	57	54	52				52															
9	72	61	55	51	71	61	55	51	60	54	51	59	54	50	58	54	50	49				49															
10	68	58	52	47	67	57	51	47	57	51	47	56	51	47	55	50	47	46				46															

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	81281
5°	81075
10°	81004
15°	78507
20°	71469
25°	62283
30°	51800
35°	41046
40°	29627
45°	18716
50°	9758
55°	5183
60°	2722
65°	1493
70°	632
75°	700
80°	471
85°	402

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 18716 cd/sqm



TEST NUMBER: P786534

CATALOG NUMBER: LERS6D10D010-EC6DR650210IC9024-6LBS1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	131.6	8.6
10°-20°	360.4	23.5
20°-30°	440.5	28.7
30°-40°	357.4	23.3
40°-50°	178.1	11.6
50°-60°	49.7	3.2
60°-70°	11.3	0.7
70°-80°	2.9	0.2
80°-90°	0.7	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	932.5	60.8
0°-40°	1290.0	84.2
0°-60°	1517.8	99.0
0°-90°	1532.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1532.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1392	
5°	1383	132
15°	1298	360
25°	966	441
35°	576	357
45°	227	178
55°	51	50
65°	11	11
75°	3	3
85°	1	1
90°	0	



TEST NUMBER: P786534

CATALOG NUMBER: LERS6D10D010-EC6DR650210IC9024-6LBS1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	1391.7
2.5°	1390.6
5°	1382.9
7.5°	1378.4
10°	1365.9
12.5°	1340.5
15°	1298.4
17.5°	1232.6
20°	1149.9
22.5°	1060.8
25°	966.5
27.5°	865.7
30°	768.1
32.5°	671.8
35°	575.7
37.5°	479.8
40°	388.6
42.5°	303.1
45°	226.6
47.5°	157.9
50°	107.4
52.5°	74.0
55°	50.9
57.5°	34.4
60°	23.3
62.5°	16.2
65°	10.8
67.5°	5.5
70°	3.7
72.5°	3.5
75°	3.1
77.5°	2.0
80°	1.4
82.5°	1.0
85°	0.6
87.5°	0.4
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)