

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P786632

Luminaire Tested: LERS6D15D010-EC6DR2015309027-6LBS1LI

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P786632  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-36)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LERS6D15D010-EC6DR2015309027-6LBS1LI  
Description: 6 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 20° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1584.1 lumens  
Efficiency: N/A  
Efficacy: 100.3 lumens/watt  
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.36  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct


Input Watts (W): 15.8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



Downlight

TEST NUMBER: P786632  
CATALOG NUMBER: LERS6D15D010-EC6DR2015309027-6LBS1LI

### Luminous Intensity Polar Plot

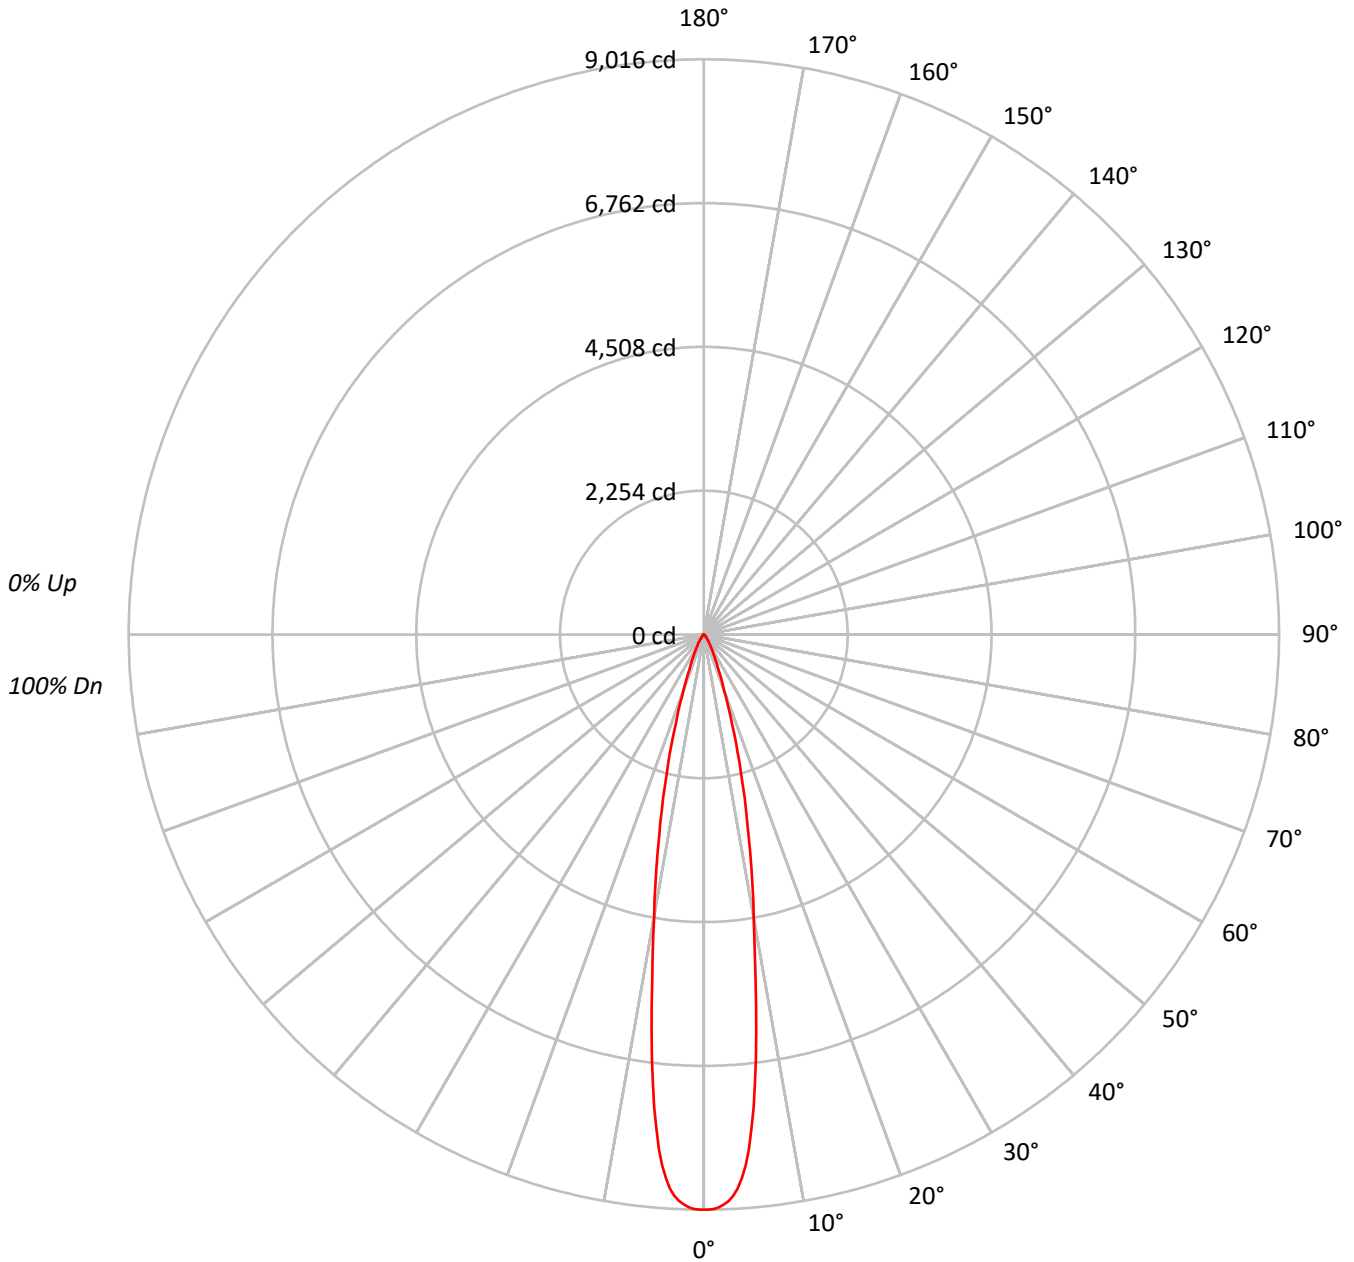



TEST NUMBER: P786632

CATALOG NUMBER: LERS6D15D010-EC6DR2015309027-6LBS1LI

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100																
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	97	97	98	97																
2	111	108	105	102	109	106	104	101	103	101	99	100	99	97	98	96	95	94	94	98	94																
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	93	92	91	91	95	91																
4	105	99	96	93	103	98	95	92	96	93	91	95	92	90	93	91	89	88	88	93	89																
5	102	96	92	89	100	95	91	89	94	90	88	92	89	87	91	88	86	85	85	91	86																
6	99	93	89	86	98	92	88	86	91	87	85	90	87	84	88	86	84	83	83	88	84																
7	96	90	86	83	95	89	86	83	88	85	82	87	84	82	86	84	82	81	81	86	82																
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	80	79	79	84	80																
9	91	85	81	78	91	85	81	78	84	80	78	83	80	78	82	80	78	77	77	82	78																
10	89	83	79	76	88	82	79	76	82	78	76	81	78	76	81	78	76	75	75	81	76																

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	985139
5°	888788
10°	498837
15°	253570
20°	107355
25°	49561
30°	26229
35°	14139
40°	7559
45°	4466
50°	2601
55°	1372
60°	874
65°	620
70°	256
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 4466 cd/sqm



TEST NUMBER: P786632

CATALOG NUMBER: LERS6D15D010-EC6DR2015309027-6LBS1LI

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	642.0	40.5
10°-20°	632.1	39.9
20°-30°	206.5	13.0
30°-40°	70.3	4.4
40°-50°	23.6	1.5
50°-60°	7.1	0.4
60°-70°	2.4	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1480.6	93.5
0°-40°	1550.9	97.9
0°-60°	1581.6	99.8
0°-90°	1584.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1584.1	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	9016	
5°	8104	642
15°	2242	632
25°	411	207
35°	106	70
45°	29	24
55°	7	7
65°	2	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P786632

CATALOG NUMBER: LERS6D15D010-EC6DR2015309027-6LBS1LI

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	9016.4
0.5°	9016.4
1°	9005.2
1.5°	8982.7
2°	8941.8
2.5°	8887.2
3°	8810.1
3.5°	8702.5
4°	8542.7
4.5°	8348.4
5°	8103.6
5.5°	7781.6
6°	7451.6
6.5°	7073.5
7°	6703.3
7.5°	6269.8
8°	5882.8
8.5°	5493.4
9°	5133.7
9.5°	4803.7
10°	4496.2
12.5°	3228.4
15°	2241.7
17.5°	1464.5
20°	923.3
22.5°	598.2
25°	411.1
27.5°	289.0
30°	207.9
32.5°	149.3
35°	106.0
37.5°	73.9
40°	53.0
42.5°	38.5
45°	28.9
47.5°	22.5
50°	15.3
52.5°	9.6
55°	7.2
57.5°	5.6
60°	4.0
62.5°	3.2
65°	2.4



TEST NUMBER: P786632

CATALOG NUMBER: LERS6D15D010-EC6DR2015309027-6LBS1LI

**CANDELA DISTRIBUTION (continued):**

	0°
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



67.5°		1.6
70°		0.8

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)