

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P786851

Luminaire Tested: LERS6D15D010-EC6DR650215IC9040-6LBS1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P786851
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-147)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LERS6D15D010-EC6DR650215IC9040-6LBS1MW
Description: 6 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2317.7 lumens
Efficiency: N/A
Efficacy: 146.7 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.96
Luminous Opening: Circular (Dia: 0.48' x H: 0')
CIE Type: Direct

Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P786851

CATALOG NUMBER: LERS6D15D010-EC6DR650215IC9040-6LBS1MW

Luminous Intensity Polar Plot

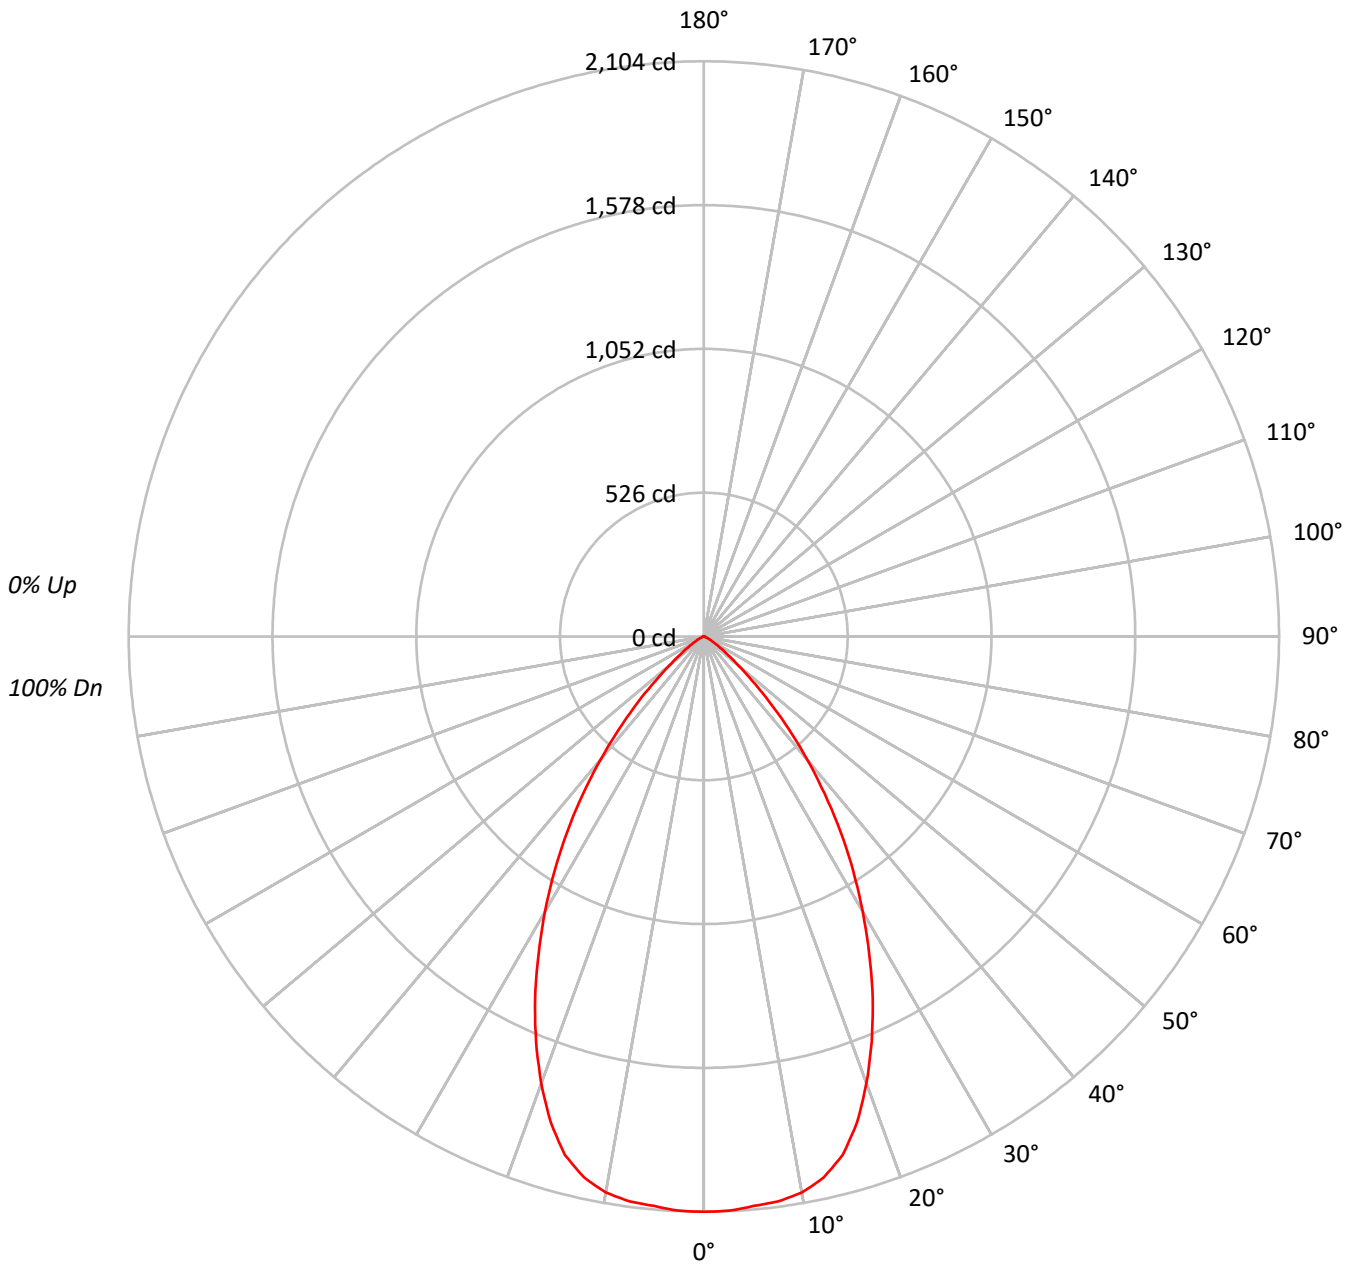



TEST NUMBER: P786851

CATALOG NUMBER: LERS6D15D010-EC6DR650215IC9040-6LBS1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	93																			
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85																			
3	101	94	88	84	99	92	87	83	90	86	82	87	84	81	85	82	80	78																			
4	95	87	81	76	93	86	80	76	84	79	75	82	77	74	80	76	73	72																			
5	90	81	74	70	88	80	74	69	78	73	69	76	72	68	75	71	68	66																			
6	85	75	69	64	83	74	68	64	73	67	63	71	67	63	70	66	62	61																			
7	80	70	64	59	79	69	63	59	68	63	59	67	62	58	66	61	58	56																			
8	76	66	59	55	75	65	59	55	64	58	54	63	58	54	62	57	54	52																			
9	72	61	55	51	71	61	55	51	60	54	51	59	54	50	58	54	50	49																			
10	68	58	52	47	67	57	51	47	57	51	47	56	51	47	55	50	47	46																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	122905
5°	122595
10°	122488
15°	118715
20°	108076
25°	94181
30°	78330
35°	62065
40°	44799
45°	28297
50°	14756
55°	7840
60°	4123
65°	2266
70°	956
75°	1038
80°	740
85°	603

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 28297 cd/sqm



TEST NUMBER: P786851

CATALOG NUMBER: LERS6D15D010-EC6DR650215IC9040-6LBS1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	199.0	8.6
10°-20°	545.0	23.5
20°-30°	666.1	28.7
30°-40°	540.5	23.3
40°-50°	269.3	11.6
50°-60°	75.1	3.2
60°-70°	17.1	0.7
70°-80°	4.5	0.2
80°-90°	1.1	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1410.1	60.8
0°-40°	1950.6	84.2
0°-60°	2295.0	99.0
0°-90°	2317.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2317.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2104	
5°	2091	199
15°	1963	545
25°	1462	666
35°	870	540
45°	343	269
55°	77	75
65°	16	17
75°	5	4
85°	1	1
90°	0	



TEST NUMBER: P786851

CATALOG NUMBER: LERS6D15D010-EC6DR650215IC9040-6LBS1MW

CANDELA DISTRIBUTION (FULL):

0°	
0°	2104.4
2.5°	2102.8
5°	2091.1
7.5°	2084.3
10°	2065.4
12.5°	2027.1
15°	1963.4
17.5°	1863.8
20°	1738.9
22.5°	1604.0
25°	1461.5
27.5°	1309.0
30°	1161.5
32.5°	1015.9
35°	870.5
37.5°	725.5
40°	587.6
42.5°	458.3
45°	342.6
47.5°	238.7
50°	162.4
52.5°	111.9
55°	77.0
57.5°	52.0
60°	35.3
62.5°	24.4
65°	16.4
67.5°	8.3
70°	5.6
72.5°	5.3
75°	4.6
77.5°	3.1
80°	2.2
82.5°	1.5
85°	0.9
87.5°	0.6
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)