

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P786934

Luminaire Tested: LER6D02D010-EC6DR150210IC9024-6LBS1MW

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P786934  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-21)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LER6D02D010-EC6DR150210IC9024-6LBS1MW  
Description: 6 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 15° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 319.4 lumens  
Efficiency: N/A  
Efficacy: 62.6 lumens/watt  
Spacing Criteria (0/90/45): 0.22 / 0.22 / 0.23  
Luminous Opening: Vertical Cylinder (Dia: 0.35' x H: 0.35')  
CIE Type: Direct

Input Watts (W): 5.1  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight

TEST NUMBER: P786934

CATALOG NUMBER: LER6D02D010-EC6DR150210IC9024-6LBS1MW

### Luminous Intensity Polar Plot

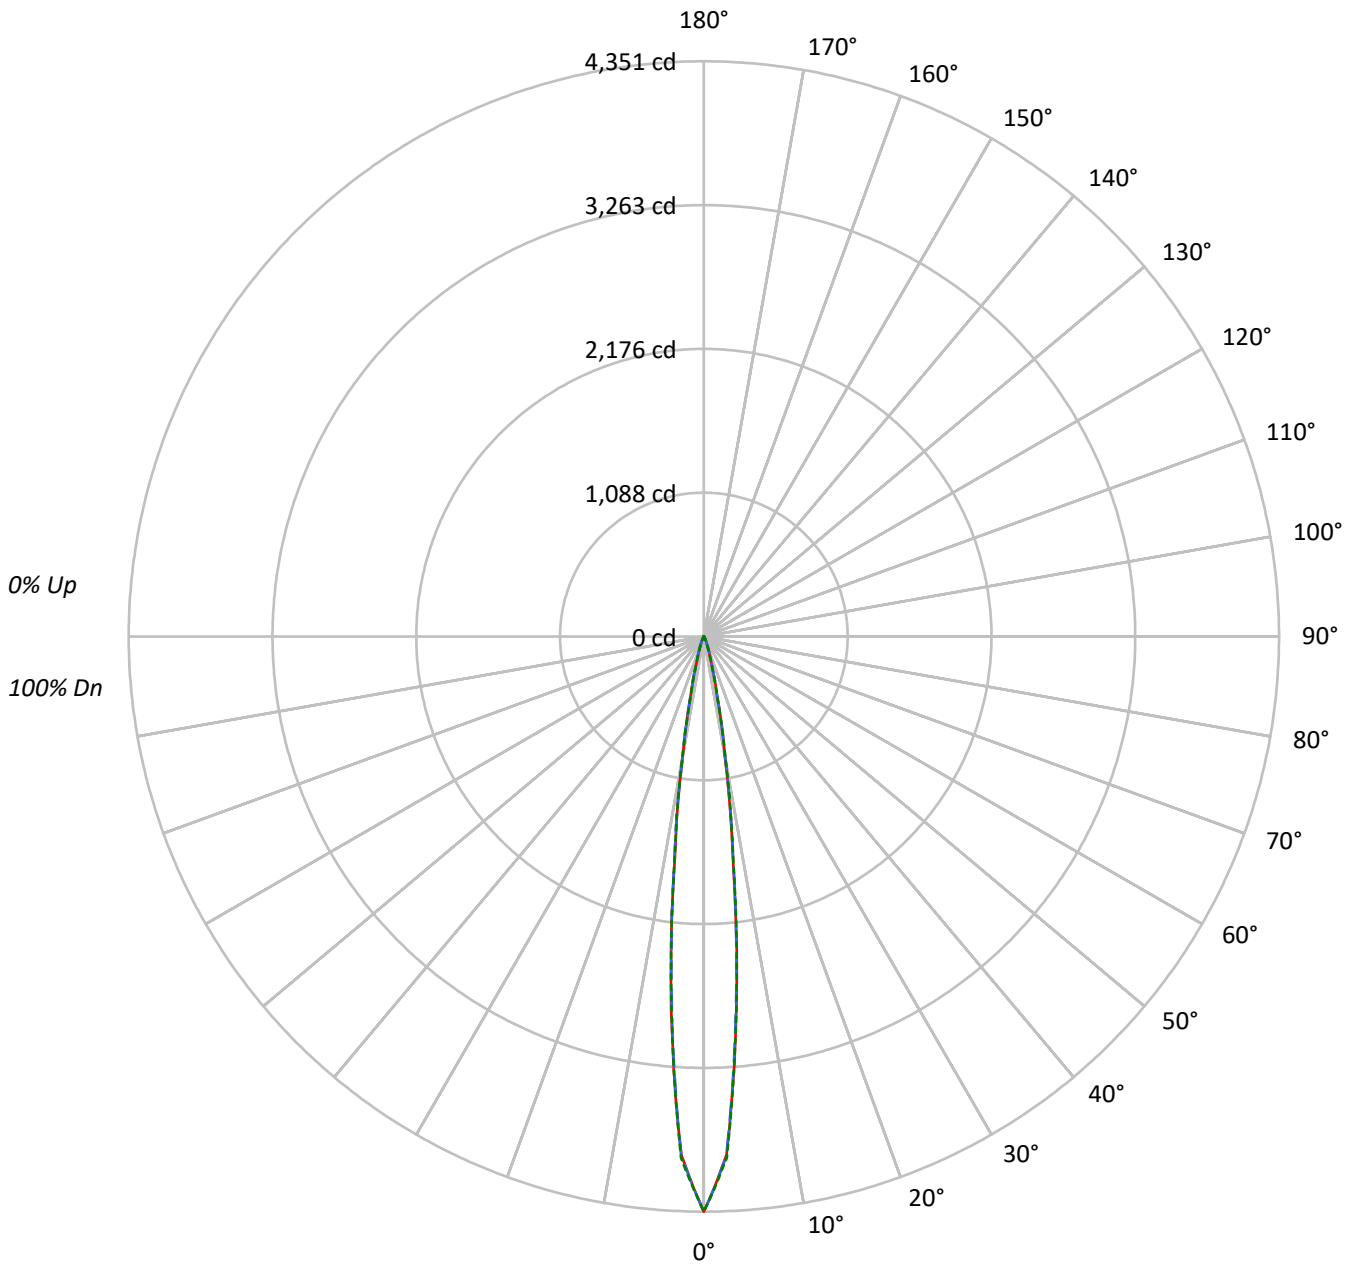



TEST NUMBER: P786934

CATALOG NUMBER: LER6D02D010-EC6DR150210IC9024-6LBS1MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	116	114	112	111	113	112	110	109	108	107	106	104	103	103	101	100	100	98						98													
2	113	110	107	105	111	108	106	104	105	103	102	102	101	100	100	98	98	96						96													
3	110	106	103	101	108	105	102	100	103	100	99	100	99	97	98	97	96	94						94													
4	108	103	100	98	106	102	99	97	100	98	96	99	97	95	97	95	94	93						93													
5	106	101	98	95	104	100	97	95	98	96	94	97	95	93	96	94	92	92						92													
6	104	99	95	93	102	98	95	93	97	94	92	96	93	92	95	93	91	90						90													
7	102	97	93	91	101	96	93	91	95	93	91	94	92	90	93	91	90	89						89													
8	100	95	92	90	99	95	92	90	94	91	89	93	91	89	92	90	89	88						88													
9	99	93	90	88	98	93	90	88	92	90	88	92	89	88	91	89	87	87						87													
10	97	92	89	87	96	92	89	87	91	89	87	91	88	87	90	88	86	86						86													

**AVERAGE LUMINANCE (cd/sqm):**

	0°	45°	90°
0°	489597	489597	489597
5°	287711	283982	286228
10°	85871	86468	87793
15°	21358	21775	21106
20°	6390	7397	6529
25°	2251	2867	2282
30°	831	1093	839
35°	414	465	399
40°	263	291	263
45°	196	203	196
50°	153	153	153
55°	125	125	125
60°	105	105	105
65°	79	79	79
70°	66	66	66
75°	45	45	53
80°	32	32	32
85°	17	17	17

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 45°

Vertical Angle: 45°

Luminance: 203 cd/sqm



TEST NUMBER: P786934

CATALOG NUMBER: LER6D02D010-EC6DR150210IC9024-6LBS1MW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	207.1	64.8
10°-20°	85.2	26.7
20°-30°	16.9	5.3
30°-40°	4.2	1.3
40°-50°	2.2	0.7
50°-60°	1.6	0.5
60°-70°	1.2	0.4
70°-80°	0.7	0.2
80°-90°	0.2	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	309.2	96.8
0°-40°	313.5	98.1
0°-60°	317.3	99.4
0°-90°	319.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	319.4	100.0

**CANDELA DISTRIBUTION:**

	0°	22.5°	45°	67.5°	90°	Flux
0°	4351	4351	4351	4351	4351	
5°	2831	2802	2794	2814	2816	207
15°	246	250	251	246	243	84
25°	29	33	37	33	29	15
35°	6	6	6	6	6	4
45°	3	3	3	3	3	2
55°	2	2	2	2	2	2
65°	1	1	1	1	1	1
75°	1	1	1	1	1	1
85°	0	0	0	0	0	0
90°	0	0	0	0	0	



TEST NUMBER: P786934

CATALOG NUMBER: LER6D02D010-EC6DR150210IC9024-6LBS1MW

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°
0°	4351.2	4351.2	4351.2	4351.2	4351.2
2.5°	3925.0	3928.3	3929.6	3933.4	3947.8
5°	2831.0	2801.9	2794.3	2813.7	2816.4
7.5°	1677.0	1682.9	1704.4	1709.2	1691.9
10°	920.3	927.8	926.7	933.4	940.9
12.5°	470.6	464.7	462.9	470.5	460.0
15°	245.9	250.5	250.7	246.3	243.0
17.5°	132.3	137.6	146.4	139.3	128.2
20°	78.1	82.9	90.4	84.5	79.8
22.5°	48.3	52.1	57.5	52.9	49.0
25°	28.9	32.8	36.8	32.6	29.3
27.5°	17.1	20.4	23.0	20.3	16.9
30°	11.1	12.9	14.6	12.7	11.2
32.5°	7.7	8.5	9.2	8.5	7.7
35°	5.7	6.1	6.4	6.1	5.5
37.5°	4.4	4.8	5.0	4.6	4.2
40°	3.7	3.9	4.1	3.9	3.7
42.5°	3.1	3.3	3.3	3.3	3.1
45°	2.8	2.8	2.9	2.8	2.8
47.5°	2.4	2.4	2.6	2.4	2.4
50°	2.2	2.2	2.2	2.2	2.2
52.5°	2.0	2.0	2.0	2.0	2.0
55°	1.8	1.8	1.8	1.8	1.8
57.5°	1.7	1.7	1.7	1.7	1.7
60°	1.5	1.5	1.5	1.5	1.5
62.5°	1.3	1.3	1.3	1.3	1.3
65°	1.1	1.1	1.1	1.1	1.1
67.5°	1.1	1.1	1.1	1.1	1.1
70°	0.9	0.9	0.9	0.9	0.9
72.5°	0.7	0.7	0.7	0.7	0.7
75°	0.6	0.6	0.6	0.6	0.7
77.5°	0.6	0.6	0.6	0.6	0.6
80°	0.4	0.4	0.4	0.4	0.4
82.5°	0.4	0.4	0.4	0.4	0.4
85°	0.2	0.2	0.2	0.2	0.2
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report







— 0°-180°    - - 45°-225°    - - - - 90°-270°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)