

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P786941

Luminaire Tested: LER6D02D010-EC6DR150210IC9027-6LBS1LI

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P786941  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-21)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LER6D02D010-EC6DR150210IC9027-6LBS1LI  
Description: 6 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 15° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 391.9 lumens  
Efficiency: N/A  
Efficacy: 76.8 lumens/watt  
Spacing Criteria (0/90/45): 0.22 / 0.22 / 0.23  
Luminous Opening: Vertical Cylinder (Dia: 0.35' x H: 0.35')  
CIE Type: Direct


Input Watts (W): 5.1  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



Downlight

TEST NUMBER: P786941  
CATALOG NUMBER: LER6D02D010-EC6DR150210IC9027-6LBS1LI

### Luminous Intensity Polar Plot

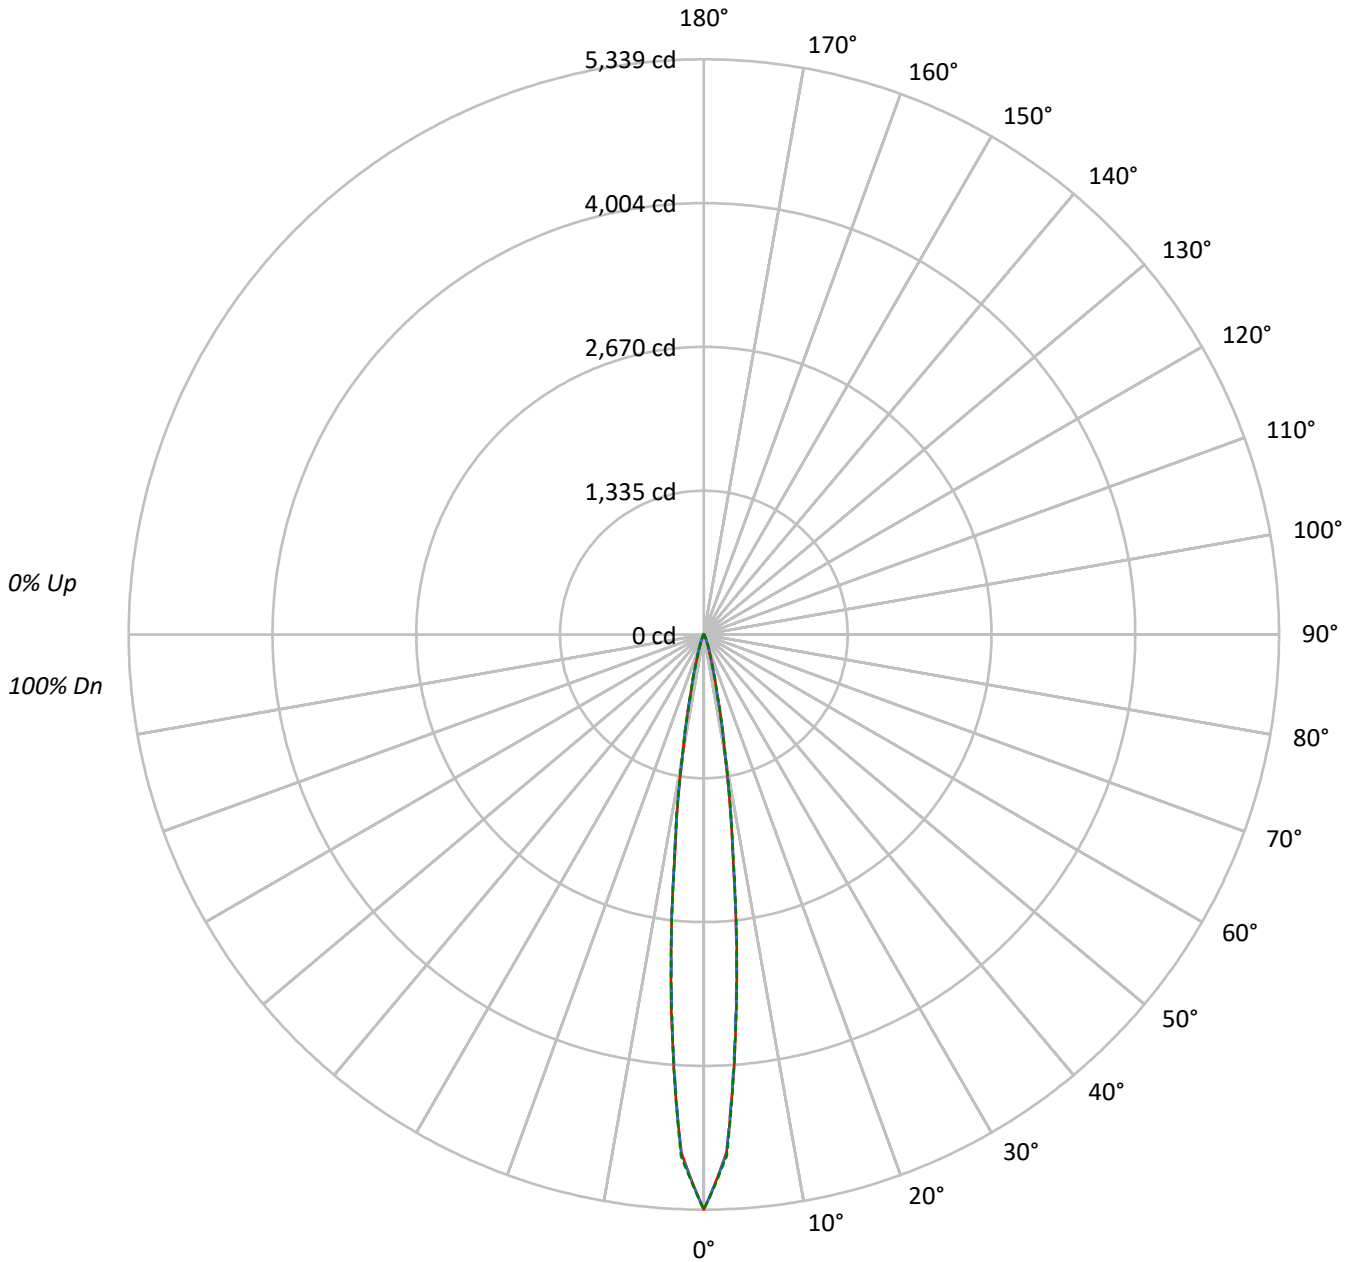



TEST NUMBER: P786941

CATALOG NUMBER: LER6D02D010-EC6DR150210IC9027-6LBS1LI

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	116	114	112	111	113	112	110	109	108	107	106	104	103	103	101	100	100	98						98													
2	113	110	107	105	111	108	106	104	105	103	102	102	101	100	100	98	98	96						96													
3	110	106	103	101	108	105	102	100	103	100	99	100	99	97	98	97	96	94						94													
4	108	103	100	98	106	102	99	97	100	98	96	99	97	95	97	95	94	93						93													
5	106	101	98	95	104	100	97	95	98	96	94	97	95	93	96	94	92	92						92													
6	104	99	95	93	102	98	95	93	97	94	92	96	93	92	95	93	91	90						90													
7	102	97	93	91	101	96	93	91	95	93	91	94	92	90	93	91	90	89						89													
8	100	95	92	90	99	95	92	90	94	91	89	93	91	89	92	90	89	88						88													
9	99	93	90	88	98	93	90	88	92	90	88	92	89	88	91	89	87	87						87													
10	97	92	89	87	96	92	89	87	91	89	87	91	88	87	90	88	86	86						86													

**AVERAGE LUMINANCE (cd/sqm):**

	0°	45°	90°
0°	600710	600710	600710
5°	352998	348435	351189
10°	105354	106091	107714
15°	26205	26717	25892
20°	7839	9082	8010
25°	2765	3521	2797
30°	1018	1340	1033
35°	508	574	494
40°	320	355	320
45°	238	252	238
50°	188	188	188
55°	160	160	160
60°	126	126	126
65°	100	100	100
70°	80	80	80
75°	53	53	68
80°	39	39	39
85°	17	17	17

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 45°

Vertical Angle: 45°

Luminance: 252 cd/sqm



TEST NUMBER: P786941

CATALOG NUMBER: LER6D02D010-EC6DR150210IC9027-6LBS1LI

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	254.1	64.8
10°-20°	104.5	26.7
20°-30°	20.8	5.3
30°-40°	5.2	1.3
40°-50°	2.7	0.7
50°-60°	2.0	0.5
60°-70°	1.4	0.4
70°-80°	0.8	0.2
80°-90°	0.3	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	379.4	96.8
0°-40°	384.6	98.1
0°-60°	389.4	99.4
0°-90°	391.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	391.9	100.0

**CANDELA DISTRIBUTION:**

	0°	22.5°	45°	67.5°	90°	Flux
0°	5339	5339	5339	5339	5339	
5°	3473	3438	3428	3452	3456	254
15°	302	307	308	302	298	103
25°	36	40	45	40	36	19
35°	7	8	8	8	7	5
45°	3	3	4	3	3	3
55°	2	2	2	2	2	2
65°	1	1	1	1	1	1
75°	1	1	1	1	1	1
85°	0	0	0	0	0	0
90°	0	0	0	0	0	0



TEST NUMBER: P786941

CATALOG NUMBER: LER6D02D010-EC6DR150210IC9027-6LBS1LI

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°
0°	5338.7	5338.7	5338.7	5338.7	5338.7
2.5°	4815.7	4819.8	4821.3	4826.1	4843.7
5°	3473.4	3437.7	3428.5	3452.2	3455.6
7.5°	2057.5	2064.8	2091.2	2097.1	2075.8
10°	1129.1	1138.4	1137.0	1145.2	1154.4
12.5°	577.4	570.2	567.9	577.2	564.3
15°	301.7	307.4	307.6	302.2	298.1
17.5°	162.3	168.8	179.7	170.9	157.3
20°	95.8	101.7	111.0	103.7	97.9
22.5°	59.2	64.0	70.5	64.9	60.1
25°	35.5	40.2	45.2	40.0	35.9
27.5°	21.0	25.1	28.3	24.9	20.8
30°	13.6	15.8	17.9	15.6	13.8
32.5°	9.5	10.4	11.3	10.4	9.5
35°	7.0	7.5	7.9	7.5	6.8
37.5°	5.4	5.9	6.1	5.7	5.2
40°	4.5	4.7	5.0	4.7	4.5
42.5°	3.8	4.1	4.1	4.1	3.8
45°	3.4	3.4	3.6	3.4	3.4
47.5°	2.9	2.9	3.2	2.9	2.9
50°	2.7	2.7	2.7	2.7	2.7
52.5°	2.5	2.5	2.5	2.5	2.5
55°	2.3	2.3	2.3	2.3	2.3
57.5°	2.0	2.0	2.0	2.0	2.0
60°	1.8	1.8	1.8	1.8	1.8
62.5°	1.6	1.6	1.6	1.6	1.6
65°	1.4	1.4	1.4	1.4	1.4
67.5°	1.4	1.4	1.4	1.4	1.4
70°	1.1	1.1	1.1	1.1	1.1
72.5°	0.9	0.9	0.9	0.9	0.9
75°	0.7	0.7	0.7	0.7	0.9
77.5°	0.7	0.7	0.7	0.7	0.7
80°	0.5	0.5	0.5	0.5	0.5
82.5°	0.5	0.5	0.5	0.5	0.5
85°	0.2	0.2	0.2	0.2	0.2
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report







— 0°-180°    - - 45°-225°    - - - - 90°-270°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)