

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P786981

Luminaire Tested: LER6D02D010-EC6DR200210IC9024-6LBS1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P786981
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D02D010-EC6DR200210IC9024-6LBS1LI
Description: 6 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 20° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 370.4 lumens
Efficiency: N/A
Efficacy: 72.6 lumens/watt
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.36
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 5.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P786981

CATALOG NUMBER: LER6D02D010-EC6DR200210IC9024-6LBS1LI

Luminous Intensity Polar Plot

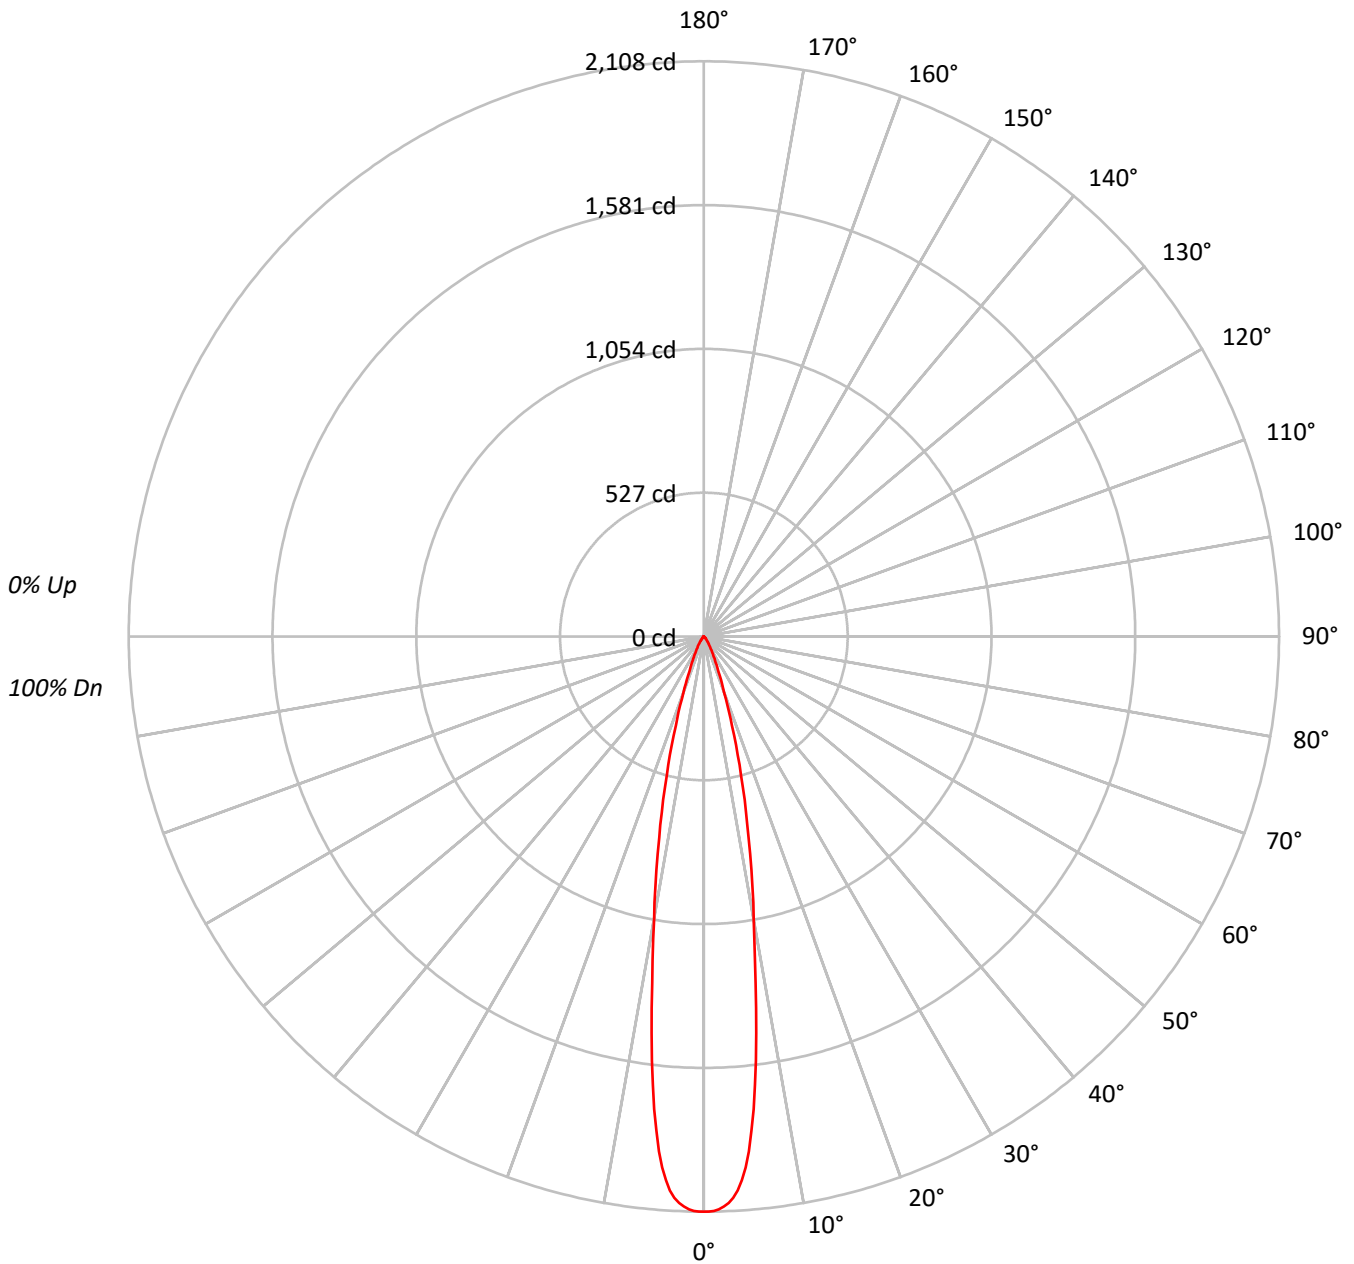



TEST NUMBER: P786981

CATALOG NUMBER: LER6D02D010-EC6DR200210IC9024-6LBS1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100																
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	97	97	98	97																
2	111	108	105	102	109	106	104	101	103	101	99	100	99	97	98	96	95	94	98	96	95																
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	93	92	91	95	93	92																
4	105	99	96	93	103	98	95	92	96	93	91	95	92	90	93	91	89	88	93	91	89																
5	102	96	92	89	100	95	91	89	93	90	88	92	89	87	91	88	86	85	91	88	86																
6	99	93	89	86	98	92	88	86	91	87	85	90	87	84	88	86	84	83	88	86	84																
7	96	90	86	83	95	89	86	83	88	85	82	87	84	82	86	84	82	81	86	84	82																
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	80	79	84	82	80																
9	91	85	81	78	91	85	81	78	84	80	78	83	80	78	82	80	78	77	82	80	78																
10	89	83	79	76	88	82	79	76	82	78	76	81	78	76	81	78	76	75	81	78	76																

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	230322
5°	207796
10°	116627
15°	59284
20°	25103
25°	11585
30°	6132
35°	3308
40°	1769
45°	1051
50°	612
55°	324
60°	197
65°	155
70°	64
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 1051 cd/sqm



TEST NUMBER: P786981

CATALOG NUMBER: LER6D02D010-EC6DR200210IC9024-6LBS1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	150.1	40.5
10°-20°	147.8	39.9
20°-30°	48.3	13.0
30°-40°	16.4	4.4
40°-50°	5.5	1.5
50°-60°	1.7	0.5
60°-70°	0.6	0.2
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	346.2	93.4
0°-40°	362.6	97.9
0°-60°	369.8	99.8
0°-90°	370.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	370.4	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2108	
5°	1895	150
15°	524	148
25°	96	48
35°	25	16
45°	7	6
55°	2	2
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P786981

CATALOG NUMBER: LER6D02D010-EC6DR200210IC9024-6LBS1LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	2108.0
0.5°	2108.0
1°	2105.4
1.5°	2100.1
2°	2090.5
2.5°	2077.8
3°	2059.7
3.5°	2034.6
4°	1997.2
4.5°	1951.8
5°	1894.6
5.5°	1819.3
6°	1742.1
6.5°	1653.7
7°	1567.2
7.5°	1465.8
8°	1375.4
8.5°	1284.3
9°	1200.2
9.5°	1123.1
10°	1051.2
12.5°	754.8
15°	524.1
17.5°	342.4
20°	215.9
22.5°	139.8
25°	96.1
27.5°	67.6
30°	48.6
32.5°	34.9
35°	24.8
37.5°	17.3
40°	12.4
42.5°	9.0
45°	6.8
47.5°	5.3
50°	3.6
52.5°	2.3
55°	1.7
57.5°	1.3
60°	0.9
62.5°	0.8
65°	0.6



TEST NUMBER: P786981
CATALOG NUMBER: LER6D02D010-EC6DR200210IC9024-6LBS1LI

CANDELA DISTRIBUTION (continued):

	0°
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



67.5°		0.4
70°		0.2

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)