

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P787012

Luminaire Tested: LER6D02D010-EC6DR200210IC9040-6LBS1H

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P787012
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D02D010-EC6DR200210IC9040-6LBS1H
Description: 6 INCH ROUND SHALLOW SEMI-SPECULAR CLEAR TRIM, WITH 20° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 438.6 lumens
Efficiency: N/A
Efficacy: 86.0 lumens/watt
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.36
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 5.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P787012
CATALOG NUMBER: LER6D02D010-EC6DR200210IC9040-6LBS1H

Luminous Intensity Polar Plot

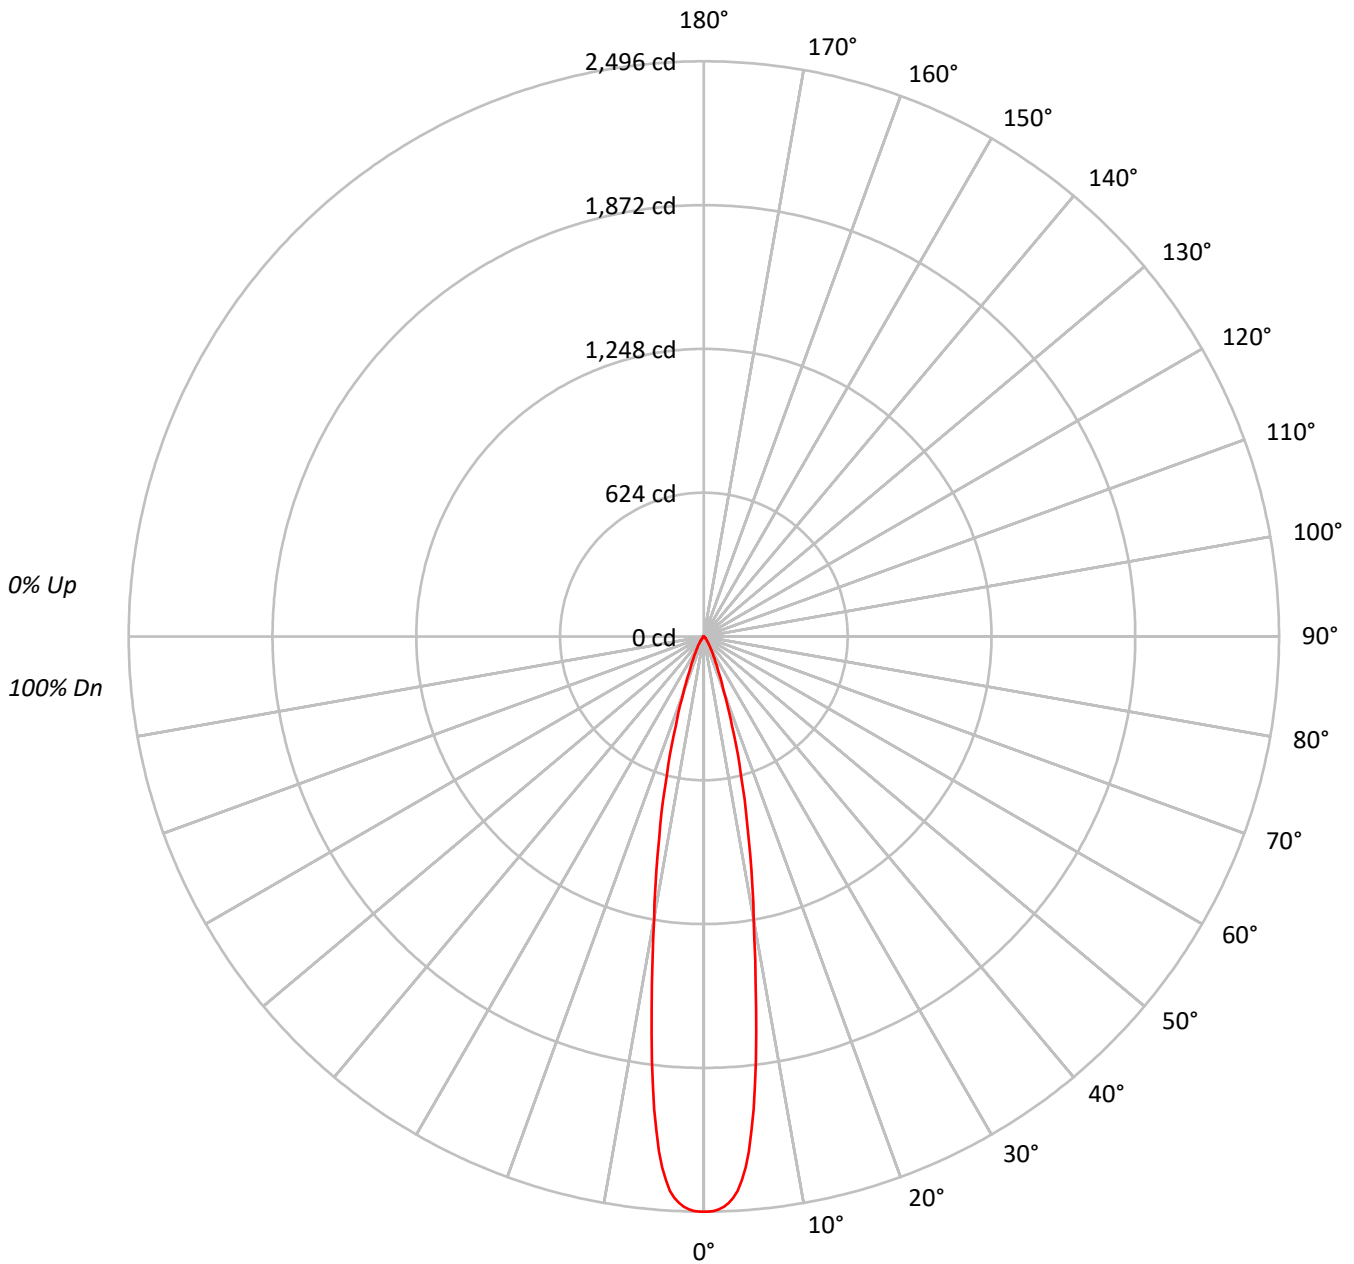



TEST NUMBER: P787012

CATALOG NUMBER: LER6D02D010-EC6DR200210IC9040-6LBS1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	100	99	98	97	98	96	95	94												
2	111	108	105	102	109	106	104	101	103	101	99	100	99	97	98	96	95	98	96	95	94	93	92	91	94												
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	93	92	98	96	95	94	93	92	91	94												
4	105	99	96	93	103	98	95	92	96	93	91	95	92	90	93	91	89	98	96	95	94	93	92	91	88												
5	102	96	92	89	100	95	91	89	94	90	88	92	89	87	91	88	86	98	96	95	94	93	92	91	85												
6	99	93	89	86	98	92	88	86	91	87	85	90	87	84	88	86	84	98	96	95	94	93	92	91	83												
7	96	90	86	83	95	89	86	83	88	85	82	87	84	82	86	84	82	98	96	95	94	93	92	91	81												
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	80	98	96	95	94	93	92	91	79												
9	91	85	81	78	91	85	81	78	84	80	78	83	80	78	82	80	78	98	96	95	94	93	92	91	77												
10	89	83	79	76	88	82	79	76	82	78	76	81	78	76	81	78	76	98	96	95	94	93	92	91	75												

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	272759
5°	246085
10°	138117
15°	70211
20°	29719
25°	13719
30°	7267
35°	3908
40°	2097
45°	1236
50°	714
55°	381
60°	240
65°	181
70°	64
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 1236 cd/sqm



TEST NUMBER: P787012

CATALOG NUMBER: LER6D02D010-EC6DR200210IC9040-6LBS1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	177.7	40.5
10°-20°	175.0	39.9
20°-30°	57.2	13.0
30°-40°	19.5	4.4
40°-50°	6.5	1.5
50°-60°	2.0	0.5
60°-70°	0.7	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	409.9	93.5
0°-40°	429.4	97.9
0°-60°	437.9	99.8
0°-90°	438.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	438.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2496	
5°	2244	178
15°	621	175
25°	114	57
35°	29	19
45°	8	7
55°	2	2
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P787012

CATALOG NUMBER: LER6D02D010-EC6DR200210IC9040-6LBS1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	2496.4
0.5°	2496.4
1°	2493.3
1.5°	2487.1
2°	2475.8
2.5°	2460.7
3°	2439.3
3.5°	2409.5
4°	2365.3
4.5°	2311.5
5°	2243.7
5.5°	2154.5
6°	2063.2
6.5°	1958.5
7°	1856.0
7.5°	1736.0
8°	1628.8
8.5°	1521.0
9°	1421.4
9.5°	1330.0
10°	1244.9
12.5°	893.9
15°	620.7
17.5°	405.5
20°	255.6
22.5°	165.6
25°	113.8
27.5°	80.0
30°	57.6
32.5°	41.3
35°	29.3
37.5°	20.5
40°	14.7
42.5°	10.7
45°	8.0
47.5°	6.2
50°	4.2
52.5°	2.7
55°	2.0
57.5°	1.6
60°	1.1
62.5°	0.9
65°	0.7



TEST NUMBER: P787012

CATALOG NUMBER: LER6D02D010-EC6DR200210IC9040-6LBS1H

CANDELA DISTRIBUTION (continued):

	0°
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



67.5°		0.4
70°		0.2

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)