

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P787248

Luminaire Tested: LER6D02D010-EC6DR450210IC9040-6LBDP1H

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P787248  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LER6D02D010-EC6DR450210IC9040-6LBDP1H  
Description: 6 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 45° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 702.9 lumens  
Efficiency: N/A  
Efficacy: 137.8 lumens/watt  
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 5.1  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight

TEST NUMBER: P787248

CATALOG NUMBER: LER6D02D010-EC6DR450210IC9040-6LBDP1H

### Luminous Intensity Polar Plot

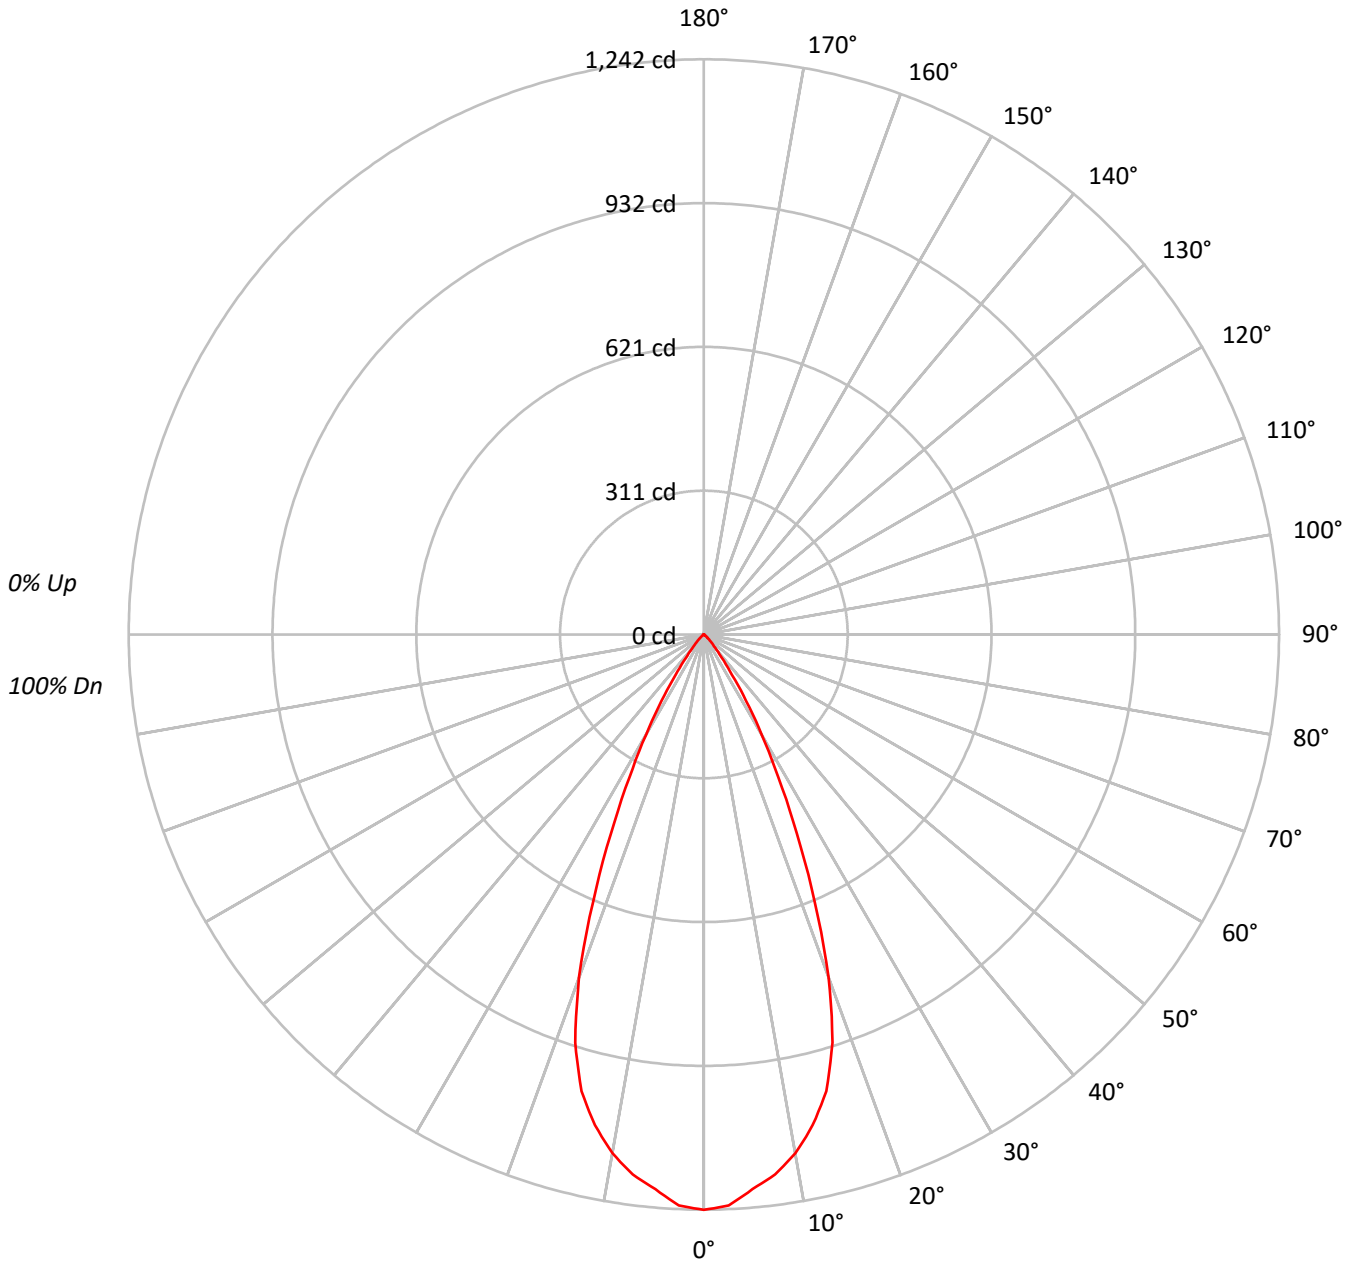



TEST NUMBER: P787248

CATALOG NUMBER: LER6D02D010-EC6DR450210IC9040-6LBDP1H

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95	95	95	95
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90	90	90	90
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85	85	85	85
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81	81	81	81
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77	77	77	77
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73	73	73	73
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69	69	69	69
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66	66	66	66
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63	63	63	63
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60	60	60	60

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	135746
5°	131877
10°	126179
15°	115479
20°	91611
25°	57192
30°	31528
35°	14152
40°	5577
45°	2627
50°	1241
55°	648
60°	328
65°	78
70°	32
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 2627 cd/sqm



TEST NUMBER: P787248

CATALOG NUMBER: LER6D02D010-EC6DR450210IC9040-6LBDP1H

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	113.0	16.1
10°-20°	278.1	39.6
20°-30°	220.2	31.3
30°-40°	73.3	10.4
40°-50°	14.5	2.1
50°-60°	3.3	0.5
60°-70°	0.5	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	611.2	87.0
0°-40°	684.5	97.4
0°-60°	702.4	99.9
0°-90°	702.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	702.9	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1242	
5°	1202	113
15°	1021	278
25°	474	220
35°	106	73
45°	17	15
55°	3	3
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P787248

CATALOG NUMBER: LER6D02D010-EC6DR450210IC9040-6LBDP1H

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	1242.4
2.5°	1234.3
5°	1202.4
7.5°	1176.1
10°	1137.3
12.5°	1085.5
15°	1020.9
17.5°	923.7
20°	787.9
22.5°	626.1
25°	474.4
27.5°	347.4
30°	249.9
32.5°	169.9
35°	106.1
37.5°	62.9
40°	39.1
42.5°	25.7
45°	17.0
47.5°	10.9
50°	7.3
52.5°	4.9
55°	3.4
57.5°	2.2
60°	1.5
62.5°	0.8
65°	0.3
67.5°	0.1
70°	0.1
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)