

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P787417

Luminaire Tested: LER6D02D010-EC6DR650210IC9027-6LBDP1LI

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P787417
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D02D010-EC6DR650210IC9027-6LBDP1LI
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 563.7 lumens
Efficiency: N/A
Efficacy: 110.5 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 5.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P787417
CATALOG NUMBER: LER6D02D010-EC6DR650210IC9027-6LBDP1LI

Luminous Intensity Polar Plot

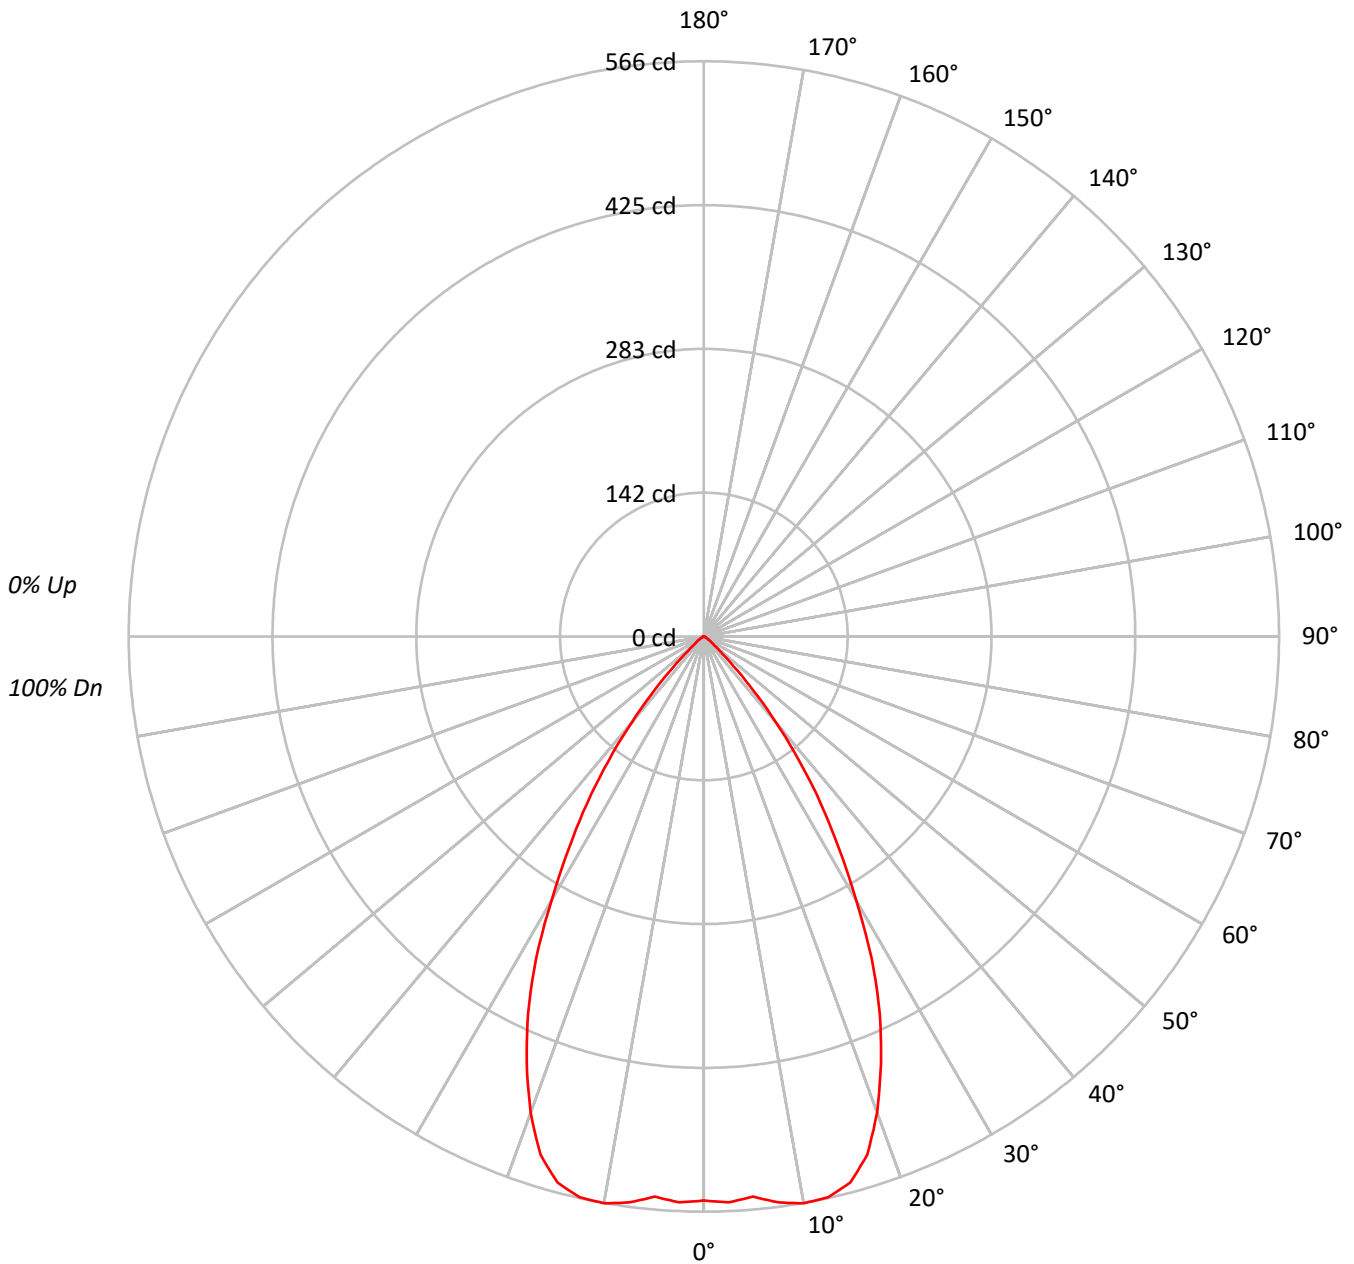



TEST NUMBER: P787417

CATALOG NUMBER: LER6D02D010-EC6DR650210IC9027-6LBDP1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20	
RC	80					70					50					30					10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93				
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87				
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80				
4	97	89	84	79	95	88	83	79	86	82	78	84	80	77	82	79	76	75				
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69				
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65				
7	83	73	67	63	81	73	67	63	71	66	62	70	66	62	69	65	62	60				
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	57				
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53				
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50				

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	60640
5°	60685
10°	62829
15°	62926
20°	57939
25°	49368
30°	37786
35°	26703
40°	15761
45°	6397
50°	2312
55°	1295
60°	743
65°	414
70°	415
75°	338
80°	378
85°	251

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 6397 cd/sqm



TEST NUMBER: P787417

CATALOG NUMBER: LER6D02D010-EC6DR650210IC9027-6LBDP1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	53.4	9.5
10°-20°	154.2	27.3
20°-30°	185.0	32.8
30°-40°	124.3	22.1
40°-50°	37.2	6.6
50°-60°	6.6	1.2
60°-70°	1.9	0.3
70°-80°	0.9	0.2
80°-90°	0.3	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	392.6	69.6
0°-40°	516.9	91.7
0°-60°	560.6	99.5
0°-90°	563.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	563.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	555	
5°	553	53
15°	556	154
25°	410	185
35°	200	124
45°	41	37
55°	7	7
65°	2	2
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P787417

CATALOG NUMBER: LER6D02D010-EC6DR650210IC9027-6LBDP1LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	555.0
2.5°	557.4
5°	553.3
7.5°	561.7
10°	566.3
12.5°	565.2
15°	556.3
17.5°	534.7
20°	498.3
22.5°	455.4
25°	409.5
27.5°	357.7
30°	299.5
32.5°	246.9
35°	200.2
37.5°	154.0
40°	110.5
42.5°	72.2
45°	41.4
47.5°	21.9
50°	13.6
52.5°	9.5
55°	6.8
57.5°	4.9
60°	3.4
62.5°	2.2
65°	1.6
67.5°	1.4
70°	1.3
72.5°	1.0
75°	0.8
77.5°	0.7
80°	0.6
82.5°	0.4
85°	0.2
87.5°	0.2
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)