

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P787418

Luminaire Tested: LER6D02D010-EC6DR650210IC9027-6LBDP1MW

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P787418
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D02D010-EC6DR650210IC9027-6LBDP1MW
Description: 6 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 463.2 lumens
Efficiency: N/A
Efficacy: 90.8 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 5.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P787418

CATALOG NUMBER: LER6D02D010-EC6DR650210IC9027-6LBDP1MW

Luminous Intensity Polar Plot

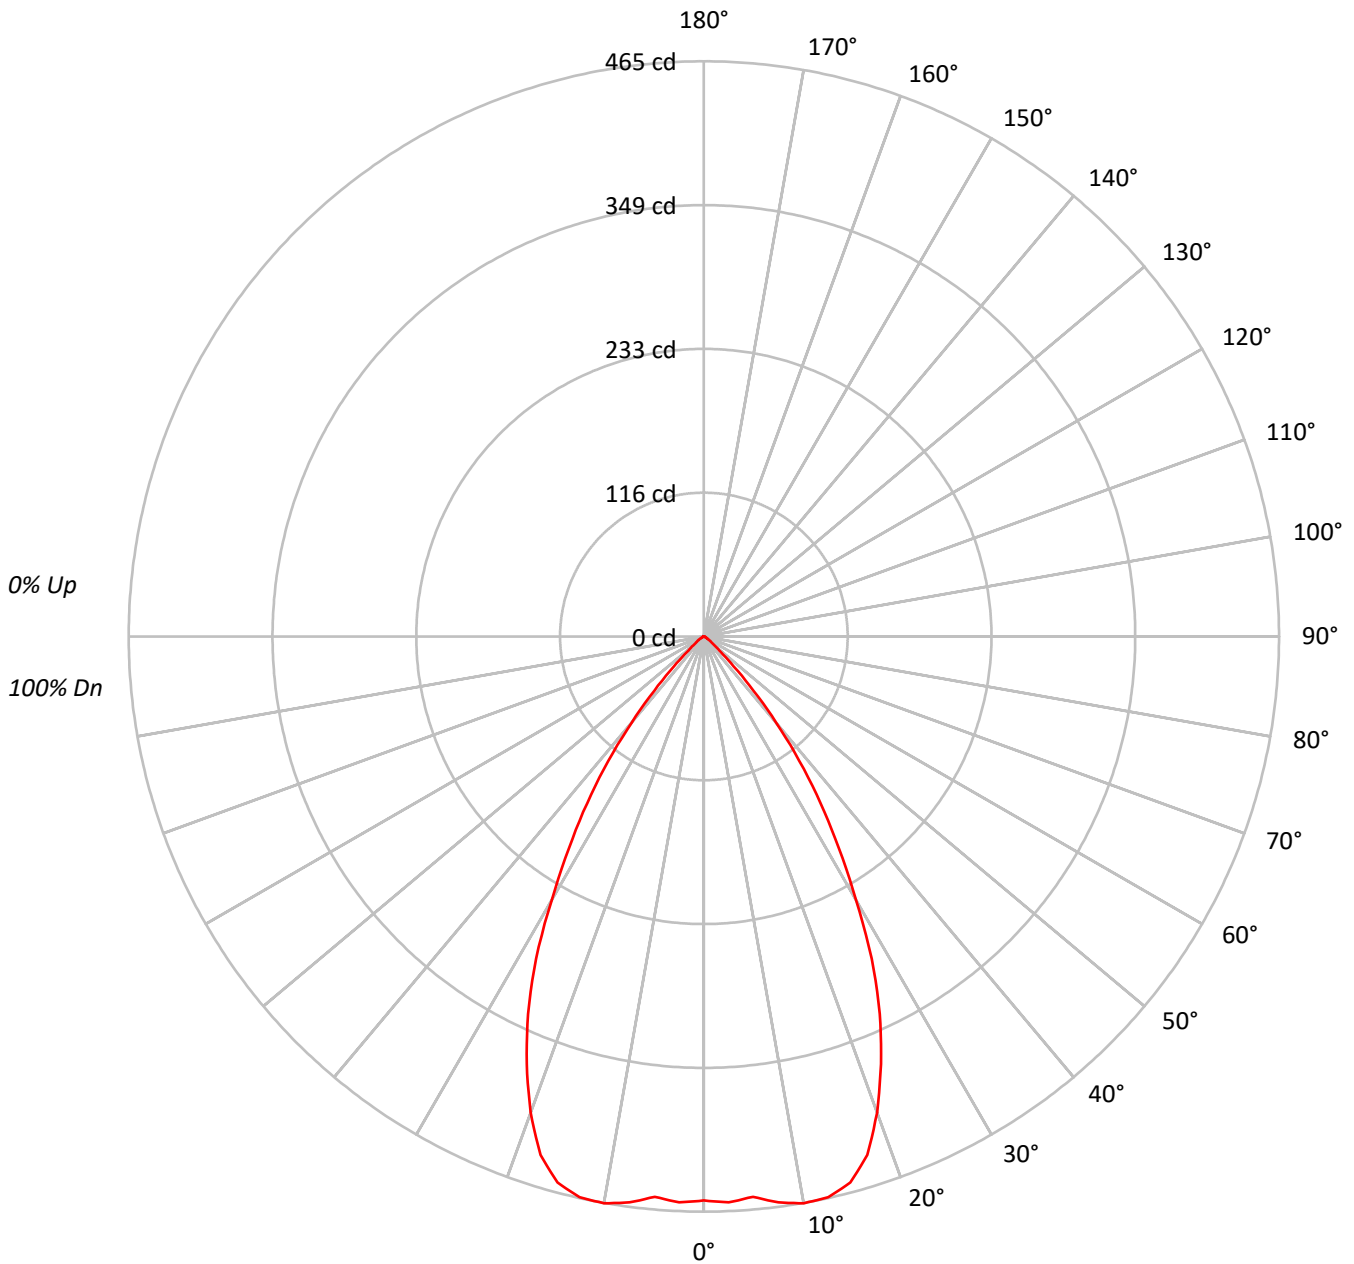



TEST NUMBER: P787418

CATALOG NUMBER: LER6D02D010-EC6DR650210IC9027-6LBDP1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93		
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87		
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80		
4	97	89	84	79	95	88	83	79	86	82	78	84	80	77	82	79	76	75		
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69		
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65		
7	83	73	67	63	81	73	67	63	71	66	62	70	66	62	69	65	62	60		
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	57		
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53		
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	49823
5°	49871
10°	51623
15°	51705
20°	47602
25°	40567
30°	31049
35°	21941
40°	12951
45°	5254
50°	1904
55°	1067
60°	612
65°	336
70°	351
75°	253
80°	315
85°	251

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 5254 cd/sqm



TEST NUMBER: P787418

CATALOG NUMBER: LER6D02D010-EC6DR650210IC9027-6LBDP1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	43.9	9.5
10°-20°	126.7	27.3
20°-30°	152.0	32.8
30°-40°	102.1	22.1
40°-50°	30.6	6.6
50°-60°	5.4	1.2
60°-70°	1.5	0.3
70°-80°	0.7	0.2
80°-90°	0.2	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	322.6	69.6
0°-40°	424.7	91.7
0°-60°	460.7	99.5
0°-90°	463.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	463.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	456	
5°	455	44
15°	457	127
25°	336	152
35°	164	102
45°	34	31
55°	6	5
65°	1	2
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P787418

CATALOG NUMBER: LER6D02D010-EC6DR650210IC9027-6LBDP1MW

CANDELA DISTRIBUTION (FULL):

0°	
0°	456.0
2.5°	458.0
5°	454.7
7.5°	461.5
10°	465.3
12.5°	464.4
15°	457.1
17.5°	439.4
20°	409.4
22.5°	374.2
25°	336.5
27.5°	293.9
30°	246.1
32.5°	202.8
35°	164.5
37.5°	126.6
40°	90.8
42.5°	59.3
45°	34.0
47.5°	18.0
50°	11.2
52.5°	7.8
55°	5.6
57.5°	4.0
60°	2.8
62.5°	1.8
65°	1.3
67.5°	1.2
70°	1.1
72.5°	0.8
75°	0.6
77.5°	0.6
80°	0.5
82.5°	0.3
85°	0.2
87.5°	0.1
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)