

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P787553

Luminaire Tested: LER6D05D010-EC6DR150210IC9024-6LBDP1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P787553
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-21)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D05D010-EC6DR150210IC9024-6LBDP1LI
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 15° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 611.4 lumens
Efficiency: N/A
Efficacy: 81.5 lumens/watt
Spacing Criteria (0/90/45): 0.22 / 0.22 / 0.23
Luminous Opening: Vertical Cylinder (Dia: 0.35' x H: 0.35')
CIE Type: Direct

Input Watts (W): 7.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P787553

CATALOG NUMBER: LER6D05D010-EC6DR150210IC9024-6LBDP1LI

Luminous Intensity Polar Plot

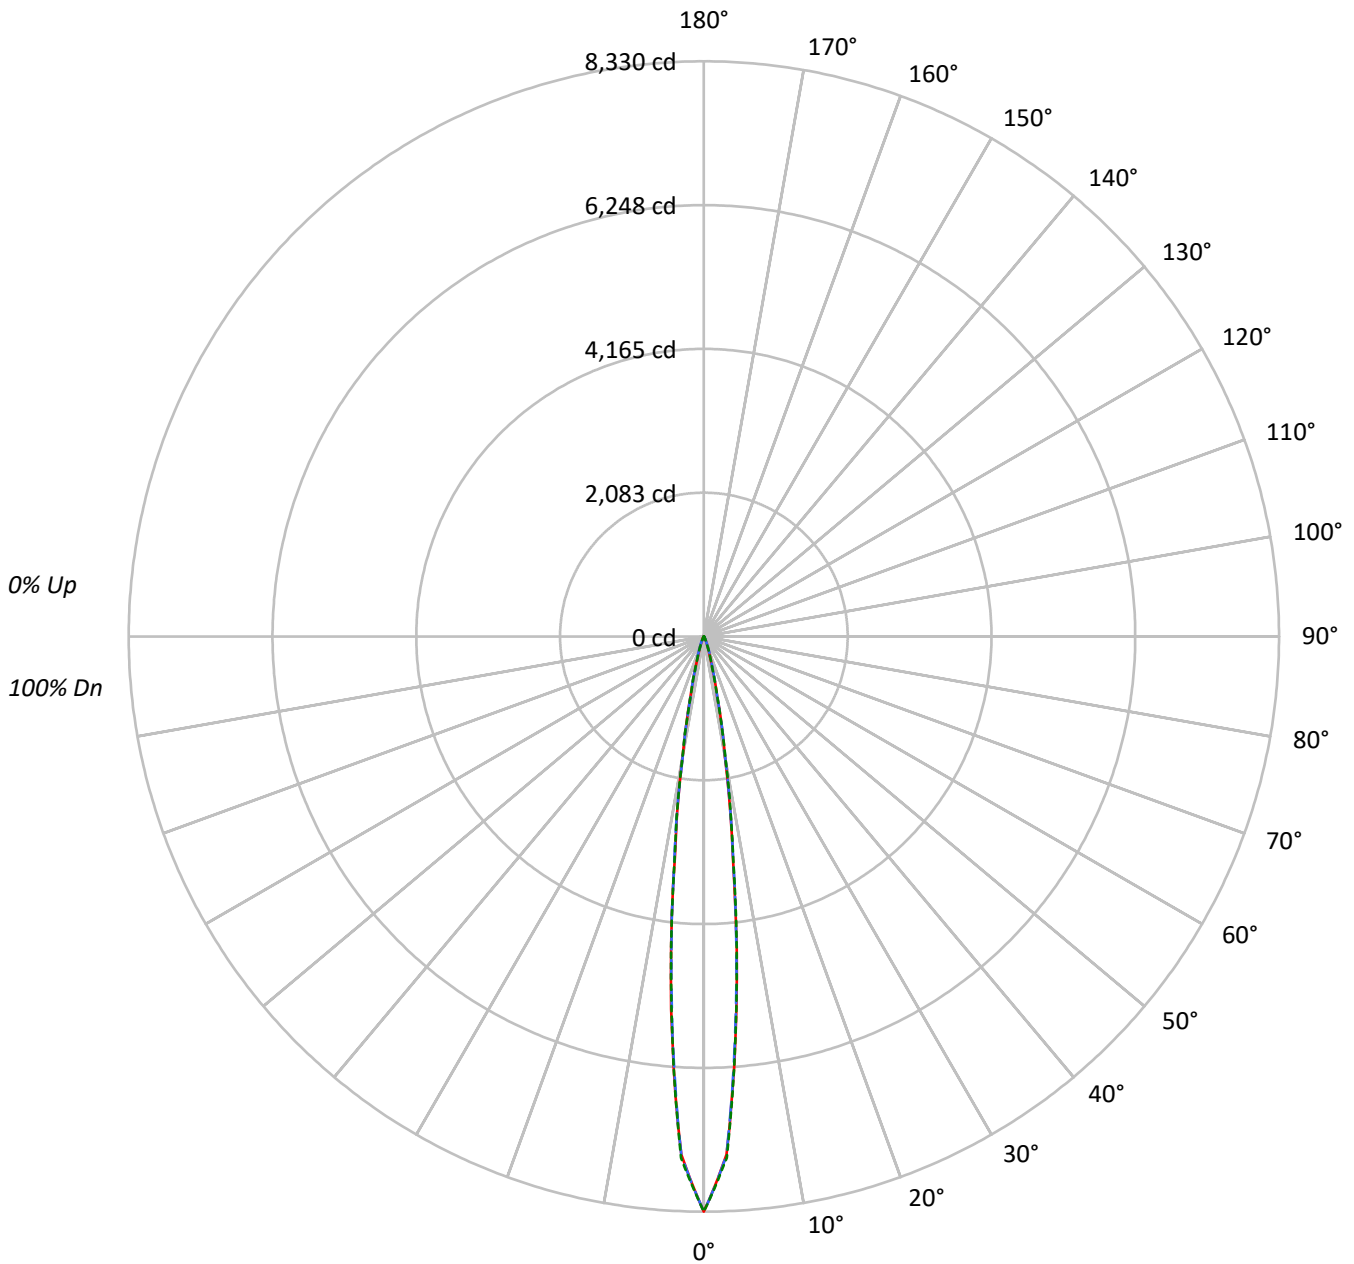



TEST NUMBER: P787553

CATALOG NUMBER: LER6D05D010-EC6DR150210IC9024-6LBDP1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	116	114	112	111	113	112	110	109	108	107	106	104	103	103	101	100	100	98																			
2	113	110	107	105	111	108	106	104	105	103	102	102	101	100	100	98	98	96																			
3	110	106	103	101	108	105	102	100	103	100	99	100	99	97	98	97	96	94																			
4	108	103	100	98	106	102	99	97	100	98	96	99	97	95	97	95	94	93																			
5	106	101	98	95	104	100	97	95	98	96	94	97	95	93	96	94	92	92																			
6	104	99	95	93	102	98	95	93	97	94	92	96	93	92	95	93	91	90																			
7	102	97	94	91	101	96	93	91	95	93	91	94	92	90	93	91	90	89																			
8	100	95	92	90	99	95	92	90	94	91	89	93	91	89	92	90	89	88																			
9	99	93	90	88	98	93	90	88	92	90	88	92	89	88	91	89	87	87																			
10	97	92	89	87	96	92	89	87	91	89	87	91	88	87	90	88	86	86																			

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	937269	937269	937269
5°	550778	543654	547953
10°	164380	165537	168066
15°	40892	41683	40397
20°	12233	14164	12494
25°	4316	5492	4370
30°	1587	2089	1610
35°	792	893	770
40°	504	554	504
45°	371	392	371
50°	292	292	292
55°	244	244	244
60°	197	197	197
65°	150	150	150
70°	132	132	132
75°	83	83	106
80°	55	55	55
85°	33	33	33

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 45°

Vertical Angle: 45°

Luminance: 392 cd/sqm



TEST NUMBER: P787553

CATALOG NUMBER: LER6D05D010-EC6DR150210IC9024-6LBDP1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	396.5	64.9
10°-20°	163.1	26.7
20°-30°	32.4	5.3
30°-40°	8.1	1.3
40°-50°	4.2	0.7
50°-60°	3.2	0.5
60°-70°	2.2	0.4
70°-80°	1.3	0.2
80°-90°	0.4	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	592.0	96.8
0°-40°	600.1	98.2
0°-60°	607.5	99.4
0°-90°	611.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	611.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	8330	8330	8330	8330	8330	
5°	5420	5364	5349	5386	5392	396
15°	471	480	480	472	465	161
25°	55	63	70	62	56	29
35°	11	12	12	12	11	7
45°	5	5	6	5	5	4
55°	4	4	4	4	4	3
65°	2	2	2	2	2	2
75°	1	1	1	1	1	1
85°	0	0	0	0	0	0
90°	0	0	0	0	0	



TEST NUMBER: P787553

CATALOG NUMBER: LER6D05D010-EC6DR150210IC9024-6LBDP1LI

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	8329.8	8329.8	8329.8	8329.8	8329.8
2.5°	7513.8	7520.1	7522.6	7530.0	7557.5
5°	5419.5	5363.8	5349.4	5386.4	5391.7
7.5°	3210.3	3221.6	3262.9	3272.0	3238.9
10°	1761.7	1776.2	1774.1	1786.8	1801.2
12.5°	901.0	889.7	886.2	900.6	880.5
15°	470.8	479.6	479.9	471.5	465.1
17.5°	253.2	263.4	280.3	266.6	245.4
20°	149.5	158.7	173.1	161.9	152.7
22.5°	92.4	99.8	110.0	101.2	93.8
25°	55.4	62.8	70.5	62.4	56.1
27.5°	32.8	39.1	44.1	38.8	32.4
30°	21.2	24.7	27.9	24.3	21.5
32.5°	14.8	16.2	17.6	16.2	14.8
35°	10.9	11.6	12.3	11.6	10.6
37.5°	8.5	9.2	9.5	8.8	8.1
40°	7.1	7.4	7.8	7.4	7.1
42.5°	6.0	6.3	6.3	6.3	6.0
45°	5.3	5.3	5.6	5.3	5.3
47.5°	4.6	4.6	4.9	4.6	4.6
50°	4.2	4.2	4.2	4.2	4.2
52.5°	3.9	3.9	3.9	3.9	3.9
55°	3.5	3.5	3.5	3.5	3.5
57.5°	3.2	3.2	3.2	3.2	3.2
60°	2.8	2.8	2.8	2.8	2.8
62.5°	2.5	2.5	2.5	2.5	2.5
65°	2.1	2.1	2.1	2.1	2.1
67.5°	2.1	2.1	2.1	2.1	2.1
70°	1.8	1.8	1.8	1.8	1.8
72.5°	1.4	1.4	1.4	1.4	1.4
75°	1.1	1.1	1.1	1.1	1.4
77.5°	1.1	1.1	1.1	1.1	1.1
80°	0.7	0.7	0.7	0.7	0.7
82.5°	0.7	0.7	0.7	0.7	0.7
85°	0.4	0.4	0.4	0.4	0.4
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)