

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P787572

Luminaire Tested: LER6D05D010-EC6DR150210IC9030-6LBS1H

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P787572  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-21)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LER6D05D010-EC6DR150210IC9030-6LBS1H  
Description: 6 INCH ROUND SHALLOW SEMI-SPECULAR CLEAR TRIM, WITH 15° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 702.5 lumens  
Efficiency: N/A  
Efficacy: 93.7 lumens/watt  
Spacing Criteria (0/90/45): 0.22 / 0.22 / 0.23  
Luminous Opening: Vertical Cylinder (Dia: 0.35' x H: 0.35')  
CIE Type: Direct


Input Watts (W): 7.5  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



Downlight

TEST NUMBER: P787572  
CATALOG NUMBER: LER6D05D010-EC6DR150210IC9030-6LBS1H

### Luminous Intensity Polar Plot

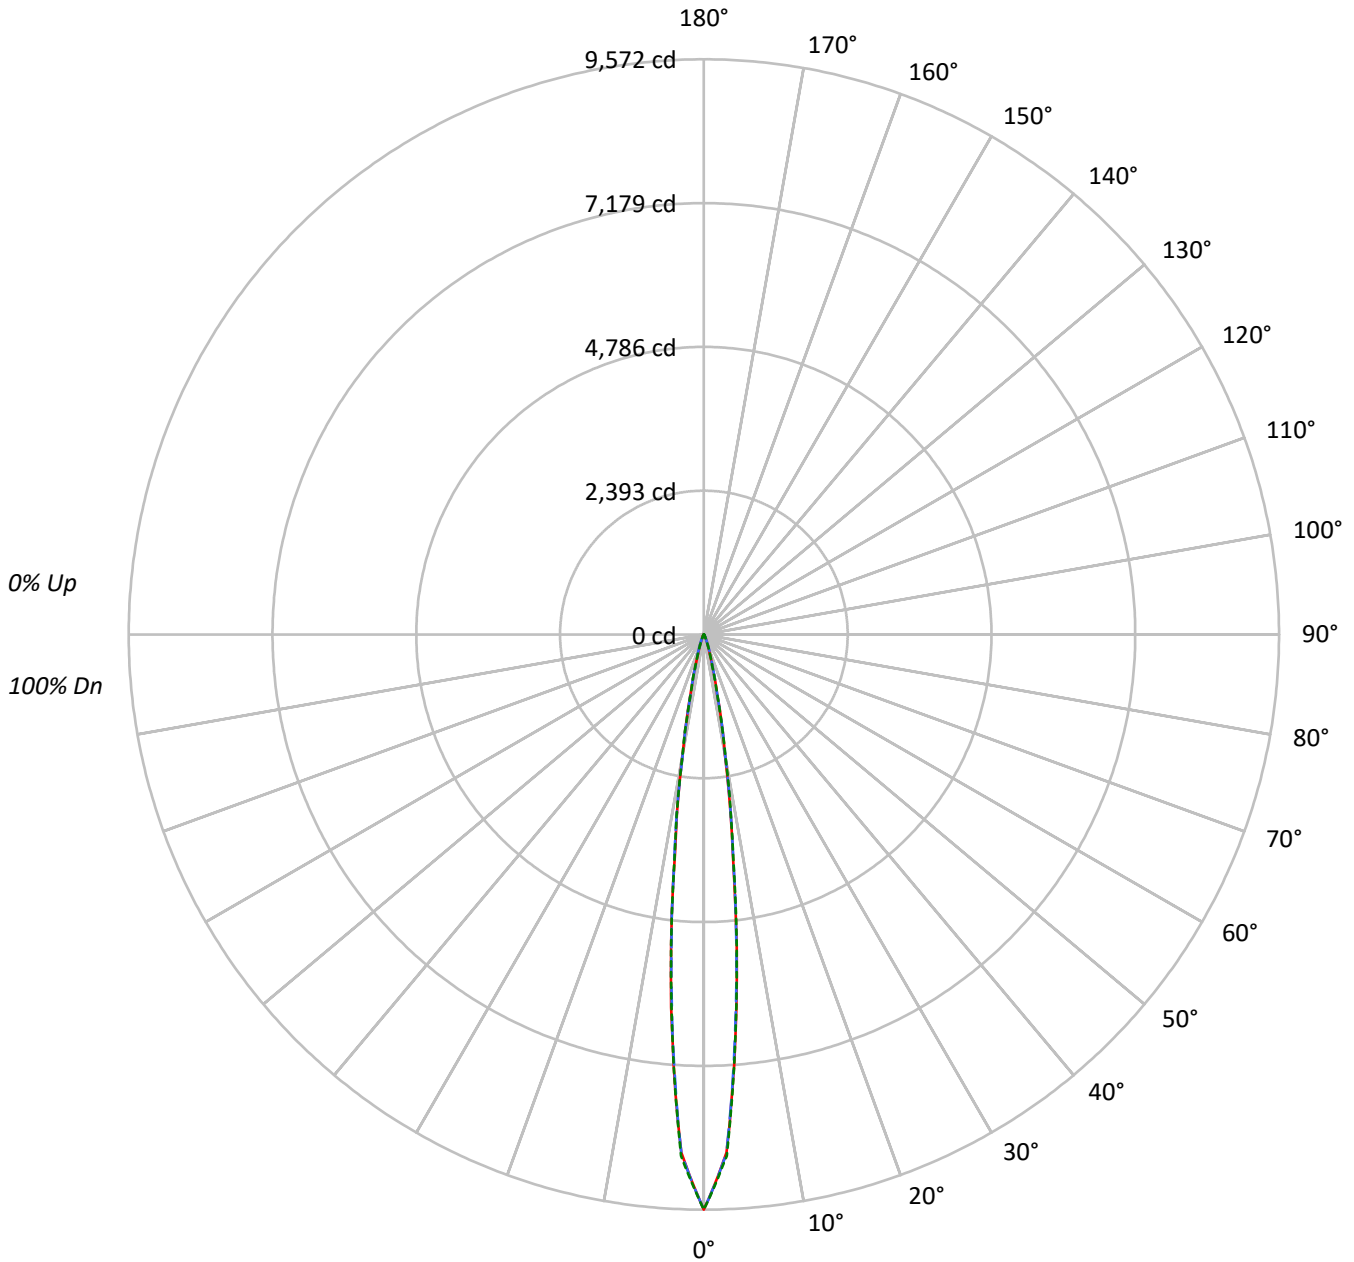



TEST NUMBER: P787572

CATALOG NUMBER: LER6D05D010-EC6DR150210IC9030-6LBS1H

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	116	114	112	111	113	112	110	109	108	107	106	104	103	103	101	100	100	98						98													
2	113	110	107	105	111	108	106	104	105	103	102	102	101	100	100	99	98	96						96													
3	110	106	103	101	108	105	102	100	103	100	99	100	99	97	98	97	96	94						94													
4	108	103	100	98	106	102	99	97	100	98	96	99	97	95	97	95	94	93						93													
5	106	101	98	95	104	100	97	95	99	96	94	97	95	93	96	94	92	92						92													
6	104	99	95	93	102	98	95	93	97	94	92	96	93	92	95	93	91	90						90													
7	102	97	94	91	101	96	93	91	95	93	91	94	92	90	93	91	90	89						89													
8	100	95	92	90	99	95	92	90	94	91	89	93	91	89	92	90	89	88						88													
9	99	93	90	88	98	93	90	88	92	90	88	92	89	88	91	89	88	87						87													
10	97	92	89	87	96	92	89	87	91	89	87	91	88	87	90	88	86	86						86													

**AVERAGE LUMINANCE (cd/sqm):**

	0°	45°	90°
0°	1077007	1077007	1077007
5°	632904	624703	629642
10°	188892	190217	193128
15°	46981	47902	46425
20°	14057	16283	14360
25°	4954	6310	5017
30°	1820	2396	1850
35°	915	1031	886
40°	575	632	575
45°	427	455	427
50°	341	341	341
55°	285	285	285
60°	225	225	225
65°	171	171	171
70°	146	146	146
75°	91	91	121
80°	63	63	63
85°	33	33	33

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 45°

Vertical Angle: 45°

Luminance: 455 cd/sqm



TEST NUMBER: P787572

CATALOG NUMBER: LER6D05D010-EC6DR150210IC9030-6LBS1H

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	455.6	64.9
10°-20°	187.4	26.7
20°-30°	37.2	5.3
30°-40°	9.3	1.3
40°-50°	4.9	0.7
50°-60°	3.6	0.5
60°-70°	2.5	0.4
70°-80°	1.4	0.2
80°-90°	0.4	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	680.3	96.8
0°-40°	689.6	98.2
0°-60°	698.1	99.4
0°-90°	702.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	702.5	100.0

**CANDELA DISTRIBUTION:**

	0°	22.5°	45°	67.5°	90°	Flux
0°	9572	9572	9572	9572	9572	
5°	6228	6164	6147	6190	6196	455
15°	541	551	552	542	534	185
25°	64	72	81	72	64	33
35°	13	13	14	13	12	9
45°	6	6	6	6	6	5
55°	4	4	4	4	4	4
65°	2	2	2	2	2	3
75°	1	1	1	1	2	1
85°	0	0	0	0	0	0
90°	0	0	0	0	0	



TEST NUMBER: P787572

CATALOG NUMBER: LER6D05D010-EC6DR150210IC9030-6LBS1H

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°
0°	9571.7	9571.7	9571.7	9571.7	9571.7
2.5°	8634.1	8641.3	8644.2	8652.7	8684.3
5°	6227.6	6163.5	6146.9	6189.5	6195.5
7.5°	3689.0	3701.9	3749.3	3759.9	3721.8
10°	2024.4	2041.0	2038.6	2053.2	2069.8
12.5°	1035.3	1022.3	1018.3	1034.9	1011.8
15°	540.9	551.1	551.5	541.8	534.5
17.5°	290.9	302.7	322.1	306.3	282.0
20°	171.8	182.3	199.0	186.0	175.5
22.5°	106.2	114.7	126.4	116.3	107.8
25°	63.6	72.1	81.0	71.7	64.4
27.5°	37.7	45.0	50.7	44.6	37.3
30°	24.3	28.4	32.0	28.0	24.7
32.5°	17.0	18.6	20.3	18.6	17.0
35°	12.6	13.4	14.2	13.4	12.2
37.5°	9.7	10.5	10.9	10.1	9.3
40°	8.1	8.5	8.9	8.5	8.1
42.5°	6.9	7.3	7.3	7.3	6.9
45°	6.1	6.1	6.5	6.1	6.1
47.5°	5.3	5.3	5.7	5.3	5.3
50°	4.9	4.9	4.9	4.9	4.9
52.5°	4.5	4.5	4.5	4.5	4.5
55°	4.1	4.1	4.1	4.1	4.1
57.5°	3.6	3.6	3.6	3.6	3.6
60°	3.2	3.2	3.2	3.2	3.2
62.5°	2.8	2.8	2.8	2.8	2.8
65°	2.4	2.4	2.4	2.4	2.4
67.5°	2.4	2.4	2.4	2.4	2.4
70°	2.0	2.0	2.0	2.0	2.0
72.5°	1.6	1.6	1.6	1.6	1.6
75°	1.2	1.2	1.2	1.2	1.6
77.5°	1.2	1.2	1.2	1.2	1.2
80°	0.8	0.8	0.8	0.8	0.8
82.5°	0.8	0.8	0.8	0.8	0.8
85°	0.4	0.4	0.4	0.4	0.4
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report







— 0°-180°    - - 45°-225°    - - - - 90°-270°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)