

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P787579

Luminaire Tested: LER6D05D010-EC6DR150210IC9035-6LBS1B

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P787579
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-21)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D05D010-EC6DR150210IC9035-6LBS1B
Description: 6 INCH ROUND SHALLOW SPECULAR BLACK TRIM, WITH 15° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 696.0 lumens
Efficiency: N/A
Efficacy: 92.8 lumens/watt
Spacing Criteria (0/90/45): 0.22 / 0.22 / 0.23
Luminous Opening: Vertical Cylinder (Dia: 0.35' x H: 0.35')
CIE Type: Direct

Input Watts (W): 7.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P787579

CATALOG NUMBER: LER6D05D010-EC6DR150210IC9035-6LBS1B

Luminous Intensity Polar Plot

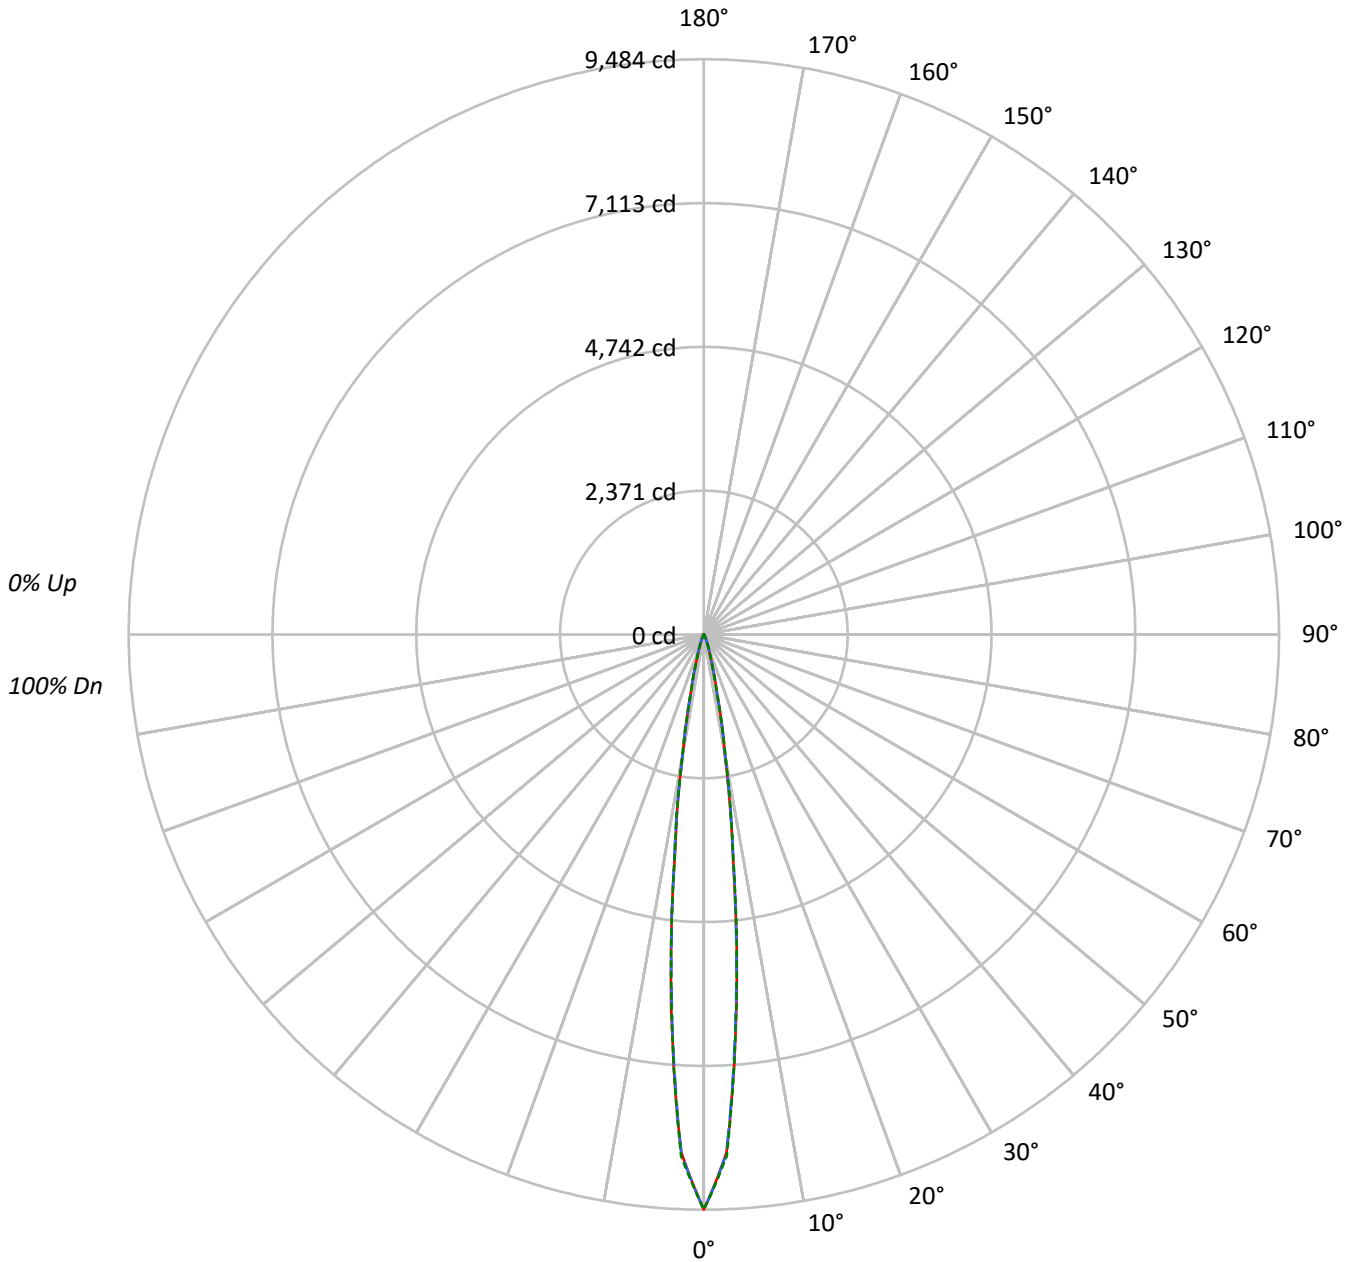



TEST NUMBER: P787579

CATALOG NUMBER: LER6D05D010-EC6DR150210IC9035-6LBS1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	116	114	112	111	113	112	110	109	108	107	106	104	103	103	101	100	100	98																			
2	113	110	107	105	111	108	106	104	105	103	102	102	101	100	100	98	98	96																			
3	110	106	103	101	108	105	102	100	103	100	99	100	99	97	98	97	96	94																			
4	108	103	100	98	106	102	99	97	100	98	96	99	97	95	97	95	94	93																			
5	106	101	98	95	104	100	97	95	99	96	94	97	95	93	96	94	92	92																			
6	104	99	95	93	102	98	95	93	97	94	92	96	93	92	95	93	91	90																			
7	102	97	94	91	101	96	93	91	95	93	91	94	92	90	93	91	90	89																			
8	100	95	92	90	99	95	92	90	94	91	89	93	91	89	92	90	89	88																			
9	99	93	90	88	98	93	90	88	92	90	88	92	89	88	91	89	88	87																			
10	97	92	89	87	96	92	89	87	91	89	87	91	88	87	90	88	86	86																			

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1067105	1067105	1067105
5°	627081	618961	623859
10°	187156	188463	191346
15°	46555	47459	45991
20°	13926	16127	14221
25°	4908	6255	4970
30°	1805	2374	1835
35°	900	1024	871
40°	568	625	568
45°	420	448	420
50°	334	334	334
55°	278	278	278
60°	225	225	225
65°	171	171	171
70°	146	146	146
75°	91	91	121
80°	63	63	63
85°	33	33	33

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 45°

Vertical Angle: 45°

Luminance: 448 cd/sqm



TEST NUMBER: P787579

CATALOG NUMBER: LER6D05D010-EC6DR150210IC9035-6LBS1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	451.4	64.9
10°-20°	185.7	26.7
20°-30°	36.9	5.3
30°-40°	9.2	1.3
40°-50°	4.8	0.7
50°-60°	3.6	0.5
60°-70°	2.5	0.4
70°-80°	1.4	0.2
80°-90°	0.4	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	674.0	96.8
0°-40°	683.2	98.2
0°-60°	691.6	99.4
0°-90°	696.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	696.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	9484	9484	9484	9484	9484	
5°	6170	6107	6090	6133	6139	451
15°	536	546	546	537	530	184
25°	63	72	80	71	64	33
35°	12	13	14	13	12	8
45°	6	6	6	6	6	5
55°	4	4	4	4	4	4
65°	2	2	2	2	2	3
75°	1	1	1	1	2	1
85°	0	0	0	0	0	0
90°	0	0	0	0	0	



TEST NUMBER: P787579

CATALOG NUMBER: LER6D05D010-EC6DR150210IC9035-6LBS1B

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	9483.7	9483.7	9483.7	9483.7	9483.7
2.5°	8554.7	8561.9	8564.7	8573.1	8604.4
5°	6170.3	6106.9	6090.4	6132.6	6138.6
7.5°	3655.0	3667.9	3714.9	3725.3	3687.6
10°	2005.8	2022.2	2019.8	2034.3	2050.7
12.5°	1025.8	1012.9	1008.9	1025.4	1002.5
15°	536.0	546.0	546.4	536.8	529.5
17.5°	288.3	299.9	319.2	303.5	279.4
20°	170.2	180.7	197.1	184.3	173.8
22.5°	105.2	113.6	125.3	115.2	106.8
25°	63.0	71.5	80.3	71.1	63.8
27.5°	37.3	44.6	50.2	44.2	36.9
30°	24.1	28.1	31.7	27.7	24.5
32.5°	16.9	18.5	20.1	18.5	16.9
35°	12.4	13.2	14.1	13.2	12.0
37.5°	9.6	10.4	10.8	10.0	9.2
40°	8.0	8.4	8.8	8.4	8.0
42.5°	6.8	7.2	7.2	7.2	6.8
45°	6.0	6.0	6.4	6.0	6.0
47.5°	5.2	5.2	5.6	5.2	5.2
50°	4.8	4.8	4.8	4.8	4.8
52.5°	4.4	4.4	4.4	4.4	4.4
55°	4.0	4.0	4.0	4.0	4.0
57.5°	3.6	3.6	3.6	3.6	3.6
60°	3.2	3.2	3.2	3.2	3.2
62.5°	2.8	2.8	2.8	2.8	2.8
65°	2.4	2.4	2.4	2.4	2.4
67.5°	2.4	2.4	2.4	2.4	2.4
70°	2.0	2.0	2.0	2.0	2.0
72.5°	1.6	1.6	1.6	1.6	1.6
75°	1.2	1.2	1.2	1.2	1.6
77.5°	1.2	1.2	1.2	1.2	1.2
80°	0.8	0.8	0.8	0.8	0.8
82.5°	0.8	0.8	0.8	0.8	0.8
85°	0.4	0.4	0.4	0.4	0.4
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)