

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P787606

Luminaire Tested: LER6D05D010-EC6DR200210IC9024-6LBS1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P787606
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D05D010-EC6DR200210IC9024-6LBS1MW
Description: 6 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 20° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 610.9 lumens
Efficiency: N/A
Efficacy: 81.5 lumens/watt
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.36
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 7.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P787606

CATALOG NUMBER: LER6D05D010-EC6DR200210IC9024-6LBS1MW

Luminous Intensity Polar Plot

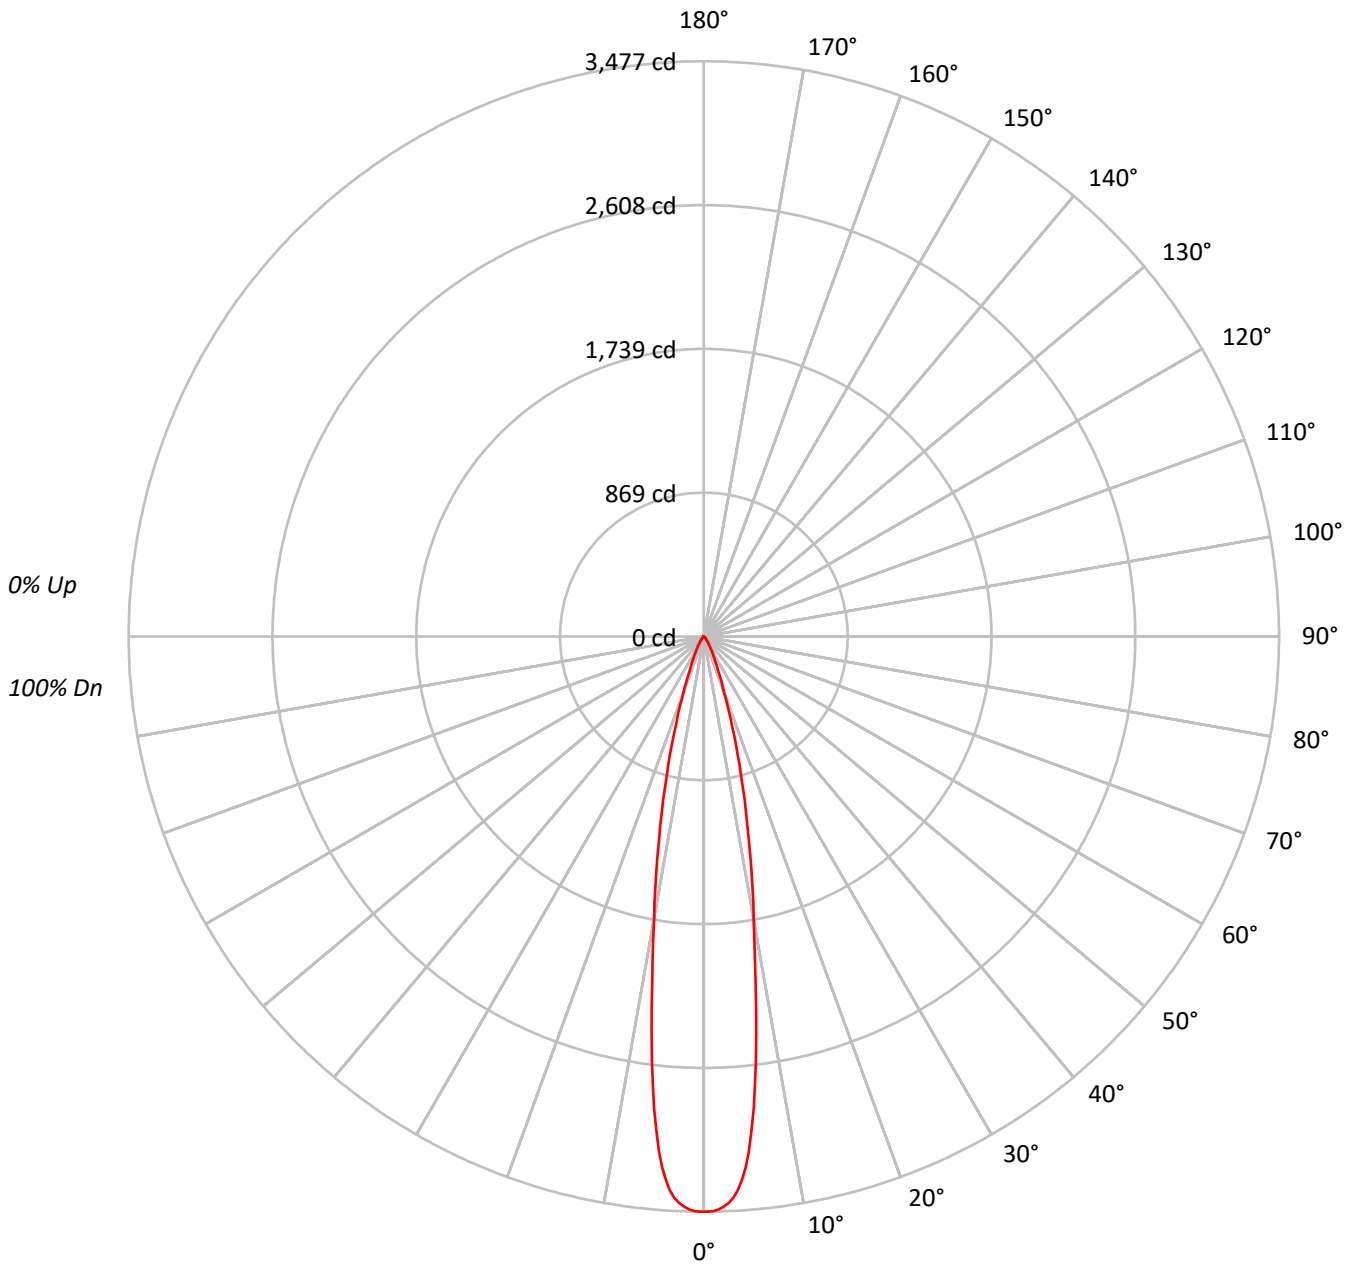



TEST NUMBER: P787606

CATALOG NUMBER: LER6D05D010-EC6DR200210IC9024-6LBS1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100															
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	97	97	98	98	97															
2	111	108	105	102	109	106	104	101	103	101	99	100	99	97	98	96	95	94	94	95	95	94															
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	93	92	91	91	92	92	91															
4	105	99	96	93	103	98	95	92	96	93	91	95	92	90	93	91	89	88	88	89	89	88															
5	102	96	92	89	100	95	91	89	94	90	88	92	89	87	91	88	86	85	85	86	86	85															
6	99	93	89	86	98	92	88	86	91	87	85	90	87	84	88	86	84	83	83	84	84	83															
7	96	90	86	83	95	89	86	83	88	85	82	87	84	82	86	84	82	81	81	82	82	81															
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	80	79	79	80	80	79															
9	91	85	81	78	91	85	81	78	84	80	78	83	80	78	82	80	78	77	77	78	78	77															
10	89	83	79	76	88	82	79	76	82	78	76	81	78	76	81	78	76	75	75	76	76	75															

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	379921
5°	342766
10°	192381
15°	97788
20°	41405
25°	19108
30°	10118
35°	5455
40°	2910
45°	1715
50°	1003
55°	533
60°	328
65°	233
70°	96
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 1715 cd/sqm



TEST NUMBER: P787606

CATALOG NUMBER: LER6D05D010-EC6DR200210IC9024-6LBS1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	247.6	40.5
10°-20°	243.8	39.9
20°-30°	79.6	13.0
30°-40°	27.1	4.4
40°-50°	9.1	1.5
50°-60°	2.7	0.4
60°-70°	0.9	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	571.0	93.5
0°-40°	598.1	97.9
0°-60°	610.0	99.8
0°-90°	610.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	610.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3477	
5°	3125	248
15°	864	244
25°	158	80
35°	41	27
45°	11	9
55°	3	3
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P787606

CATALOG NUMBER: LER6D05D010-EC6DR200210IC9024-6LBS1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	3477.2
0.5°	3477.2
1°	3472.9
1.5°	3464.2
2°	3448.4
2.5°	3427.4
3°	3397.7
3.5°	3356.2
4°	3294.5
4.5°	3219.6
5°	3125.2
5.5°	3001.0
6°	2873.7
6.5°	2727.9
7°	2585.2
7.5°	2418.0
8°	2268.7
8.5°	2118.5
9°	1979.8
9.5°	1852.6
10°	1734.0
12.5°	1245.1
15°	864.5
17.5°	564.8
20°	356.1
22.5°	230.7
25°	158.5
27.5°	111.5
30°	80.2
32.5°	57.6
35°	40.9
37.5°	28.5
40°	20.4
42.5°	14.9
45°	11.1
47.5°	8.7
50°	5.9
52.5°	3.7
55°	2.8
57.5°	2.2
60°	1.5
62.5°	1.2
65°	0.9



TEST NUMBER: P787606

CATALOG NUMBER: LER6D05D010-EC6DR200210IC9024-6LBS1MW

CANDELA DISTRIBUTION (continued):

	0°
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





67.5°		0.6
70°		0.3

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)