

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P787617

Luminaire Tested: LER6D05D010-EC6DR200210IC9030-6LBDP1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P787617
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D05D010-EC6DR200210IC9030-6LBDP1LI
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 20° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 735.3 lumens
Efficiency: N/A
Efficacy: 98.0 lumens/watt
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.36
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 7.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P787617

CATALOG NUMBER: LER6D05D010-EC6DR200210IC9030-6LBDP1LI

Luminous Intensity Polar Plot

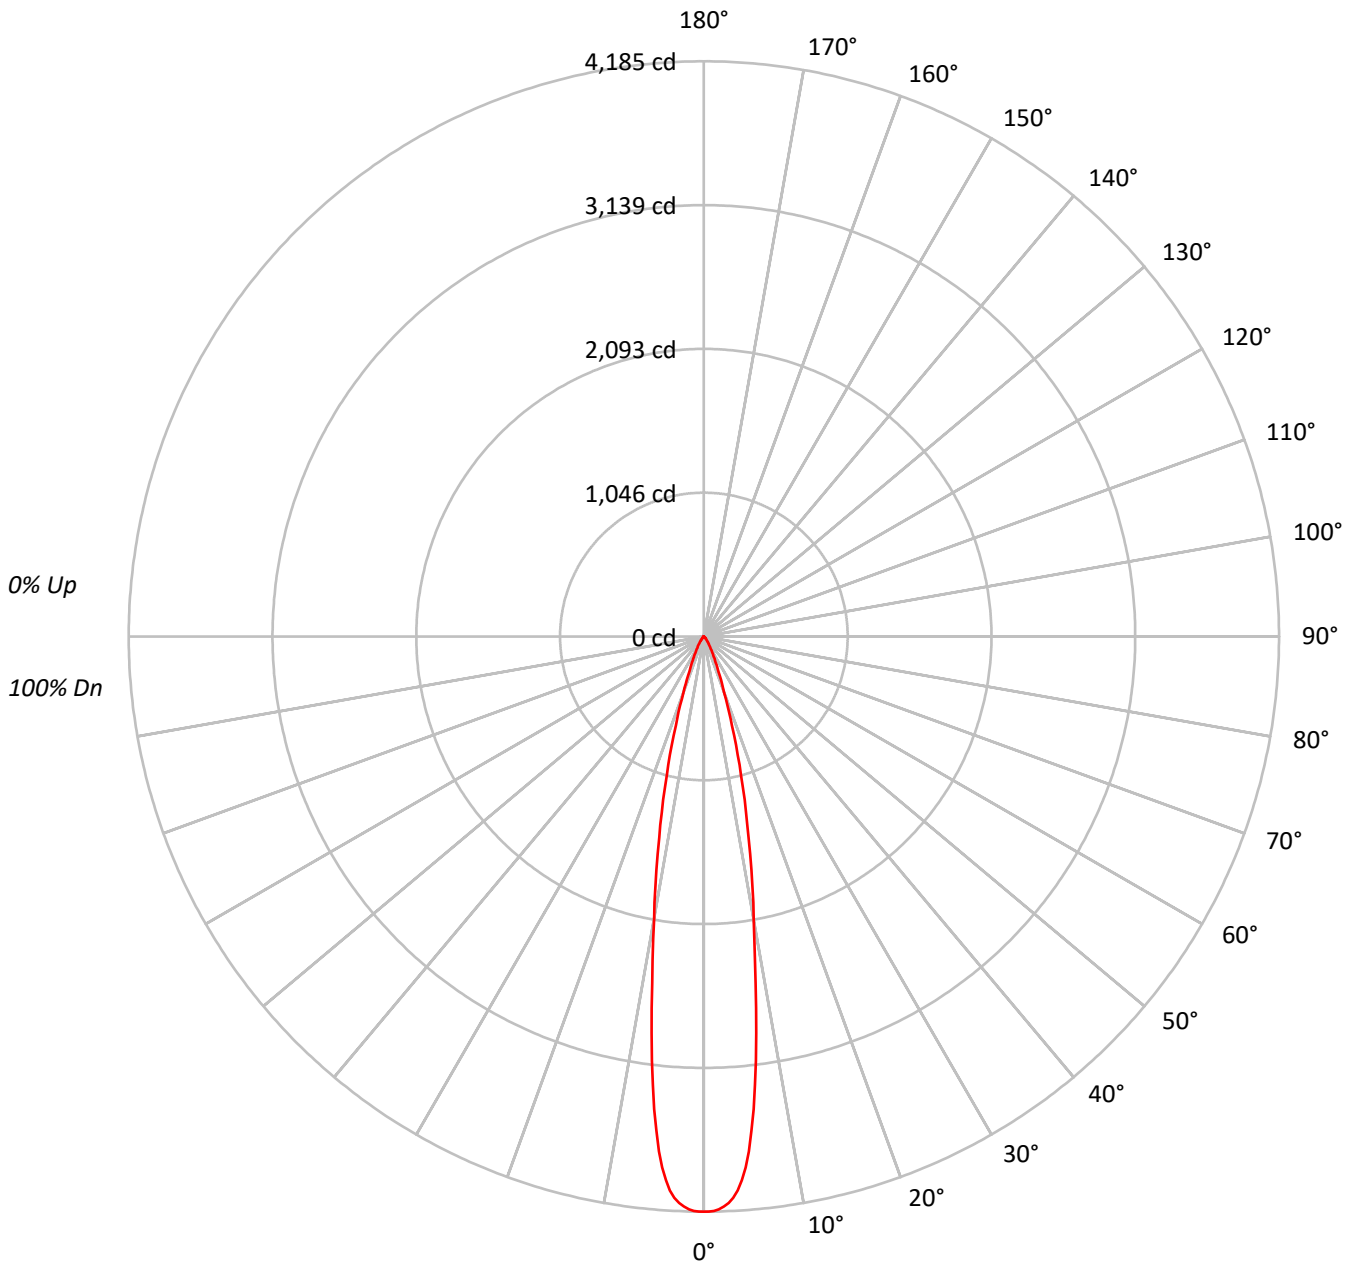



TEST NUMBER: P787617

CATALOG NUMBER: LER6D05D010-EC6DR200210IC9030-6LBDP1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	100	99	98	97	98	96	95	94												
2	111	108	105	102	109	106	104	101	103	101	99	100	99	97	98	96	95	98	96	95	94	93	92	91	94												
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	93	92	98	96	95	94	93	92	91	94												
4	105	99	96	93	103	98	95	92	96	93	91	95	92	90	93	91	89	93	91	89	88	87	86	85	88												
5	102	96	92	89	100	95	91	89	94	90	88	92	89	87	91	88	86	91	88	86	85	84	83	82	85												
6	99	93	89	86	98	92	88	86	91	87	85	90	87	84	88	86	84	88	86	84	83	82	81	80	83												
7	96	90	86	83	95	89	86	83	88	85	82	87	84	82	86	84	82	86	84	82	81	80	79	78	81												
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	80	84	82	80	79	78	77	76	79												
9	91	85	81	78	91	85	81	78	84	80	78	83	80	78	82	80	78	82	80	78	77	76	75	74	77												
10	89	83	79	76	88	82	79	76	82	78	76	81	78	76	81	78	76	81	78	76	75	74	73	72	75												

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	457256
5°	412521
10°	231534
15°	117696
20°	49835
25°	23002
30°	12175
35°	6562
40°	3509
45°	2071
50°	1207
55°	648
60°	415
65°	284
70°	128
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 2071 cd/sqm



TEST NUMBER: P787617

CATALOG NUMBER: LER6D05D010-EC6DR200210IC9030-6LBDP1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	298.0	40.5
10°-20°	293.4	39.9
20°-30°	95.9	13.0
30°-40°	32.6	4.4
40°-50°	11.0	1.5
50°-60°	3.3	0.5
60°-70°	1.1	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	687.2	93.5
0°-40°	719.8	97.9
0°-60°	734.1	99.8
0°-90°	735.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	735.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4185	
5°	3761	298
15°	1040	293
25°	191	96
35°	49	33
45°	13	11
55°	3	3
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P787617

CATALOG NUMBER: LER6D05D010-EC6DR200210IC9030-6LBDP1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	4185.0
0.5°	4185.0
1°	4179.7
1.5°	4169.3
2°	4150.3
2.5°	4125.0
3°	4089.2
3.5°	4039.2
4°	3965.1
4.5°	3874.9
5°	3761.2
5.5°	3611.8
6°	3458.6
6.5°	3283.1
7°	3111.3
7.5°	2910.1
8°	2730.5
8.5°	2549.7
9°	2382.8
9.5°	2229.6
10°	2086.9
12.5°	1498.5
15°	1040.5
17.5°	679.7
20°	428.6
22.5°	277.6
25°	190.8
27.5°	134.2
30°	96.5
32.5°	69.3
35°	49.2
37.5°	34.3
40°	24.6
42.5°	17.9
45°	13.4
47.5°	10.4
50°	7.1
52.5°	4.5
55°	3.4
57.5°	2.6
60°	1.9
62.5°	1.5
65°	1.1



TEST NUMBER: P787617

CATALOG NUMBER: LER6D05D010-EC6DR200210IC9030-6LBDP1LI

CANDELA DISTRIBUTION (continued):

	0°
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





67.5°		0.7
70°		0.4

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)