

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P787723

Luminaire Tested: LER6D05D010-EC6DR300210IC9035-6LBS1B

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P787723
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-16)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D05D010-EC6DR300210IC9035-6LBS1B
Description: 6 INCH ROUND SHALLOW SPECULAR BLACK TRIM, WITH 30° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1173.5 lumens
Efficiency: N/A
Efficacy: 156.5 lumens/watt
Spacing Criteria (0/90/45): 0.52 / 0.52 / 0.49
Luminous Opening: Rectangular (W 0.38' x L: 0.38' x H: 0')
CIE Type: Direct

Input Watts (W): 7.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P787723

CATALOG NUMBER: LER6D05D010-EC6DR300210IC9035-6LBS1B

Luminous Intensity Polar Plot

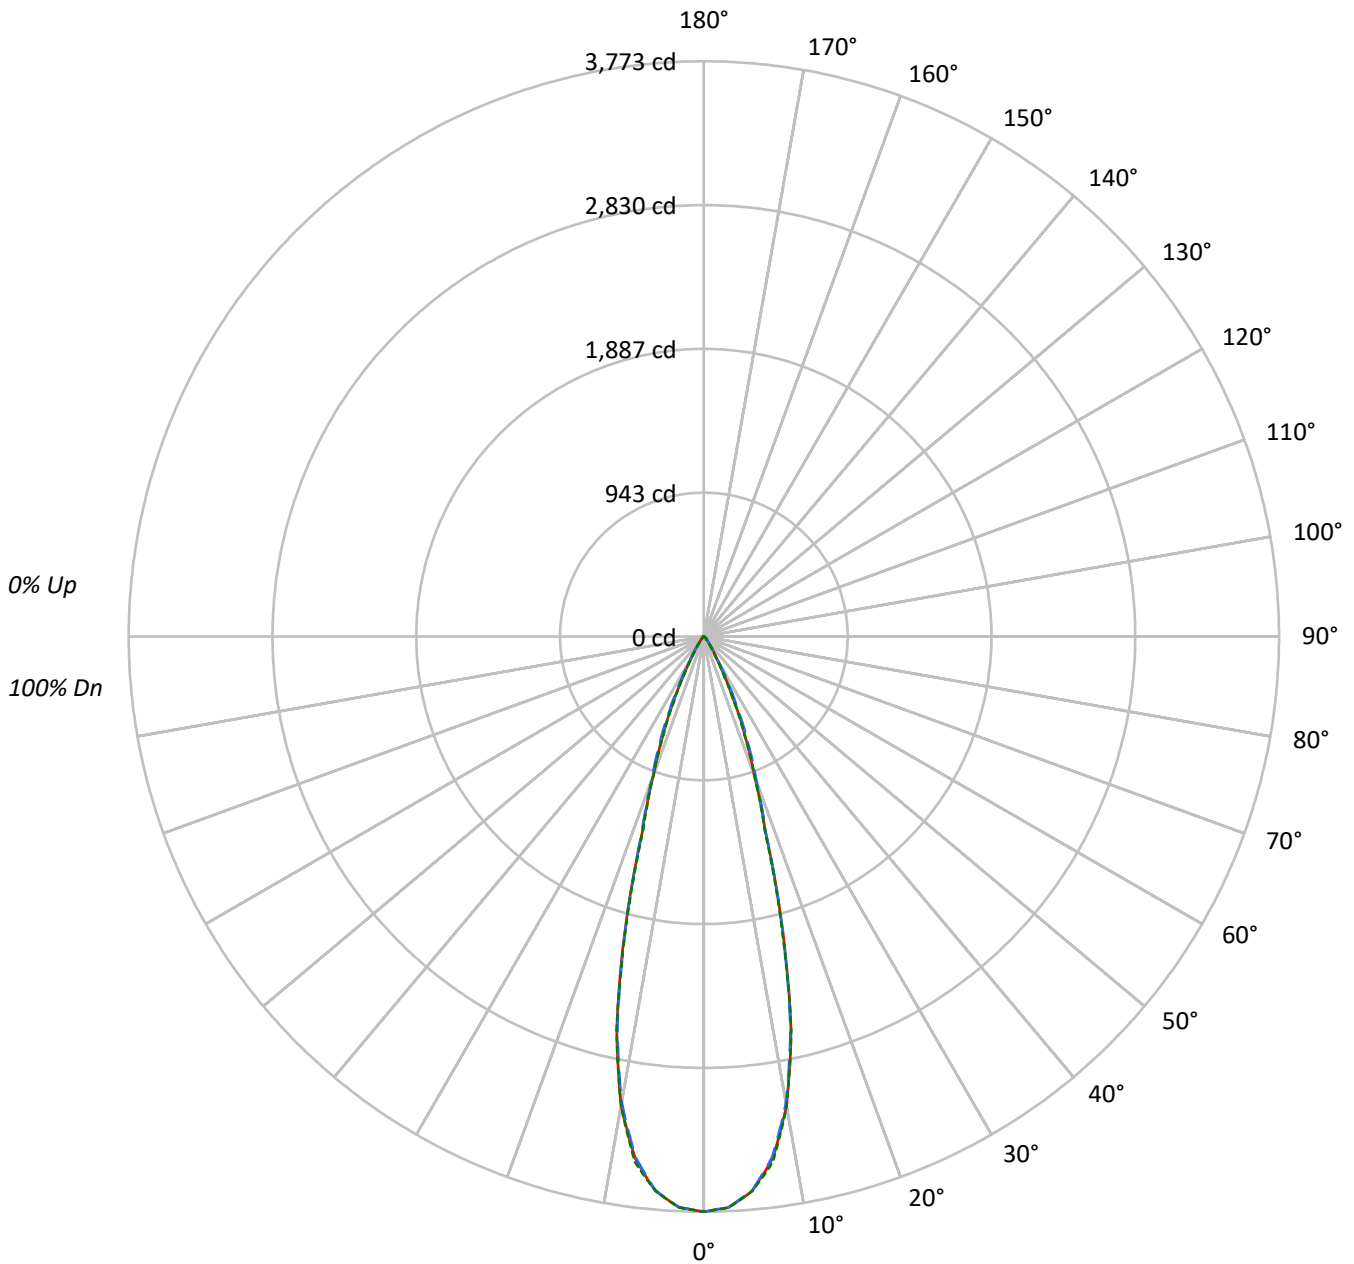



TEST NUMBER: P787723

CATALOG NUMBER: LER6D05D010-EC6DR300210IC9035-6LBS1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96						96													
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92						92													
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89						89													
4	103	98	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85						85													
5	100	94	89	86	98	93	89	86	91	88	85	90	86	84	88	86	83	82						82													
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79						79													
7	94	87	82	79	92	86	82	79	85	81	78	84	81	78	83	80	78	77						77													
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74						74													
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72						72													
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69						69													

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	288814	288814	288814
5°	280527	280197	280535
10°	242974	241264	242919
15°	158527	157679	156886
20°	78833	81790	78727
25°	39711	44779	38892
30°	15900	17323	13850
35°	7373	7064	5924
40°	3187	3537	2998
45°	2241	2793	2262
50°	774	2024	822
55°	440	841	467
60°	306	367	306
65°	199	199	199
70°	134	90	134
75°	0	59	0
80°	0	0	0
85°	0	0	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 22.5°

Vertical Angle: 45°

Luminance: 2793 cd/sqm



TEST NUMBER: P787723

CATALOG NUMBER: LER6D05D010-EC6DR300210IC9035-6LBS1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	331.8	28.3
10°-20°	534.4	45.5
20°-30°	230.9	19.7
30°-40°	52.6	4.5
40°-50°	18.1	1.5
50°-60°	4.4	0.4
60°-70°	1.1	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1097.1	93.5
0°-40°	1149.7	98.0
0°-60°	1172.2	99.9
0°-90°	1173.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1173.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3773	3773	3773	3773	3773	
5°	3651	3647	3647	3654	3651	332
15°	2000	1976	1990	1983	1980	536
25°	470	488	530	476	460	225
35°	79	81	76	75	63	54
45°	21	26	26	26	21	15
55°	3	4	6	4	4	3
65°	1	1	1	1	1	1
75°	0	0	0	0	0	0
85°	0	0	0	0	0	0
90°	0	0	0	0	0	



TEST NUMBER: P787723

CATALOG NUMBER: LER6D05D010-EC6DR300210IC9035-6LBS1B

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3773.2	3773.2	3773.2	3773.2	3773.2
2.5°	3748.2	3745.6	3747.1	3749.0	3749.7
5°	3651.0	3647.4	3646.7	3654.3	3651.1
7.5°	3454.8	3449.8	3442.2	3459.4	3475.5
10°	3126.1	3120.6	3104.1	3112.2	3125.4
12.5°	2641.0	2623.0	2622.6	2648.6	2645.0
15°	2000.5	1976.5	1989.8	1983.3	1979.8
17.5°	1345.3	1336.0	1353.8	1348.5	1325.3
20°	967.8	970.2	1004.1	987.0	966.5
22.5°	706.2	714.9	755.1	711.2	695.1
25°	470.2	488.0	530.2	475.5	460.5
27.5°	289.2	297.3	340.1	285.5	277.3
30°	179.9	175.8	196.0	168.2	156.7
32.5°	118.0	112.8	119.3	107.1	97.8
35°	78.9	80.6	75.6	75.0	63.4
37.5°	49.3	56.7	50.0	53.4	40.8
40°	31.9	41.1	35.4	39.1	30.0
42.5°	26.1	31.7	29.1	30.9	26.7
45°	20.7	25.8	25.8	25.8	20.9
47.5°	11.5	17.2	22.0	17.6	12.2
50°	6.5	8.7	17.0	9.1	6.9
52.5°	4.4	5.0	11.7	5.2	4.6
55°	3.3	3.5	6.3	3.7	3.5
57.5°	2.6	2.8	3.3	2.8	2.6
60°	2.0	2.0	2.4	2.2	2.0
62.5°	1.5	1.5	1.7	1.5	1.5
65°	1.1	1.1	1.1	1.1	1.1
67.5°	0.6	0.7	0.7	0.7	0.7
70°	0.6	0.4	0.4	0.4	0.6
72.5°	0.4	0.2	0.2	0.2	0.2
75°	0.0	0.0	0.2	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)