

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P787857

Luminaire Tested: LER6D05D010-EC6DR450210IC9030-6LBDP1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P787857
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D05D010-EC6DR450210IC9030-6LBDP1LI
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 45° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1240.4 lumens
Efficiency: N/A
Efficacy: 165.4 lumens/watt
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 7.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P787857
CATALOG NUMBER: LER6D05D010-EC6DR450210IC9030-6LBDP1LI

Luminous Intensity Polar Plot

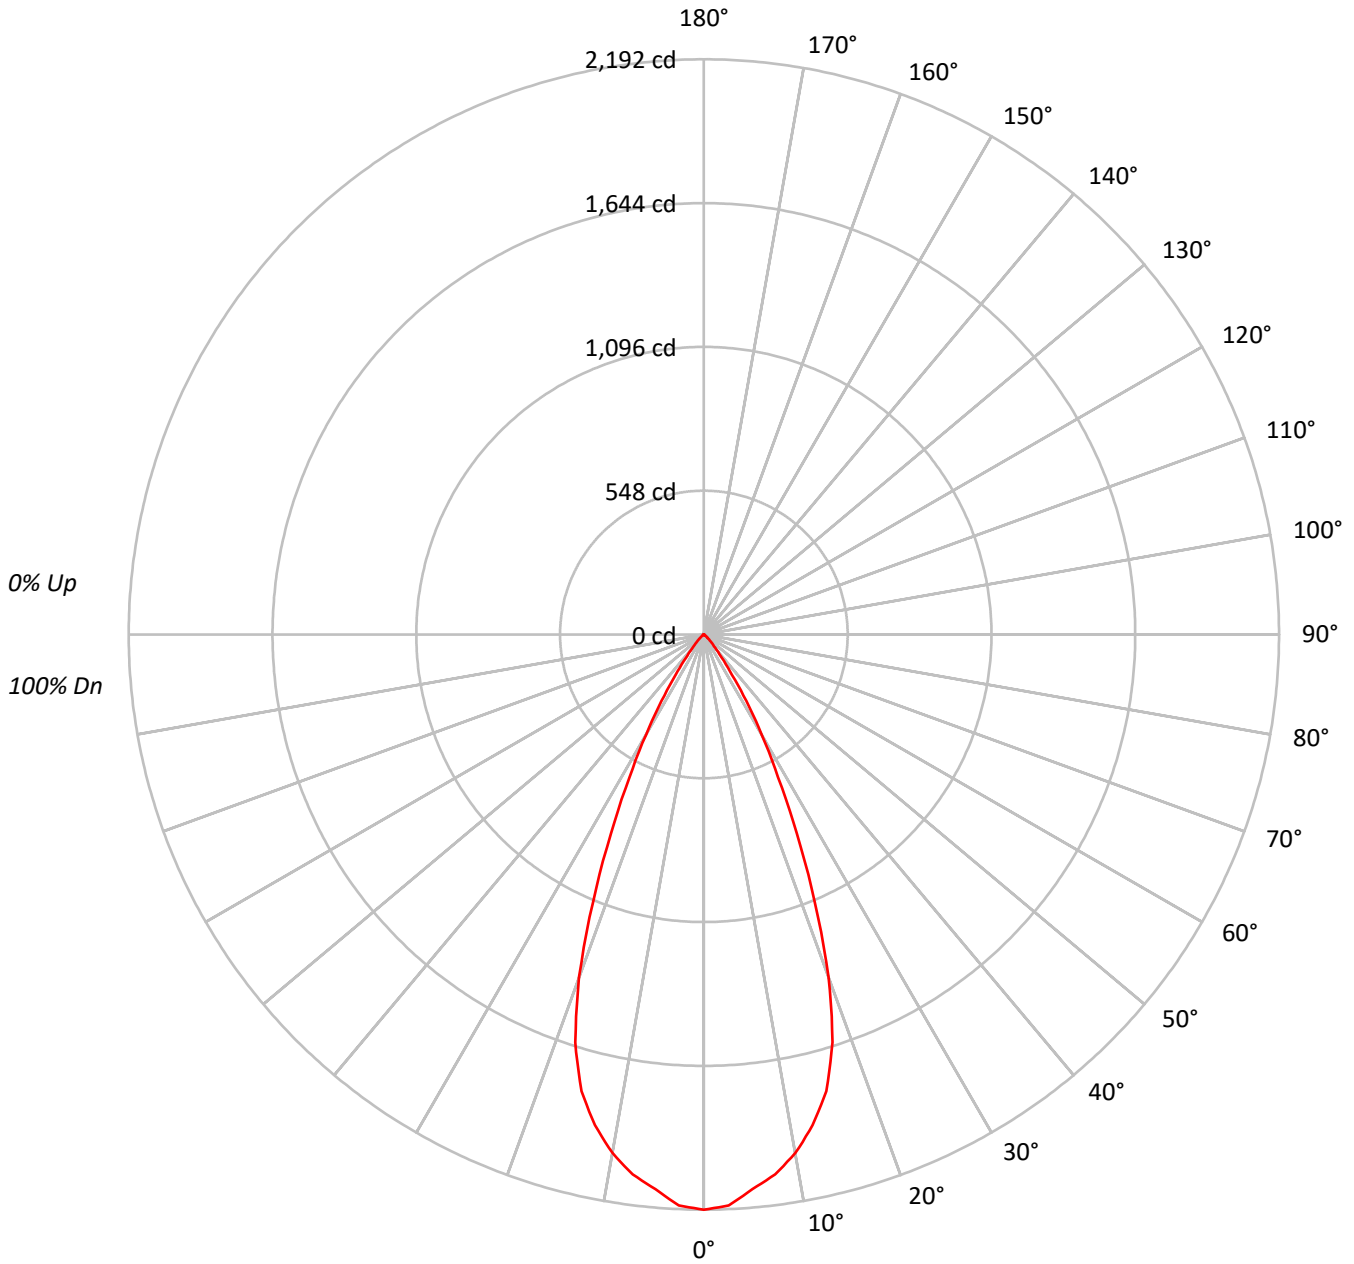



TEST NUMBER: P787857

CATALOG NUMBER: LER6D05D010-EC6DR450210IC9030-6LBDP1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100															
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95				95															
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90				90															
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85				85															
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81				81															
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77				77															
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73				73															
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69				69															
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66				66															
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63				63															
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60				60															

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	239532
5°	232715
10°	222647
15°	203765
20°	161654
25°	100929
30°	55625
35°	24983
40°	9841
45°	4636
50°	2193
55°	1143
60°	568
65°	129
70°	64
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 4636 cd/sqm



TEST NUMBER: P787857

CATALOG NUMBER: LER6D05D010-EC6DR450210IC9030-6LBDP1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	199.4	16.1
10°-20°	490.7	39.6
20°-30°	388.6	31.3
30°-40°	129.4	10.4
40°-50°	25.7	2.1
50°-60°	5.8	0.5
60°-70°	0.9	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1078.6	87.0
0°-40°	1208.0	97.4
0°-60°	1239.5	99.9
0°-90°	1240.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1240.4	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2192	
5°	2122	199
15°	1801	491
25°	837	389
35°	187	129
45°	30	26
55°	6	6
65°	0	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P787857

CATALOG NUMBER: LER6D05D010-EC6DR450210IC9030-6LBDP1LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	2192.3
2.5°	2178.0
5°	2121.8
7.5°	2075.4
10°	2006.8
12.5°	1915.4
15°	1801.4
17.5°	1630.0
20°	1390.3
22.5°	1104.8
25°	837.2
27.5°	613.0
30°	440.9
32.5°	299.9
35°	187.3
37.5°	111.0
40°	69.0
42.5°	45.4
45°	30.0
47.5°	19.3
50°	12.9
52.5°	8.6
55°	6.0
57.5°	4.0
60°	2.6
62.5°	1.4
65°	0.5
67.5°	0.2
70°	0.2
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)