

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P787905

Luminaire Tested: LER6D05D010-EC6DR500210IC9030-6LBDP1LI

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P787905  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-44)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LER6D05D010-EC6DR500210IC9030-6LBDP1LI  
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 50° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1256.2 lumens  
Efficiency: N/A  
Efficacy: 167.5 lumens/watt  
Spacing Criteria (0/90/45): 0.8 / 0.8 / 0.73  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 7.5  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight

TEST NUMBER: P787905

CATALOG NUMBER: LER6D05D010-EC6DR500210IC9030-6LBDP1LI

### Luminous Intensity Polar Plot

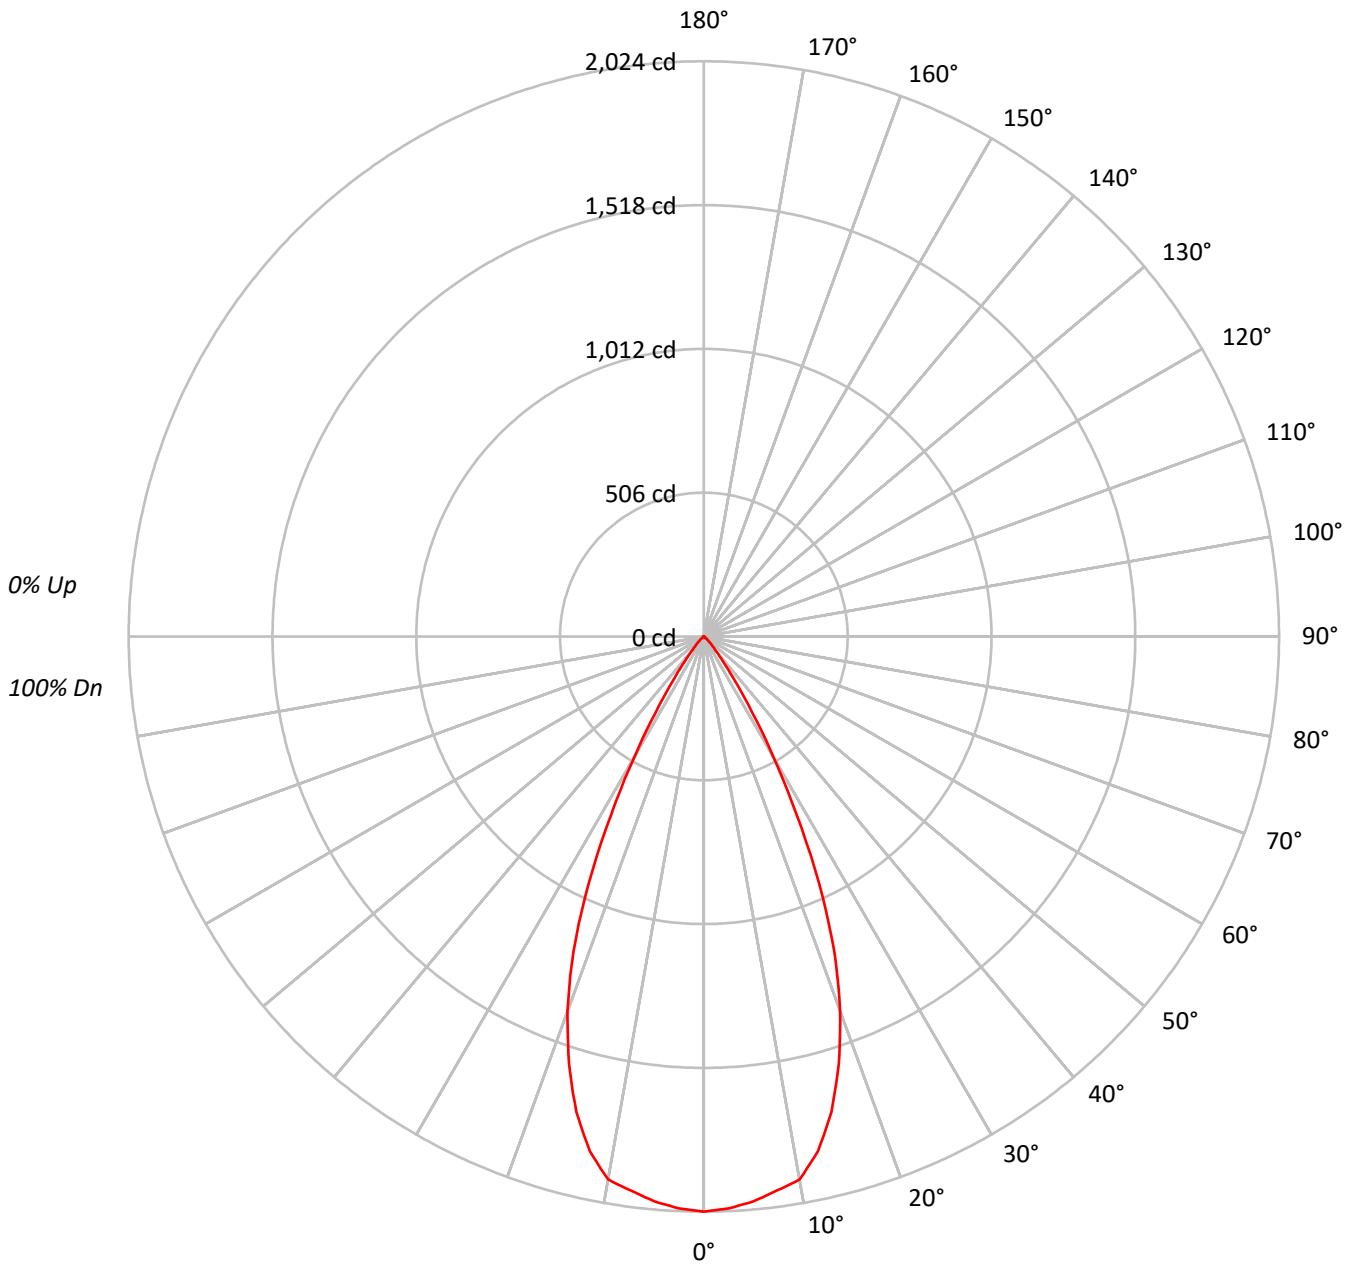



TEST NUMBER: P787905

CATALOG NUMBER: LER6D05D010-EC6DR500210IC9030-6LBDP1LI

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	114	112	109	107	112	110	108	106	106	104	102	102	101	99	98	97	97	95																			
2	109	105	101	98	107	103	100	97	100	98	95	97	95	93	95	93	91	90																			
3	105	99	95	91	103	98	94	90	95	92	89	93	90	88	91	88	86	85																			
4	100	94	89	85	99	93	88	85	90	87	84	89	85	83	87	84	82	80																			
5	96	89	84	80	95	88	83	79	86	82	79	85	81	78	83	80	77	76																			
6	92	84	79	75	91	83	79	75	82	78	74	81	77	74	79	76	74	72																			
7	88	80	75	71	87	79	74	71	78	74	71	77	73	70	76	73	70	69																			
8	85	76	71	67	84	76	71	67	75	70	67	74	70	67	73	69	66	65																			
9	81	73	68	64	80	72	67	64	71	67	64	71	67	64	70	66	63	62																			
10	78	70	64	61	77	69	64	61	68	64	61	68	64	61	67	63	60	59																			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	221166
5°	218841
10°	215236
15°	195994
20°	163084
25°	115770
30°	61278
35°	24969
40°	9271
45°	4249
50°	1734
55°	914
60°	437
65°	129
70°	0
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 4249 cd/sqm



TEST NUMBER: P787905

CATALOG NUMBER: LER6D05D010-EC6DR500210IC9030-6LBDP1LI

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	188.6	15.0
10°-20°	476.6	37.9
20°-30°	428.1	34.1
30°-40°	134.0	10.7
40°-50°	23.5	1.9
50°-60°	4.7	0.4
60°-70°	0.7	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1093.4	87.0
0°-40°	1227.4	97.7
0°-60°	1255.5	99.9
0°-90°	1256.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1256.2	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	2024	
5°	1995	189
15°	1733	477
25°	960	428
35°	187	134
45°	28	23
55°	5	5
65°	0	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P787905

CATALOG NUMBER: LER6D05D010-EC6DR500210IC9030-6LBDP1LI

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	2024.2
2.5°	2014.1
5°	1995.3
7.5°	1966.7
10°	1940.0
12.5°	1854.7
15°	1732.7
17.5°	1577.7
20°	1402.6
22.5°	1200.1
25°	960.3
27.5°	706.0
30°	485.7
32.5°	316.2
35°	187.2
37.5°	107.5
40°	65.0
42.5°	42.3
45°	27.5
47.5°	16.7
50°	10.2
52.5°	7.0
55°	4.8
57.5°	3.2
60°	2.0
62.5°	1.2
65°	0.5
67.5°	0.2
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)