

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P788009

Luminaire Tested: LER6D05D010-EC6DR600210IC9035-6LBDP1LI

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P788009
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-57)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D05D010-EC6DR600210IC9035-6LBDP1LI
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 60° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1282.1 lumens
Efficiency: N/A
Efficacy: 170.9 lumens/watt
Spacing Criteria (0/90/45): 0.91 / 0.91 / 0.84
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 7.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P788009
CATALOG NUMBER: LER6D05D010-EC6DR600210IC9035-6LBDP1LI

Luminous Intensity Polar Plot

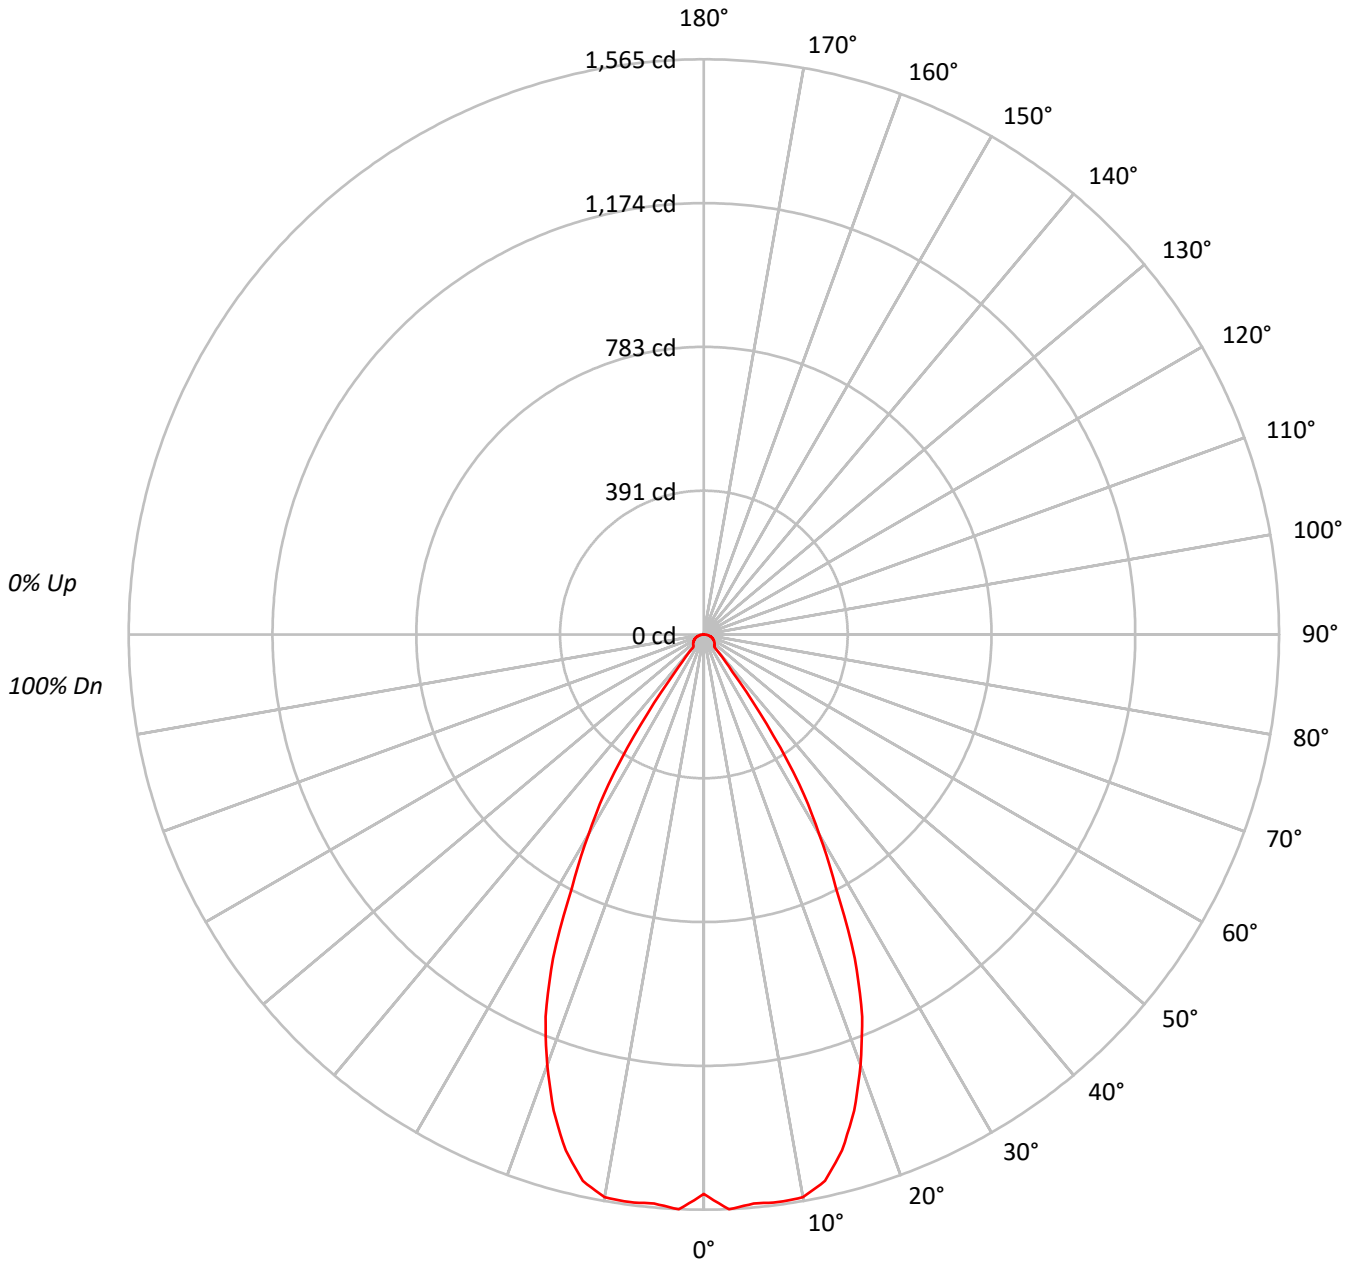



TEST NUMBER: P788009

CATALOG NUMBER: LER6D05D010-EC6DR600210IC9035-6LBDP1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	110	108	105	111	108	106	104	104	102	100	100	99	97	97	96	95	93	93	93	93
2	107	102	98	95	105	101	97	94	97	94	92	94	92	90	92	90	88	86	86	86	86
3	102	96	90	86	100	94	89	86	91	88	84	89	86	83	87	84	82	80	80	80	80
4	97	89	84	80	95	88	83	79	86	82	78	84	80	77	82	79	76	75	75	75	75
5	92	84	78	74	91	83	78	74	81	77	73	80	76	72	78	75	72	70	70	70	70
6	88	79	73	69	87	78	73	69	77	72	68	75	71	68	74	70	67	66	66	66	66
7	84	75	69	65	83	74	68	64	73	68	64	72	67	64	71	67	63	62	62	62	62
8	80	71	65	61	79	70	65	61	69	64	60	68	64	60	67	63	60	59	59	59	59
9	77	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55	55	55	55
10	73	64	58	54	72	63	58	54	62	58	54	62	57	54	61	57	54	53	53	53	53

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	166360
5°	170451
10°	172510
15°	164345
20°	144899
25°	117204
30°	79281
35°	39721
40°	6447
45°	6304
50°	6425
55°	6534
60°	6709
65°	6877
70°	7028
75°	7092
80°	6858
85°	5767

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 75°
 Luminance: 7092 cd/sqm



TEST NUMBER: P788009

CATALOG NUMBER: LER6D05D010-EC6DR600210IC9035-6LBDP1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	148.5	11.6
10°-20°	401.9	31.3
20°-30°	432.4	33.7
30°-40°	187.9	14.7
40°-50°	31.6	2.5
50°-60°	30.7	2.4
60°-70°	26.3	2.0
70°-80°	17.6	1.4
80°-90°	5.3	0.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	982.8	76.7
0°-40°	1170.8	91.3
0°-60°	1233.0	96.2
0°-90°	1282.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1282.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1523	
5°	1554	149
15°	1453	402
25°	972	432
35°	298	188
45°	41	32
55°	34	31
65°	27	26
75°	17	18
85°	5	5
90°	0	



TEST NUMBER: P788009

CATALOG NUMBER: LER6D05D010-EC6DR600210IC9035-6LBDP1LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	1522.6
2.5°	1565.4
5°	1554.1
7.5°	1557.7
10°	1554.9
12.5°	1522.8
15°	1452.9
17.5°	1359.0
20°	1246.2
22.5°	1125.5
25°	972.2
27.5°	777.6
30°	628.4
32.5°	484.3
35°	297.8
37.5°	127.4
40°	45.2
42.5°	41.6
45°	40.8
47.5°	39.4
50°	37.8
52.5°	36.1
55°	34.3
57.5°	32.5
60°	30.7
62.5°	28.7
65°	26.6
67.5°	24.4
70°	22.0
72.5°	19.4
75°	16.8
77.5°	13.9
80°	10.9
82.5°	7.7
85°	4.6
87.5°	1.6
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)