

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P788018

Luminaire Tested: LER6D05D010-EC6DR600210IC9040-6LBDP1MW

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P788018
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-57)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D05D010-EC6DR600210IC9040-6LBDP1MW
Description: 6 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 60° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1136.3 lumens
Efficiency: N/A
Efficacy: 151.5 lumens/watt
Spacing Criteria (0/90/45): 0.91 / 0.91 / 0.83
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 7.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P788018
CATALOG NUMBER: LER6D05D010-EC6DR600210IC9040-6LBDP1MW

Luminous Intensity Polar Plot

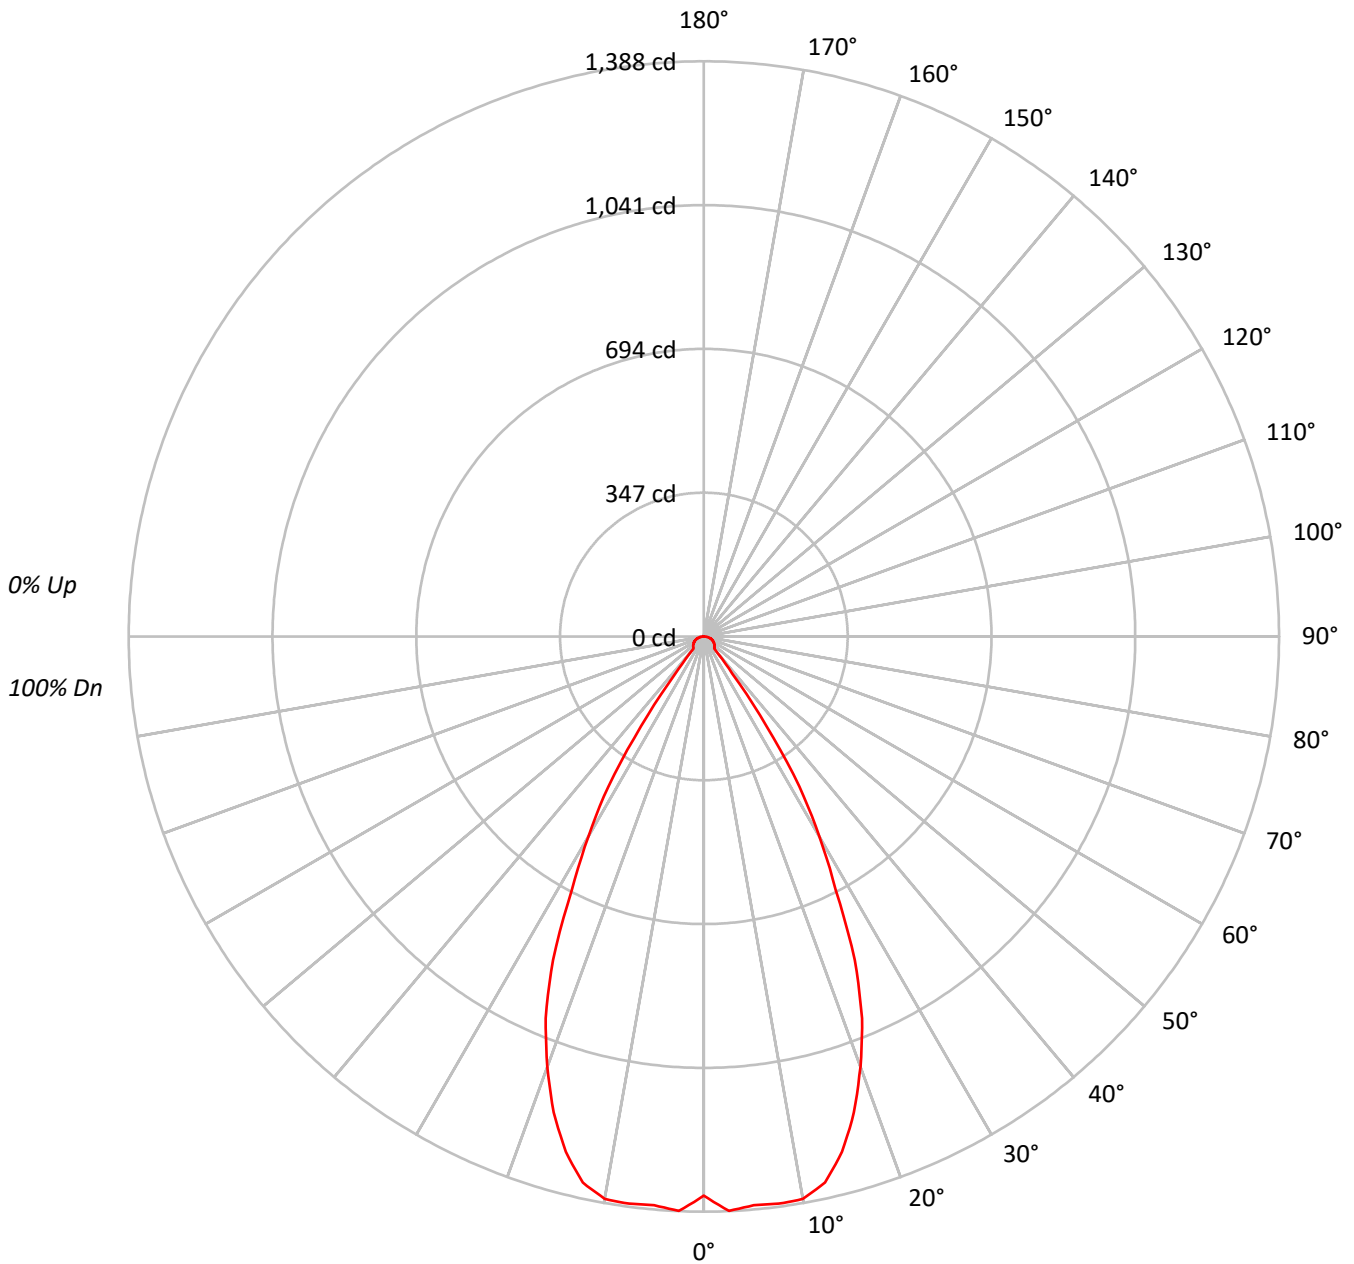



TEST NUMBER: P788018

CATALOG NUMBER: LER6D05D010-EC6DR600210IC9040-6LBDP1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	113	110	108	105	111	108	106	104	104	102	100	100	99	97	97	96	95	93			93
2	107	102	98	95	105	101	97	94	97	94	92	94	92	90	92	90	88	86			86
3	102	96	90	86	100	94	89	86	91	88	84	89	86	83	87	84	82	80			80
4	97	89	84	80	95	88	83	79	86	82	78	84	80	77	82	79	76	75			75
5	92	84	78	74	91	83	78	74	81	77	73	80	76	72	78	75	72	70			70
6	88	79	73	69	87	78	73	69	77	72	68	75	71	68	74	70	67	66			66
7	84	75	69	65	83	74	68	64	73	68	64	72	67	64	71	67	63	62			62
8	80	71	65	61	79	70	65	61	69	64	60	68	64	60	67	63	60	59			59
9	77	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55			55
10	73	64	58	54	72	63	58	54	62	58	54	62	57	54	61	57	54	53			53

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	147458
5°	151082
10°	152906
15°	145658
20°	128435
25°	103883
30°	70260
35°	35213
40°	5705
45°	5594
50°	5694
55°	5791
60°	5944
65°	6076
70°	6229
75°	6290
80°	6103
85°	5015

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 75°
 Luminance: 6290 cd/sqm



TEST NUMBER: P788018

CATALOG NUMBER: LER6D05D010-EC6DR600210IC9040-6LBDP1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	131.7	11.6
10°-20°	356.2	31.3
20°-30°	383.2	33.7
30°-40°	166.6	14.7
40°-50°	28.0	2.5
50°-60°	27.2	2.4
60°-70°	23.3	2.0
70°-80°	15.6	1.4
80°-90°	4.6	0.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	871.1	76.7
0°-40°	1037.7	91.3
0°-60°	1092.9	96.2
0°-90°	1136.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1136.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1350	
5°	1378	132
15°	1288	356
25°	862	383
35°	264	167
45°	36	28
55°	30	27
65°	24	23
75°	15	16
85°	4	5
90°	0	



TEST NUMBER: P788018

CATALOG NUMBER: LER6D05D010-EC6DR600210IC9040-6LBDP1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	1349.6
2.5°	1387.5
5°	1377.5
7.5°	1380.6
10°	1378.2
12.5°	1349.7
15°	1287.7
17.5°	1204.5
20°	1104.6
22.5°	997.6
25°	861.7
27.5°	689.2
30°	556.9
32.5°	429.2
35°	264.0
37.5°	112.9
40°	40.0
42.5°	36.9
45°	36.2
47.5°	35.0
50°	33.5
52.5°	32.0
55°	30.4
57.5°	28.8
60°	27.2
62.5°	25.5
65°	23.5
67.5°	21.6
70°	19.5
72.5°	17.2
75°	14.9
77.5°	12.3
80°	9.7
82.5°	6.8
85°	4.0
87.5°	1.4
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)