

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P788049

Luminaire Tested: LER6D05D010-EC6DR650210IC9030-6LBDP1LI

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P788049
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D05D010-EC6DR650210IC9030-6LBDP1LI
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1061.1 lumens
Efficiency: N/A
Efficacy: 141.5 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 7.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P788049
CATALOG NUMBER: LER6D05D010-EC6DR650210IC9030-6LBDP1LI

Luminous Intensity Polar Plot

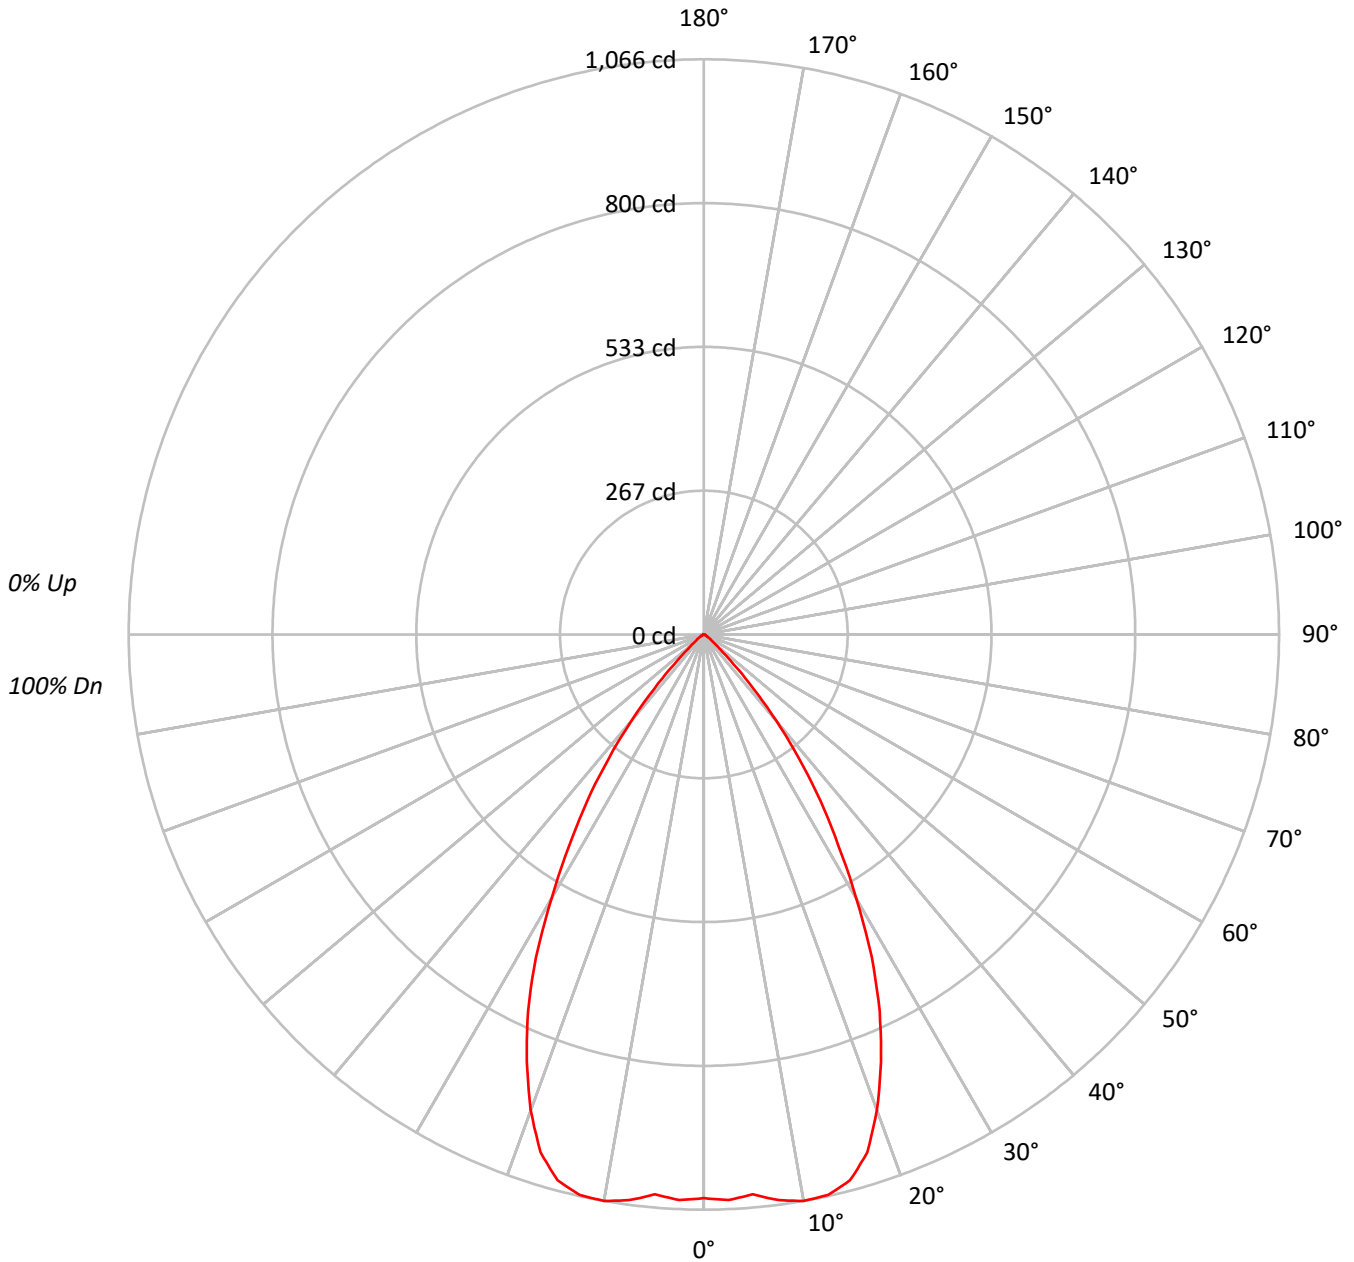



TEST NUMBER: P788049

CATALOG NUMBER: LER6D05D010-EC6DR650210IC9030-6LBDP1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93			
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87			
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80			
4	97	89	84	79	95	88	83	79	86	82	78	84	80	77	82	79	76	75			
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69			
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65			
7	83	73	67	63	81	73	67	63	71	66	62	70	66	62	69	65	62	60			
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	57			
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53			
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	114156
5°	114252
10°	118269
15°	118465
20°	109064
25°	92937
30°	71144
35°	50259
40°	29667
45°	12037
50°	4368
55°	2438
60°	1399
65°	776
70°	799
75°	633
80°	629
85°	501

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 12037 cd/sqm



TEST NUMBER: P788049

CATALOG NUMBER: LER6D05D010-EC6DR650210IC9030-6LBDP1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	100.6	9.5
10°-20°	290.2	27.3
20°-30°	348.2	32.8
30°-40°	234.0	22.1
40°-50°	70.1	6.6
50°-60°	12.4	1.2
60°-70°	3.5	0.3
70°-80°	1.7	0.2
80°-90°	0.5	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	739.0	69.6
0°-40°	973.0	91.7
0°-60°	1055.4	99.5
0°-90°	1061.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1061.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1045	
5°	1042	101
15°	1047	290
25°	771	348
35°	377	234
45°	78	70
55°	13	12
65°	3	4
75°	2	2
85°	0	1
90°	0	



TEST NUMBER: P788049

CATALOG NUMBER: LER6D05D010-EC6DR650210IC9030-6LBDP1LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	1044.8
2.5°	1049.2
5°	1041.7
7.5°	1057.4
10°	1066.0
12.5°	1063.9
15°	1047.3
17.5°	1006.6
20°	938.0
22.5°	857.3
25°	770.9
27.5°	673.3
30°	563.9
32.5°	464.7
35°	376.8
37.5°	290.0
40°	208.0
42.5°	135.9
45°	77.9
47.5°	41.3
50°	25.7
52.5°	17.8
55°	12.8
57.5°	9.2
60°	6.4
62.5°	4.2
65°	3.0
67.5°	2.7
70°	2.5
72.5°	1.9
75°	1.5
77.5°	1.3
80°	1.0
82.5°	0.7
85°	0.4
87.5°	0.3
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)