

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P788380

Luminaire Tested: LER6D08D010-EC6DR350210IC9027-6LBS1H

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P788380  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-20)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LER6D08D010-EC6DR350210IC9027-6LBS1H  
Description: 6 INCH ROUND SHALLOW SEMI-SPECULAR CLEAR TRIM, WITH 35° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1321.2 lumens  
Efficiency: N/A  
Efficacy: 148.5 lumens/watt  
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.54  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct


Input Watts (W): 8.9  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



Downlight

TEST NUMBER: P788380  
CATALOG NUMBER: LER6D08D010-EC6DR350210IC9027-6LBS1H

### Luminous Intensity Polar Plot

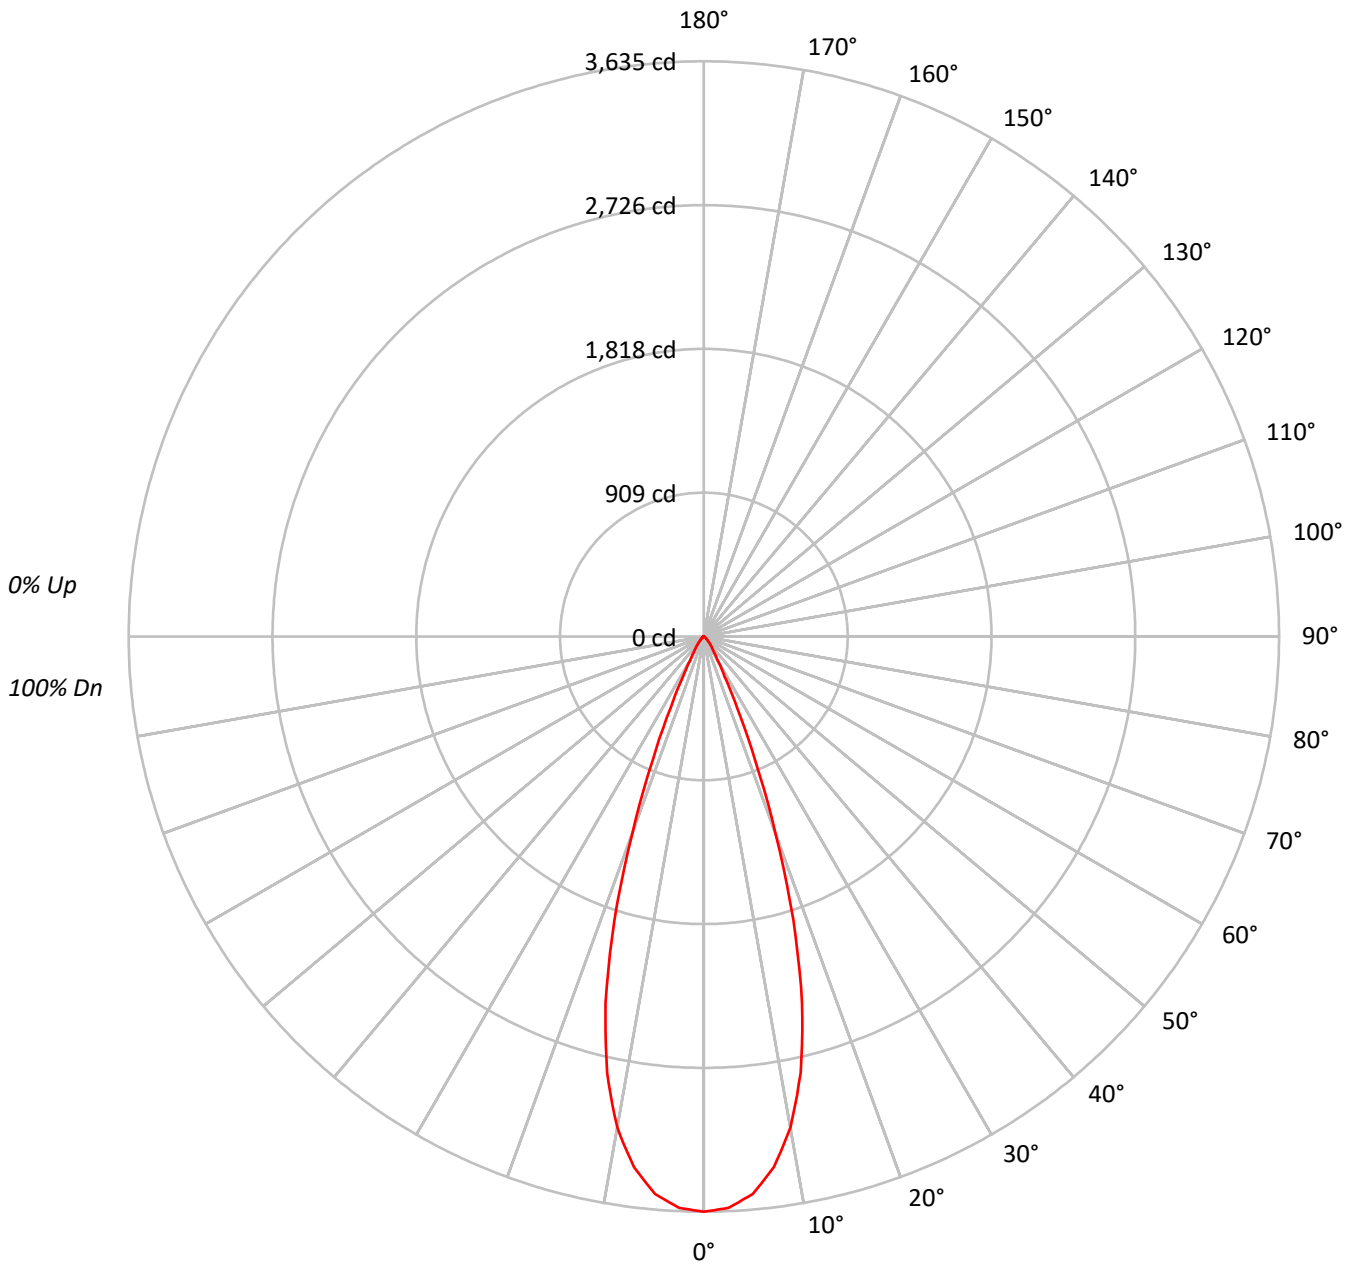



TEST NUMBER: P788380

CATALOG NUMBER: LER6D08D010-EC6DR350210IC9027-6LBS1H

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	98	96
2	110	106	103	101	108	105	102	99	102	99	97	99	97	95	96	95	93	92
3	106	101	97	94	105	100	96	93	97	95	92	95	93	91	93	91	89	88
4	103	97	92	89	101	96	92	89	94	90	88	92	89	87	90	88	86	84
5	99	93	88	85	98	92	87	84	90	86	84	89	85	83	87	84	82	81
6	96	89	84	81	94	88	84	81	87	83	80	85	82	80	84	81	79	78
7	93	85	81	78	91	85	80	77	84	80	77	83	79	77	82	79	76	75
8	90	82	78	74	88	82	77	74	81	77	74	80	76	74	79	76	73	72
9	87	79	75	72	86	79	75	72	78	74	71	77	74	71	77	73	71	70
10	84	77	72	69	83	76	72	69	76	72	69	75	71	69	74	71	69	68

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	397207
5°	387877
10°	349581
15°	271329
20°	153887
25°	59868
30°	22331
35°	12245
40°	8002
45°	4867
50°	3094
55°	2191
60°	1595
65°	879
70°	64
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 4867 cd/sqm



TEST NUMBER: P788380

CATALOG NUMBER: LER6D08D010-EC6DR350210IC9027-6LBS1H

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	325.3	24.6
10°-20°	635.0	48.1
20°-30°	259.0	19.6
30°-40°	62.0	4.7
40°-50°	25.8	2.0
50°-60°	10.7	0.8
60°-70°	3.4	0.3
70°-80°	0.1	0.0
80°-90°	0.1	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1219.3	92.3
0°-40°	1281.2	97.0
0°-60°	1317.7	99.7
0°-90°	1321.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1321.2	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	3635	
5°	3536	325
15°	2399	635
25°	497	259
35°	92	62
45°	32	26
55°	12	11
65°	3	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P788380

CATALOG NUMBER: LER6D08D010-EC6DR350210IC9027-6LBS1H

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	3635.4
2.5°	3613.6
5°	3536.5
7.5°	3382.6
10°	3150.9
12.5°	2824.5
15°	2398.7
17.5°	1877.9
20°	1323.5
22.5°	844.0
25°	496.6
27.5°	280.7
30°	177.0
32.5°	124.3
35°	91.8
37.5°	71.0
40°	56.1
42.5°	43.2
45°	31.5
47.5°	23.6
50°	18.2
52.5°	14.5
55°	11.5
57.5°	9.3
60°	7.3
62.5°	5.4
65°	3.4
67.5°	1.2
70°	0.2
72.5°	0.2
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.2
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)