

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P788631

Luminaire Tested: LER6D08D010-EC6DR600210IC9035-6LBDP1B

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P788631
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-57)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D08D010-EC6DR600210IC9035-6LBDP1B
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 60° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1131.2 lumens
Efficiency: N/A
Efficacy: 127.1 lumens/watt
Spacing Criteria (0/90/45): 0.91 / 0.91 / 0.83
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 8.9
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P788631

CATALOG NUMBER: LER6D08D010-EC6DR600210IC9035-6LBDP1B

Luminous Intensity Polar Plot

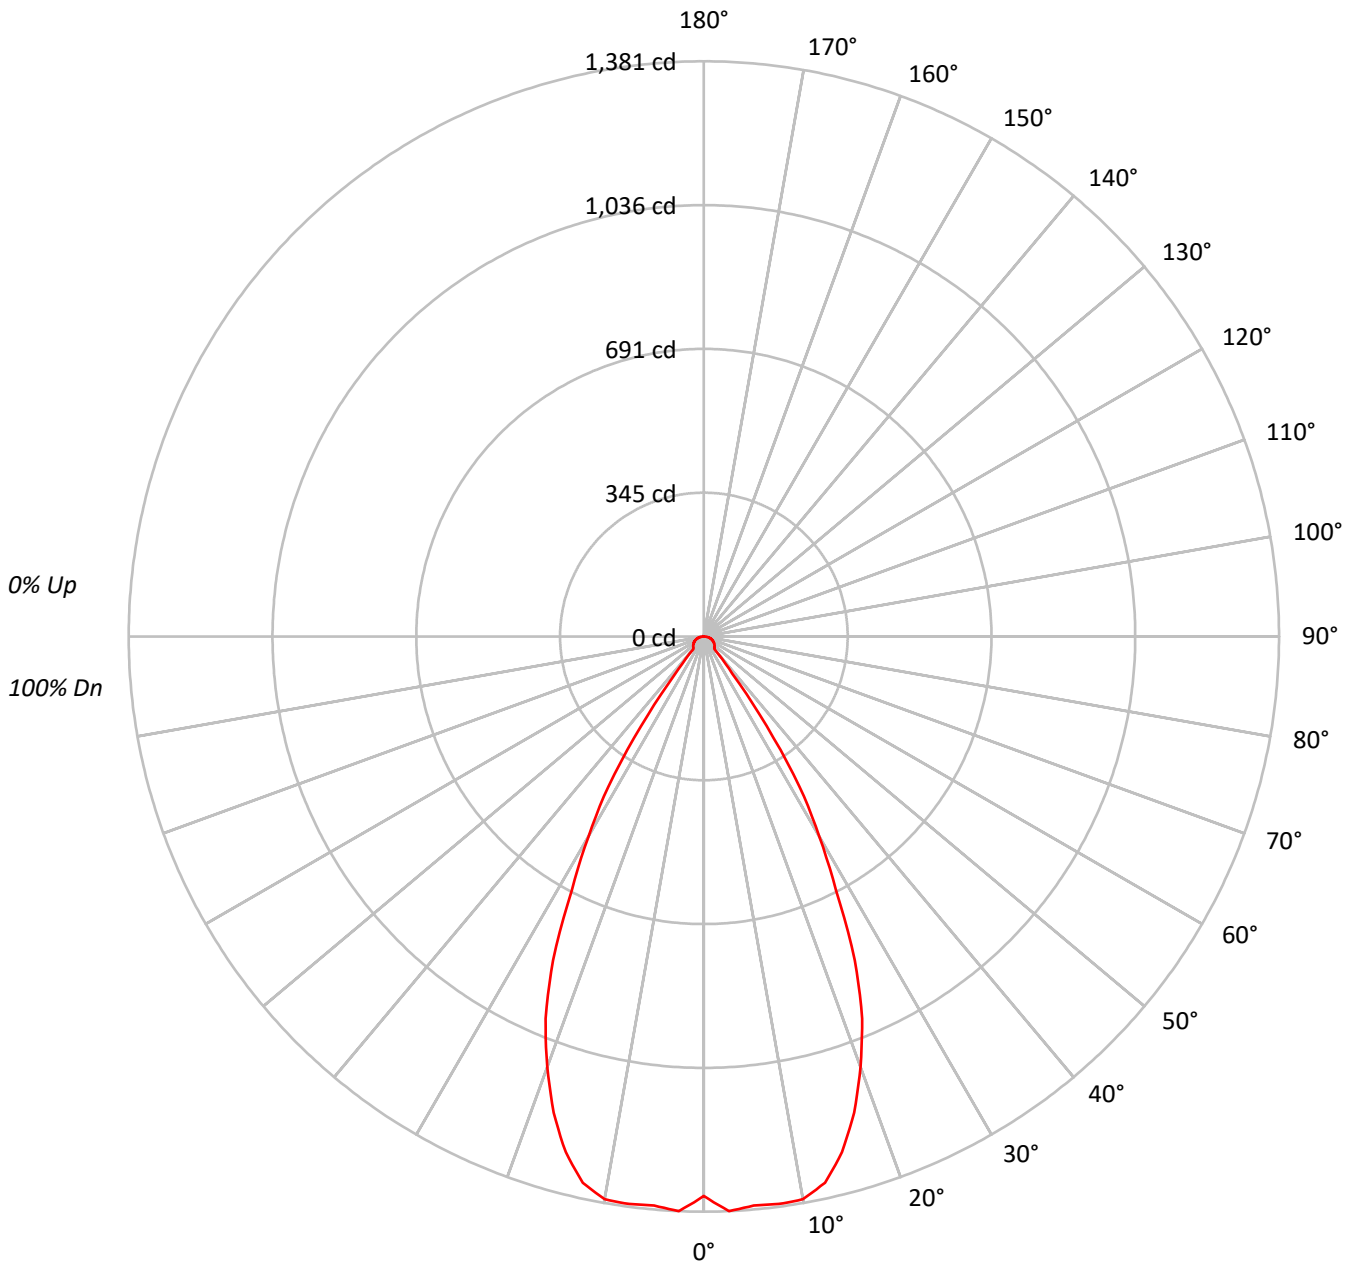



TEST NUMBER: P788631

CATALOG NUMBER: LER6D08D010-EC6DR600210IC9035-6LBDP1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	113	110	108	105	111	108	106	104	104	102	100	100	99	97	97	96	95	93																			
2	107	102	98	95	105	101	97	94	97	94	92	94	92	90	92	90	88	86																			
3	102	96	90	86	100	94	89	86	91	88	84	89	86	83	87	84	82	80																			
4	97	89	84	80	95	88	83	79	86	82	78	84	80	77	82	79	76	75																			
5	92	84	78	74	91	83	78	74	81	77	73	80	76	72	78	75	72	70																			
6	88	79	73	69	87	78	73	69	77	72	68	75	71	68	74	70	67	66																			
7	84	75	69	65	83	74	68	64	73	68	64	72	67	64	71	67	63	62																			
8	80	71	65	61	79	70	65	61	69	64	60	68	64	60	67	63	60	59																			
9	77	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55																			
10	73	64	58	54	72	63	58	54	62	58	54	62	57	54	61	57	54	53																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	146792
5°	150402
10°	152218
15°	145002
20°	127854
25°	103413
30°	69945
35°	35053
40°	5691
45°	5563
50°	5677
55°	5753
60°	5922
65°	6050
70°	6197
75°	6290
80°	6040
85°	5015

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 75°
 Luminance: 6290 cd/sqm



TEST NUMBER: P788631

CATALOG NUMBER: LER6D08D010-EC6DR600210IC9035-6LBDP1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	131.1	11.6
10°-20°	354.6	31.3
20°-30°	381.5	33.7
30°-40°	165.8	14.7
40°-50°	27.9	2.5
50°-60°	27.1	2.4
60°-70°	23.2	2.0
70°-80°	15.5	1.4
80°-90°	4.6	0.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	867.2	76.7
0°-40°	1033.0	91.3
0°-60°	1087.9	96.2
0°-90°	1131.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1131.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1344	
5°	1371	131
15°	1282	355
25°	858	382
35°	263	166
45°	36	28
55°	30	27
65°	23	23
75°	15	15
85°	4	5
90°	0	



TEST NUMBER: P788631

CATALOG NUMBER: LER6D08D010-EC6DR600210IC9035-6LBDP1B

CANDELA DISTRIBUTION (FULL):

	0°
0°	1343.5
2.5°	1381.2
5°	1371.3
7.5°	1374.4
10°	1372.0
12.5°	1343.6
15°	1281.9
17.5°	1199.0
20°	1099.6
22.5°	993.1
25°	857.8
27.5°	686.1
30°	554.4
32.5°	427.3
35°	262.8
37.5°	112.4
40°	39.9
42.5°	36.7
45°	36.0
47.5°	34.8
50°	33.4
52.5°	31.8
55°	30.2
57.5°	28.7
60°	27.1
62.5°	25.4
65°	23.4
67.5°	21.5
70°	19.4
72.5°	17.1
75°	14.9
77.5°	12.2
80°	9.6
82.5°	6.8
85°	4.0
87.5°	1.4
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)