

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P788690

Luminaire Tested: LER6D08D010-EC6DR650210IC9040-6LBDP1MW

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P788690
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D08D010-EC6DR650210IC9040-6LBDP1MW
Description: 6 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1112.9 lumens
Efficiency: N/A
Efficacy: 125.0 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 8.9
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P788690

CATALOG NUMBER: LER6D08D010-EC6DR650210IC9040-6LBDP1MW

Luminous Intensity Polar Plot

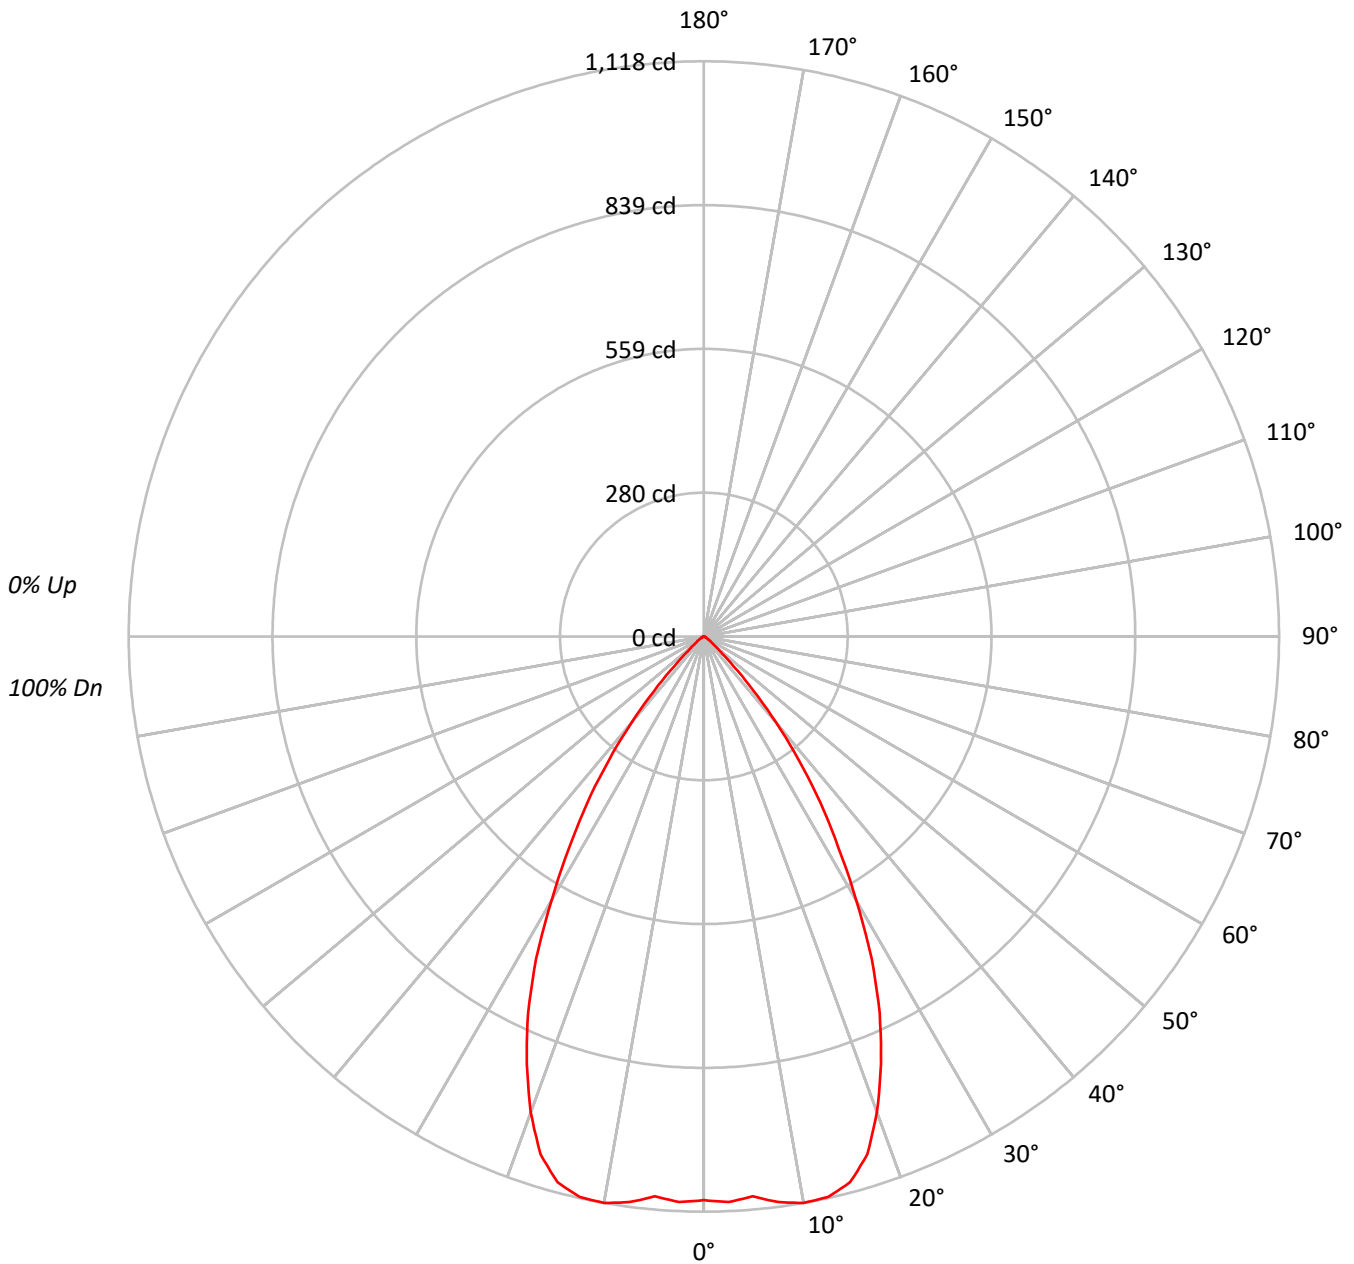



TEST NUMBER: P788690

CATALOG NUMBER: LER6D08D010-EC6DR650210IC9040-6LBDP1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93																			
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87																			
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80																			
4	97	89	84	79	95	88	83	79	86	82	78	84	80	77	82	79	76	75																			
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69																			
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65																			
7	83	73	67	63	81	73	67	63	71	66	62	70	66	62	69	65	62	60																			
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	57																			
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53																			
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	119717
5°	119823
10°	124038
15°	124246
20°	114389
25°	97457
30°	74613
35°	52713
40°	31108
45°	12624
50°	4572
55°	2553
60°	1464
65°	801
70°	831
75°	675
80°	692
85°	627

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 12624 cd/sqm



TEST NUMBER: P788690

CATALOG NUMBER: LER6D08D010-EC6DR650210IC9040-6LBDP1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	105.5	9.5
10°-20°	304.3	27.3
20°-30°	365.2	32.8
30°-40°	245.4	22.1
40°-50°	73.5	6.6
50°-60°	13.0	1.2
60°-70°	3.7	0.3
70°-80°	1.8	0.2
80°-90°	0.6	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	775.0	69.6
0°-40°	1020.4	91.7
0°-60°	1106.8	99.5
0°-90°	1112.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1112.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1096	
5°	1092	106
15°	1098	304
25°	808	365
35°	395	245
45°	82	73
55°	13	13
65°	3	4
75°	2	2
85°	0	1
90°	0	



TEST NUMBER: P788690

CATALOG NUMBER: LER6D08D010-EC6DR650210IC9040-6LBDP1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	1095.7
2.5°	1100.4
5°	1092.5
7.5°	1109.0
10°	1118.0
12.5°	1115.8
15°	1098.4
17.5°	1055.7
20°	983.8
22.5°	899.1
25°	808.4
27.5°	706.1
30°	591.4
32.5°	487.4
35°	395.2
37.5°	304.1
40°	218.1
42.5°	142.5
45°	81.7
47.5°	43.3
50°	26.9
52.5°	18.7
55°	13.4
57.5°	9.7
60°	6.7
62.5°	4.4
65°	3.1
67.5°	2.8
70°	2.6
72.5°	2.0
75°	1.6
77.5°	1.4
80°	1.1
82.5°	0.8
85°	0.5
87.5°	0.3
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)