

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P788815

Luminaire Tested: LER6D10D010-EC6DR150210IC9030-6LBDP1B

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P788815
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-21)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D10D010-EC6DR150210IC9030-6LBDP1B
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 15° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 981.0 lumens
Efficiency: N/A
Efficacy: 83.8 lumens/watt
Spacing Criteria (0/90/45): 0.22 / 0.22 / 0.23
Luminous Opening: Vertical Cylinder (Dia: 0.35' x H: 0.35')
CIE Type: Direct

Input Watts (W): 11.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P788815

CATALOG NUMBER: LER6D10D010-EC6DR150210IC9030-6LBDP1B

Luminous Intensity Polar Plot

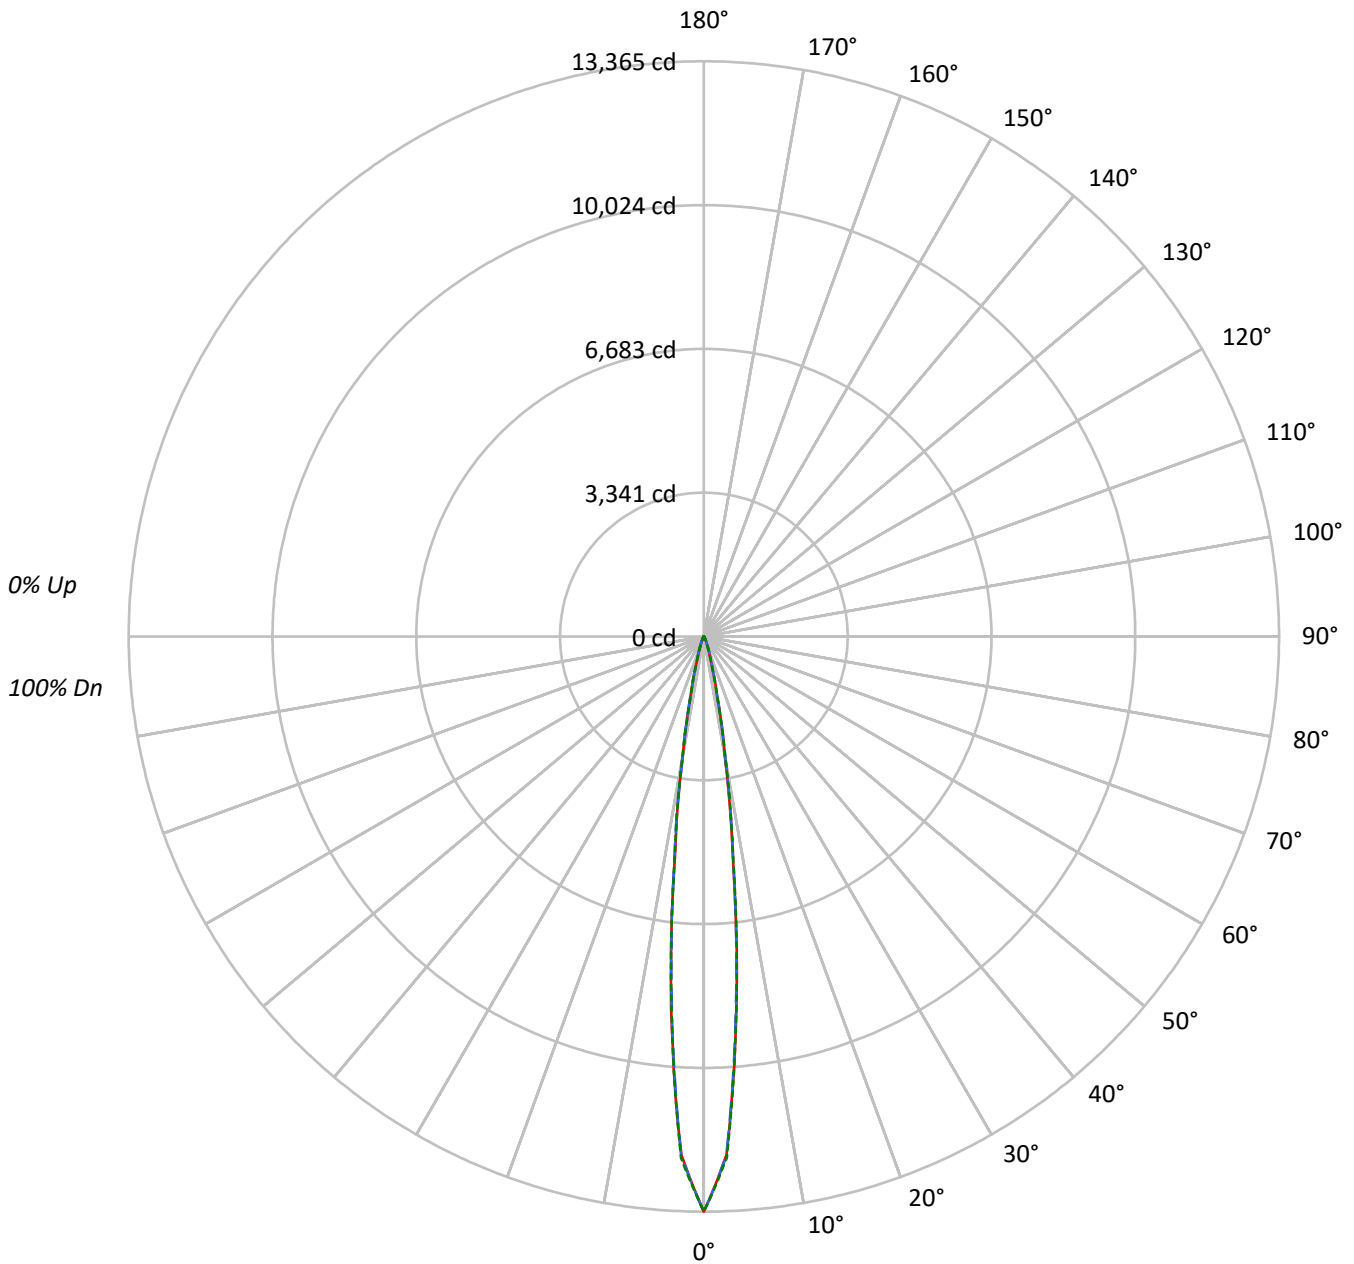



TEST NUMBER: P788815

CATALOG NUMBER: LER6D10D010-EC6DR150210IC9030-6LBDP1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	116	114	112	111	113	112	110	109	108	107	106	104	103	103	101	100	100	98																			
2	113	110	107	105	111	108	106	104	105	103	102	102	101	100	100	98	98	96																			
3	110	106	103	101	108	105	102	100	103	100	99	100	99	97	98	97	96	94																			
4	108	103	100	98	106	102	99	97	100	98	96	99	97	95	97	95	94	93																			
5	106	101	98	95	104	100	97	95	98	96	94	97	95	93	96	94	92	92																			
6	104	99	95	93	102	98	95	93	97	94	92	96	93	92	95	93	91	90																			
7	102	97	94	91	101	96	93	91	95	93	91	94	92	90	93	91	90	89																			
8	100	95	92	90	99	95	92	90	94	91	89	93	91	89	92	90	89	88																			
9	99	93	90	88	98	93	90	88	92	90	88	92	89	88	91	89	88	87																			
10	97	92	89	87	96	92	89	87	91	89	87	91	88	87	90	88	86	86																			

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1503840	1503840	1503840
5°	883724	872291	879181
10°	263753	265600	269668
15°	65603	66880	64821
20°	19629	22730	20047
25°	6918	8818	7011
30°	2538	3347	2583
35°	1271	1438	1235
40°	802	881	802
45°	595	637	595
50°	473	473	473
55°	397	397	397
60°	316	316	316
65°	243	243	243
70°	205	205	205
75°	128	128	174
80°	87	87	87
85°	50	50	50

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 45°

Vertical Angle: 45°

Luminance: 637 cd/sqm



TEST NUMBER: P788815

CATALOG NUMBER: LER6D10D010-EC6DR150210IC9030-6LBDP1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	636.2	64.9
10°-20°	261.7	26.7
20°-30°	52.0	5.3
30°-40°	13.0	1.3
40°-50°	6.8	0.7
50°-60°	5.1	0.5
60°-70°	3.6	0.4
70°-80°	2.0	0.2
80°-90°	0.6	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	949.9	96.8
0°-40°	962.8	98.2
0°-60°	974.7	99.4
0°-90°	981.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	981.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	13365	13365	13365	13365	13365	
5°	8696	8606	8583	8642	8651	635
15°	755	770	770	756	746	259
25°	89	101	113	100	90	47
35°	18	19	20	19	17	12
45°	8	8	9	8	8	7
55°	6	6	6	6	6	5
65°	3	3	3	3	3	4
75°	2	2	2	2	2	2
85°	1	1	1	1	1	1
90°	0	0	0	0	0	



TEST NUMBER: P788815

CATALOG NUMBER: LER6D10D010-EC6DR150210IC9030-6LBDP1B

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	13365.1	13365.1	13365.1	13365.1	13365.1
2.5°	12055.9	12066.1	12070.0	12081.9	12126.0
5°	8695.6	8606.2	8583.1	8642.5	8650.9
7.5°	5151.0	5169.1	5235.3	5250.0	5196.8
10°	2826.7	2849.9	2846.5	2866.9	2890.1
12.5°	1445.6	1427.5	1421.8	1445.0	1412.8
15°	755.3	769.5	770.0	756.5	746.3
17.5°	406.2	422.6	449.8	427.7	393.8
20°	239.9	254.6	277.8	259.7	245.0
22.5°	148.2	160.1	176.5	162.4	150.5
25°	88.8	100.7	113.2	100.1	90.0
27.5°	52.6	62.8	70.7	62.2	52.1
30°	33.9	39.6	44.7	39.0	34.5
32.5°	23.8	26.0	28.3	26.0	23.8
35°	17.5	18.7	19.8	18.7	17.0
37.5°	13.6	14.7	15.3	14.1	13.0
40°	11.3	11.9	12.4	11.9	11.3
42.5°	9.6	10.2	10.2	10.2	9.6
45°	8.5	8.5	9.1	8.5	8.5
47.5°	7.4	7.4	7.9	7.4	7.4
50°	6.8	6.8	6.8	6.8	6.8
52.5°	6.2	6.2	6.2	6.2	6.2
55°	5.7	5.7	5.7	5.7	5.7
57.5°	5.1	5.1	5.1	5.1	5.1
60°	4.5	4.5	4.5	4.5	4.5
62.5°	4.0	4.0	4.0	4.0	4.0
65°	3.4	3.4	3.4	3.4	3.4
67.5°	3.4	3.4	3.4	3.4	3.4
70°	2.8	2.8	2.8	2.8	2.8
72.5°	2.3	2.3	2.3	2.3	2.3
75°	1.7	1.7	1.7	1.7	2.3
77.5°	1.7	1.7	1.7	1.7	1.7
80°	1.1	1.1	1.1	1.1	1.1
82.5°	1.1	1.1	1.1	1.1	1.1
85°	0.6	0.6	0.6	0.6	0.6
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)