

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P788880

Luminaire Tested: LER6D10D010-EC6DR200210IC9040-6LBDP1H

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P788880  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-36)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LER6D10D010-EC6DR200210IC9040-6LBDP1H  
Description: 6 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 20° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1194.8 lumens  
Efficiency: N/A  
Efficacy: 102.1 lumens/watt  
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.36  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 11.7  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight

TEST NUMBER: P788880

CATALOG NUMBER: LER6D10D010-EC6DR200210IC9040-6LBDP1H

### Luminous Intensity Polar Plot

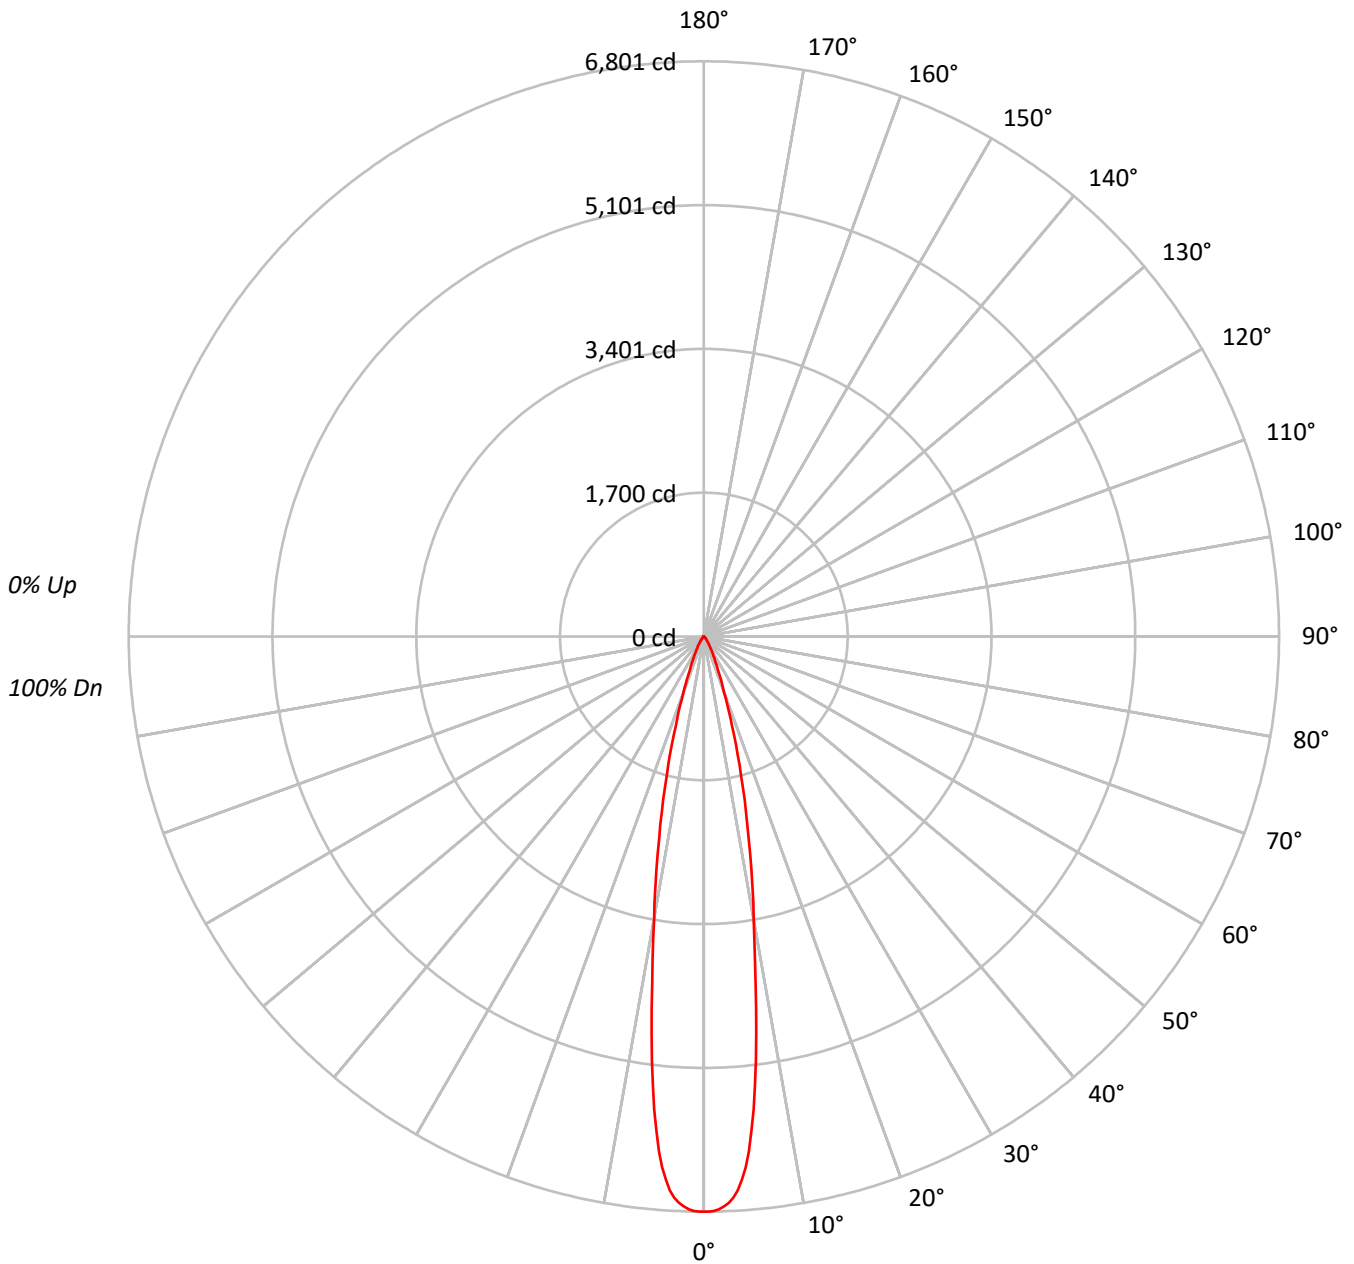



TEST NUMBER: P788880

CATALOG NUMBER: LER6D10D010-EC6DR200210IC9040-6LBDP1H

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100																
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	97	97	98	97																
2	111	108	105	102	109	106	104	101	103	101	99	100	99	97	98	96	95	94	94	98	94																
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	93	92	91	91	95	91																
4	105	99	96	93	103	98	95	92	96	93	91	95	92	90	93	91	89	88	88	93	89																
5	102	96	92	89	100	95	91	89	94	90	88	92	89	87	91	88	86	85	85	91	86																
6	99	93	89	86	98	92	88	86	91	87	85	90	87	84	88	86	84	83	83	88	84																
7	96	90	86	83	95	89	86	83	88	85	82	87	84	82	86	84	82	81	81	86	82																
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	80	79	79	84	80																
9	91	85	81	78	91	85	81	78	84	80	78	83	80	78	82	80	78	77	77	82	78																
10	89	83	79	76	88	82	79	76	82	78	76	81	78	76	81	78	76	75	75	81	76																

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	743050
5°	670364
10°	376241
15°	191255
20°	80972
25°	37384
30°	19782
35°	10657
40°	5705
45°	3368
50°	1955
55°	1048
60°	656
65°	465
70°	192
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 3368 cd/sqm



TEST NUMBER: P788880

CATALOG NUMBER: LER6D10D010-EC6DR200210IC9040-6LBDP1H

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	484.2	40.5
10°-20°	476.8	39.9
20°-30°	155.8	13.0
30°-40°	53.0	4.4
40°-50°	17.8	1.5
50°-60°	5.4	0.4
60°-70°	1.8	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1116.7	93.5
0°-40°	1169.8	97.9
0°-60°	1193.0	99.8
0°-90°	1194.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1194.8	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	6801	
5°	6112	484
15°	1691	477
25°	310	156
35°	80	53
45°	22	18
55°	6	5
65°	2	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P788880

CATALOG NUMBER: LER6D10D010-EC6DR200210IC9040-6LBDP1H

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	6800.7
0.5°	6800.7
1°	6792.2
1.5°	6775.2
2°	6744.3
2.5°	6703.2
3°	6645.0
3.5°	6563.9
4°	6443.4
4.5°	6296.8
5°	6112.1
5.5°	5869.3
6°	5620.4
6.5°	5335.2
7°	5056.0
7.5°	4729.0
8°	4437.1
8.5°	4143.4
9°	3872.1
9.5°	3623.2
10°	3391.2
12.5°	2435.0
15°	1690.8
17.5°	1104.6
20°	696.4
22.5°	451.2
25°	310.1
27.5°	218.0
30°	156.8
32.5°	112.6
35°	79.9
37.5°	55.7
40°	40.0
42.5°	29.1
45°	21.8
47.5°	17.0
50°	11.5
52.5°	7.3
55°	5.5
57.5°	4.2
60°	3.0
62.5°	2.4
65°	1.8



TEST NUMBER: P788880

CATALOG NUMBER: LER6D10D010-EC6DR200210IC9040-6LBDP1H

**CANDELA DISTRIBUTION (continued):**

	0°
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





67.5°		1.2
70°		0.6

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)