

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P788883

Luminaire Tested: LER6D10D010-EC6DR200210IC9040-6LBS1B

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P788883
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D10D010-EC6DR200210IC9040-6LBS1B
Description: 6 INCH ROUND SHALLOW SPECULAR BLACK TRIM, WITH 20° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1177.0 lumens
Efficiency: N/A
Efficacy: 100.6 lumens/watt
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.36
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 11.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P788883
CATALOG NUMBER: LER6D10D010-EC6DR200210IC9040-6LBS1B

Luminous Intensity Polar Plot

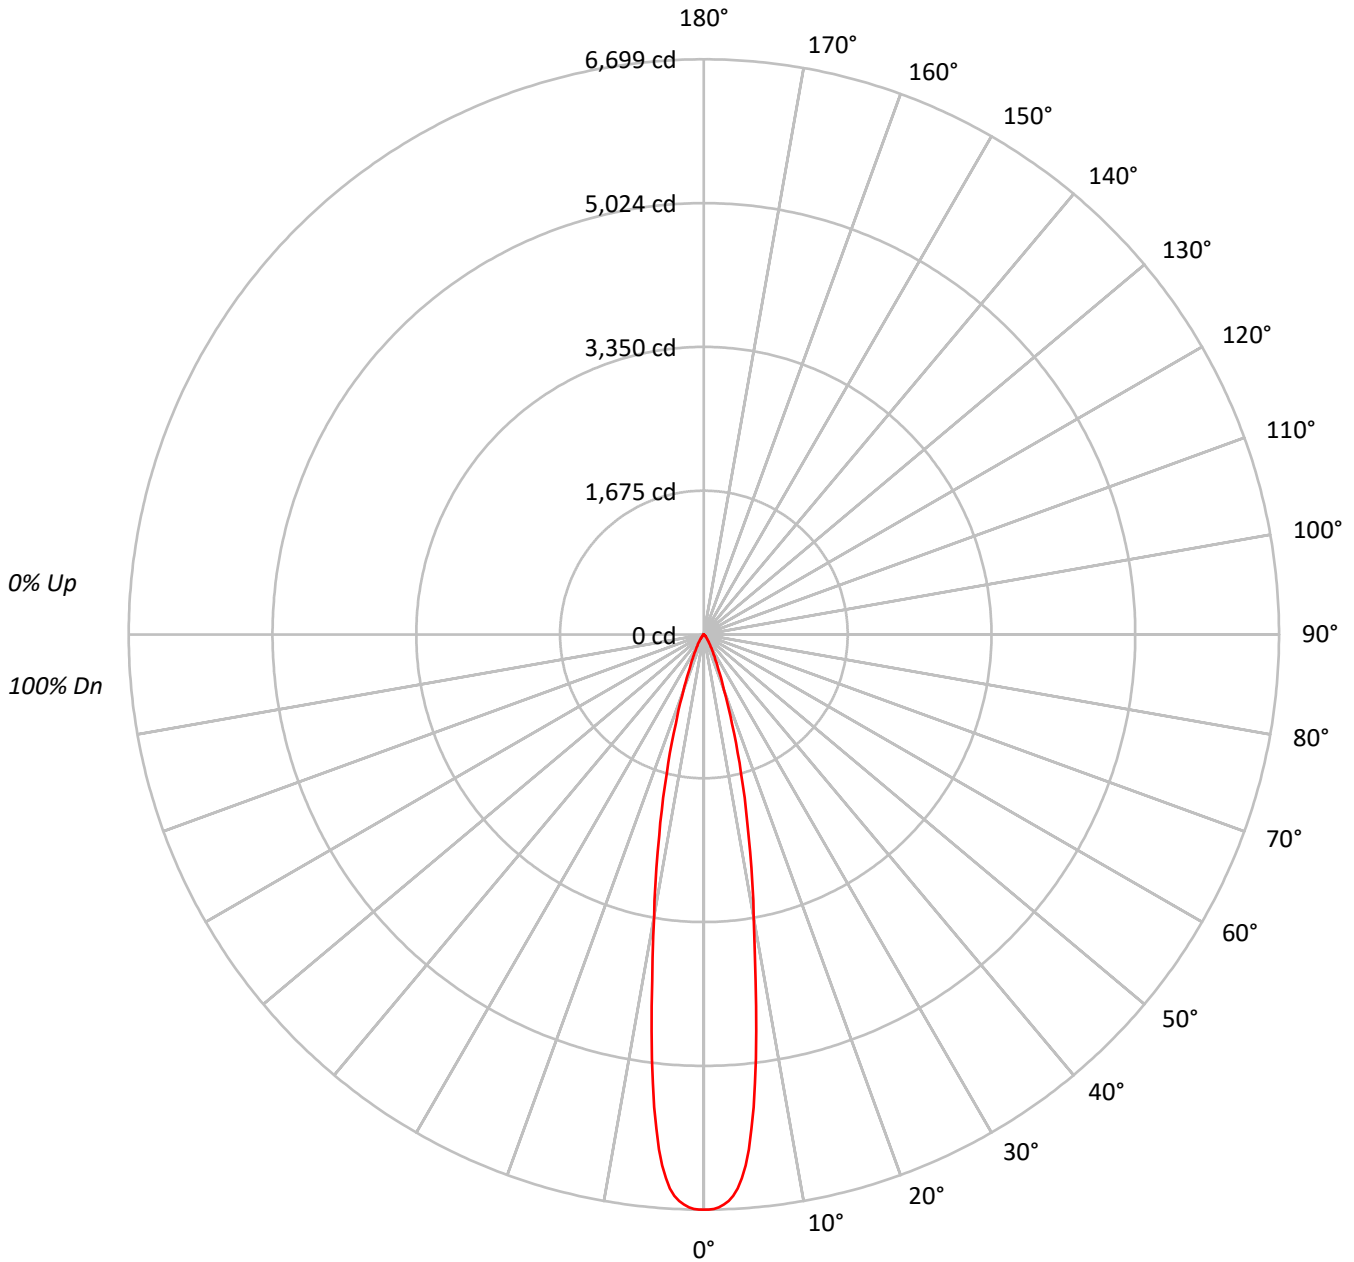



TEST NUMBER: P788883

CATALOG NUMBER: LER6D10D010-EC6DR200210IC9040-6LBS1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100															
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	97	97	98	98	97															
2	111	108	105	102	109	106	104	101	103	101	99	100	99	97	98	96	95	94	94	98	96	95															
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	93	92	91	91	98	96	95															
4	105	99	96	93	103	98	95	92	96	93	91	95	92	90	93	91	89	88	88	96	94	93															
5	102	96	92	89	100	95	91	89	94	90	88	92	89	87	91	88	86	85	85	94	92	91															
6	99	93	89	86	98	92	88	86	91	87	85	90	87	84	88	86	84	83	83	92	90	89															
7	96	90	86	83	95	89	86	83	88	85	82	87	84	82	86	84	82	81	81	90	88	87															
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	80	79	79	88	86	85															
9	91	85	81	78	91	85	81	78	84	80	78	83	80	78	82	80	78	77	77	86	84	83															
10	89	83	79	76	88	82	79	76	82	78	76	81	78	76	81	78	76	75	75	84	82	81															

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	731916
5°	660328
10°	370616
15°	188393
20°	79763
25°	36818
30°	19492
35°	10497
40°	5620
45°	3322
50°	1921
55°	1029
60°	656
65°	465
70°	192
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 3322 cd/sqm



TEST NUMBER: P788883

CATALOG NUMBER: LER6D10D010-EC6DR200210IC9040-6LBS1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	476.9	40.5
10°-20°	469.6	39.9
20°-30°	153.4	13.0
30°-40°	52.2	4.4
40°-50°	17.6	1.5
50°-60°	5.3	0.5
60°-70°	1.8	0.2
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1100.0	93.5
0°-40°	1152.2	97.9
0°-60°	1175.1	99.8
0°-90°	1177.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1177.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	6699	
5°	6021	477
15°	1666	470
25°	305	153
35°	79	52
45°	22	18
55°	5	5
65°	2	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P788883

CATALOG NUMBER: LER6D10D010-EC6DR200210IC9040-6LBS1B

CANDELA DISTRIBUTION (FULL):

	0°
0°	6698.8
0.5°	6698.8
1°	6690.4
1.5°	6673.7
2°	6643.3
2.5°	6602.8
3°	6545.5
3.5°	6465.6
4°	6346.9
4.5°	6202.5
5°	6020.6
5.5°	5781.4
6°	5536.2
6.5°	5255.2
7°	4980.3
7.5°	4658.1
8°	4370.6
8.5°	4081.3
9°	3814.1
9.5°	3568.9
10°	3340.5
12.5°	2398.6
15°	1665.5
17.5°	1088.0
20°	686.0
22.5°	444.4
25°	305.4
27.5°	214.7
30°	154.5
32.5°	111.0
35°	78.7
37.5°	54.9
40°	39.4
42.5°	28.6
45°	21.5
47.5°	16.7
50°	11.3
52.5°	7.2
55°	5.4
57.5°	4.2
60°	3.0
62.5°	2.4
65°	1.8



TEST NUMBER: P788883

CATALOG NUMBER: LER6D10D010-EC6DR200210IC9040-6LBS1B

CANDELA DISTRIBUTION (continued):

	0°
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



67.5°		1.2
70°		0.6

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)